



BRIDGE H-1412

HAZARDOUS MATERIALS SURVEY

BRIDGE INSPECTION AND SURVEY FOR PRESENCE OF
ASBESTOS AND HEAVY METAL(S),
JANUARY 2021

NDOT Hazardous Materials Section, Environmental Division

1263 South Stewart Drive
Carson City, NV 89712

EXECUTIVE SUMMARY

The inspection (survey) for hazardous materials was conducted on bridge H-1412 on January 20, 2021 by NDOT personnel from the Hazardous Materials section, of the Environmental Division. The bridge was evaluated for both asbestos containing materials (ACM) and heavy metals in coating materials. Two suspect metals samples and twenty-six suspect asbestos samples were collected with results and considerations summarized below:

- No ACMs were identified
- No heavy metals were identified in coating materials.

1.0 INTRODUCTION

NDOT conducted an asbestos survey and screening for metals-based coating materials on the following bridge structure located in Clark county:

- H-1412 (Pecos Grade Separator, I-515, Las Vegas, NV)

The survey was conducted on January 20, 2021 by NDOT personnel. Suspect Asbestos Containing Material (ACM) were identified and appropriately sampled. Coating materials, if present, were sampled and analyzed for the Resource Recovery and Conservation Act eight (RCRA 8) metals.

Bulk asbestos samples were analyzed by a National Voluntary Laboratory Accredited laboratory by polarized light microscopy (PLM). Metals analysis was conducted by a Nevada Certified Lab. The results of the laboratory analysis are attached as Appendix C and Appendix D, respectively.

2.0 BRIDGE DESCRIPTION

Bridge H-1412 was constructed in 1982 with improvements/maintenance-related activities in 1995 and 2001. Bridge H-1412 is constructed of concrete components including bridge stem wall/backwall, abutments, wing walls, sound walls, parapet, concrete barriers, and concrete bridge superstructure and deck overlain with asphaltic concrete. Three different types of coating materials were applied. Discrete coating materials were identified throughout the bridge as two types of texturing and paint on abutments. Bridge bearing pads were not located. Both fibrous and rubberized expansion joints were identified.

3.0 FIELD ACTIVITIES

The survey was conducted by NDOT personnel, appropriately licensed Asbestos and Hazardous Emergency Response Act (AHERA) accredited asbestos inspectors. The survey was conducted in general accordance with the sample collection protocols established in EPA regulation 40 CFR 763. A summary of the survey activities performed is discussed below. Copies of AHERA certifications and licenses for NDOT personnel conducting the survey are provided as Appendix E.

3.1 Visual and Physical Assessment

Survey activities began with a visual observation of the structures to identify homogeneous areas of suspect ACM and presence of coating materials. A physical assessment of each homogeneous area of suspect ACM was conducted to assess the friability and condition of the materials.

The homogeneous areas identified during the visual survey, the presence of coating materials, and sample identifiers are summarized in Table 1.

Table 1 - Bridge Component Descriptions

Homogeneous Area	Description	Sample IDs
A	bridge and bridge deck	DECK-1, DECK-2, DECK-3
B	sound wall	S-WALL-1, S-WALL-2, S-WALL-3
C	wing walls	WW-1, WW-2, WW-3
D	parapet	PARA-1, PARA-2, PARA-3
E	stem/back wall	STEM-1, STEM-2, STEM-3
F	north parapet	N-PARA-1, N-PARA-2, N-PARA-3
G	abutment	ABT-1, ABT-2, ABT-3
H	brown fibrous expansion joint	EXP-1
I	brown fibrous expansion joint	EXP-2
J	abutment paint (composite)	ABT PAINT, ABT-PAINT-1412 ^(a)
K	white texture (composite)	TXT-1, TEXTURE-412 ^{(a)(b)}
L	white cementous texture (composite)	TXT-2

notes: a) Heavy metals sample identifier.

b) Sample "TEXTURE-1412" mislabeled by laboratory as "TEXTURE-412."

3.2 Sample Collection

Based on results of the visual observation, bulk samples of suspect ACM and coating materials were collected in general accordance with AHERA sampling protocols. Representative samples of suspect materials were collected in each homogeneous area. Samples were placed in new sealable containers and labeled with unique sample numbers.

3.3 Sample Analysis

Bulk samples of ACM were submitted under chain of custody to Asbestos TEM Laboratories for analysis by PLM. The percentage of asbestos, where applicable, was determined by microscopic visual estimation. Coating material samples were also submitted to Alpha Analytical and analyzed for heavy metals using EPA 6020 test method.

A discussion of suspect ACM and suspect metals-based coating samples collected during the survey and findings are included in Section 6.0.

4.0 PLAN REVIEW

Design plans did not require review.

5.0 REGULATORY OVERVIEW

5.1 Asbestos Regulations

NESHAP (40 CFR Part 61, Subpart M) regulates asbestos fiber emissions and asbestos waste disposal practices. It also requires the identification and classification of existing building materials prior to demolition or renovation activity. Under NESHAP, asbestos-containing building materials are classified as either friable, Category I non-friable, or Category II non-friable ACM. Category I non-friable ACM includes packings, gaskets, resilient floor coverings and asphalt roofing products containing more than 1% asbestos. Category II non-friable ACM are any materials other than Category I materials that contain more than 1% asbestos.

Friable ACM, Category I and Category II non-friable ACM which are in poor condition and have become friable or which will be subjected to drilling, sanding, grinding, cutting or abrading and which could be crushed or pulverized during anticipated renovation or demolition activities are considered Regulated ACM (RACM).

5.2 Coating Material and Lead Based Paint Regulations

Lead-based paint (LBP) is defined as a surface coating or paint containing lead in excess of 0.5% (5000 mg/Kg) by weight (EPA Toxic Substance Control Act, Section 401).

Under EPA regulations heavy metal impacted wastes generated during abatement activities are handled as either a solid waste or a hazardous waste, depending on the concentration of each of the metal(s) and the method of coating material removal.

6.0 FINDINGS AND RECOMMENDATIONS

6.1 Suspect Asbestos Containing Materials

A total of twenty-six bulk samples were collected from twelve homogeneous areas of suspect ACM. No Asbestos Containing Materials were identified.

A bridge Location Map is included in Appendix A. A photographic log showing homogenous areas is presented in Appendix B. Asbestos analytical results are included in Appendix C. A summary of the suspect ACMs identified is provided in Table 2.

Table 2 – Summary of Suspected ACM

Homogeneous Sampling Area	Sample Number	Material Description/Sample Location	Asbestos Results ⁽¹⁾ , %	NESHAP Category ⁽²⁾	Friability ⁽³⁾
A	DECK-1	bridge and bridge deck	Not detected	N/A	non-friable
	DECK-2				
	DECK-3				
B	S-WALL-1	sound wall	Not detected	N/A	non-friable
	S-WALL-2				
	S-WALL-3				
C	WW-1	wing walls	Not detected	N/A	non-friable
	WW-2				
	WW-3				
D	PARA-1	parapet	Not detected	N/A	non-friable
	PARA-2				
	PARA-3				
E	STEM-1	stem/back wall	Not detected	N/A	non-friable
	STEM-2				
	STEM-3				
F	N-PARA-1	north parapet	Not detected	N/A	non-friable
	N-PARA-2				
	N-PARA-3				
G	ABT-1	abutment	Not detected	N/A	non-friable
	ABT-2				
	ABT-3				
H	EXP-1	brown fibrous expansion joint	Not detected	N/A	friable

I	EXP-2	brown fibrous expansion joint	Not detected	N/A	friable
J	ABT-PAINT	abutment paint (composite)	Not detected	N/A	non-friable
K	TXT-1	white texture (composite)	Not detected	N/A	non-friable
L	TXT-2	white cementous texture (composite)	Not detected	N/A	non-friable

notes: (1) PLM unless otherwise noted.

(2) NESHAAAP category I, category II, RACM, or (N/A) not applicable.

(3) Friable materials are those that, when dry, may be crumbled, pulverized or reduced to powder by hand pressure.

Additional suspect materials, other than those identified during the survey, could exist within the structures in areas not accessible to the inspector at the time of the survey. Should suspect materials other than those identified during this survey be uncovered during the renovation/demolition process, those materials should be assumed to be ACM until sampling and analysis can confirm or refute this assumption.

6.2 Coating Materials

One composite sample from the textured coating material found throughout concrete components “TEXTURE-412”, and one composite paint sample from the abutment “ABT-PAINT-1412” were collected for analysis. These composite samples were analyzed for total arsenic, barium, cadmium, chromium, lead, selenium, silver, and mercury. Based on the EPA’s definition of LBP, none of the coating materials are a LBP. Analytical results are included in Appendix D and laboratory results are summarized in Table 3.

The white texture cementous material identified as “TXT-2” was not sampled for heavy metals. This was attributed to the cementous nature of the material and the historic absence of heavy metals, primarily lead.

Table 3 – Summary of Coating Material

Sample Identification	Material Description/Sample Location	Heavy Metal Results ⁽¹⁾ , mg/Kg							
		As	Ba	Cd	Cr	Pb	Se	Ag	Hg
TEXTURE-412 ^(a)	white texture (composite)	nd	nd	nd	nd	nd	nd	nd	nd
ABT-PAINT-1412	abutment paint (composite)	nd	nd	nd	nd	nd	nd	nd	nd

notes: (1) EPA test method 6020.

nd – not detected above method limits.


(a) Sample “TEXTURE-1412” mislabeled by laboratory as “TEXTURE-412.”

6.3 Recommendations

No ACMs were identified. Lead was found in steel component paint but at regulatory insignificant concentrations. Total concentration(s) of the above metal(s) indicates that the coating wastes would not be a toxic characteristic hazardous waste. However, the method used to remove the coating material will need to be taken into consideration prior to disposal.

Appendix A
Bridge Location Map

Bridge H-1412
Pecos Grade Separator, I-515
Las Vegas, Nevada

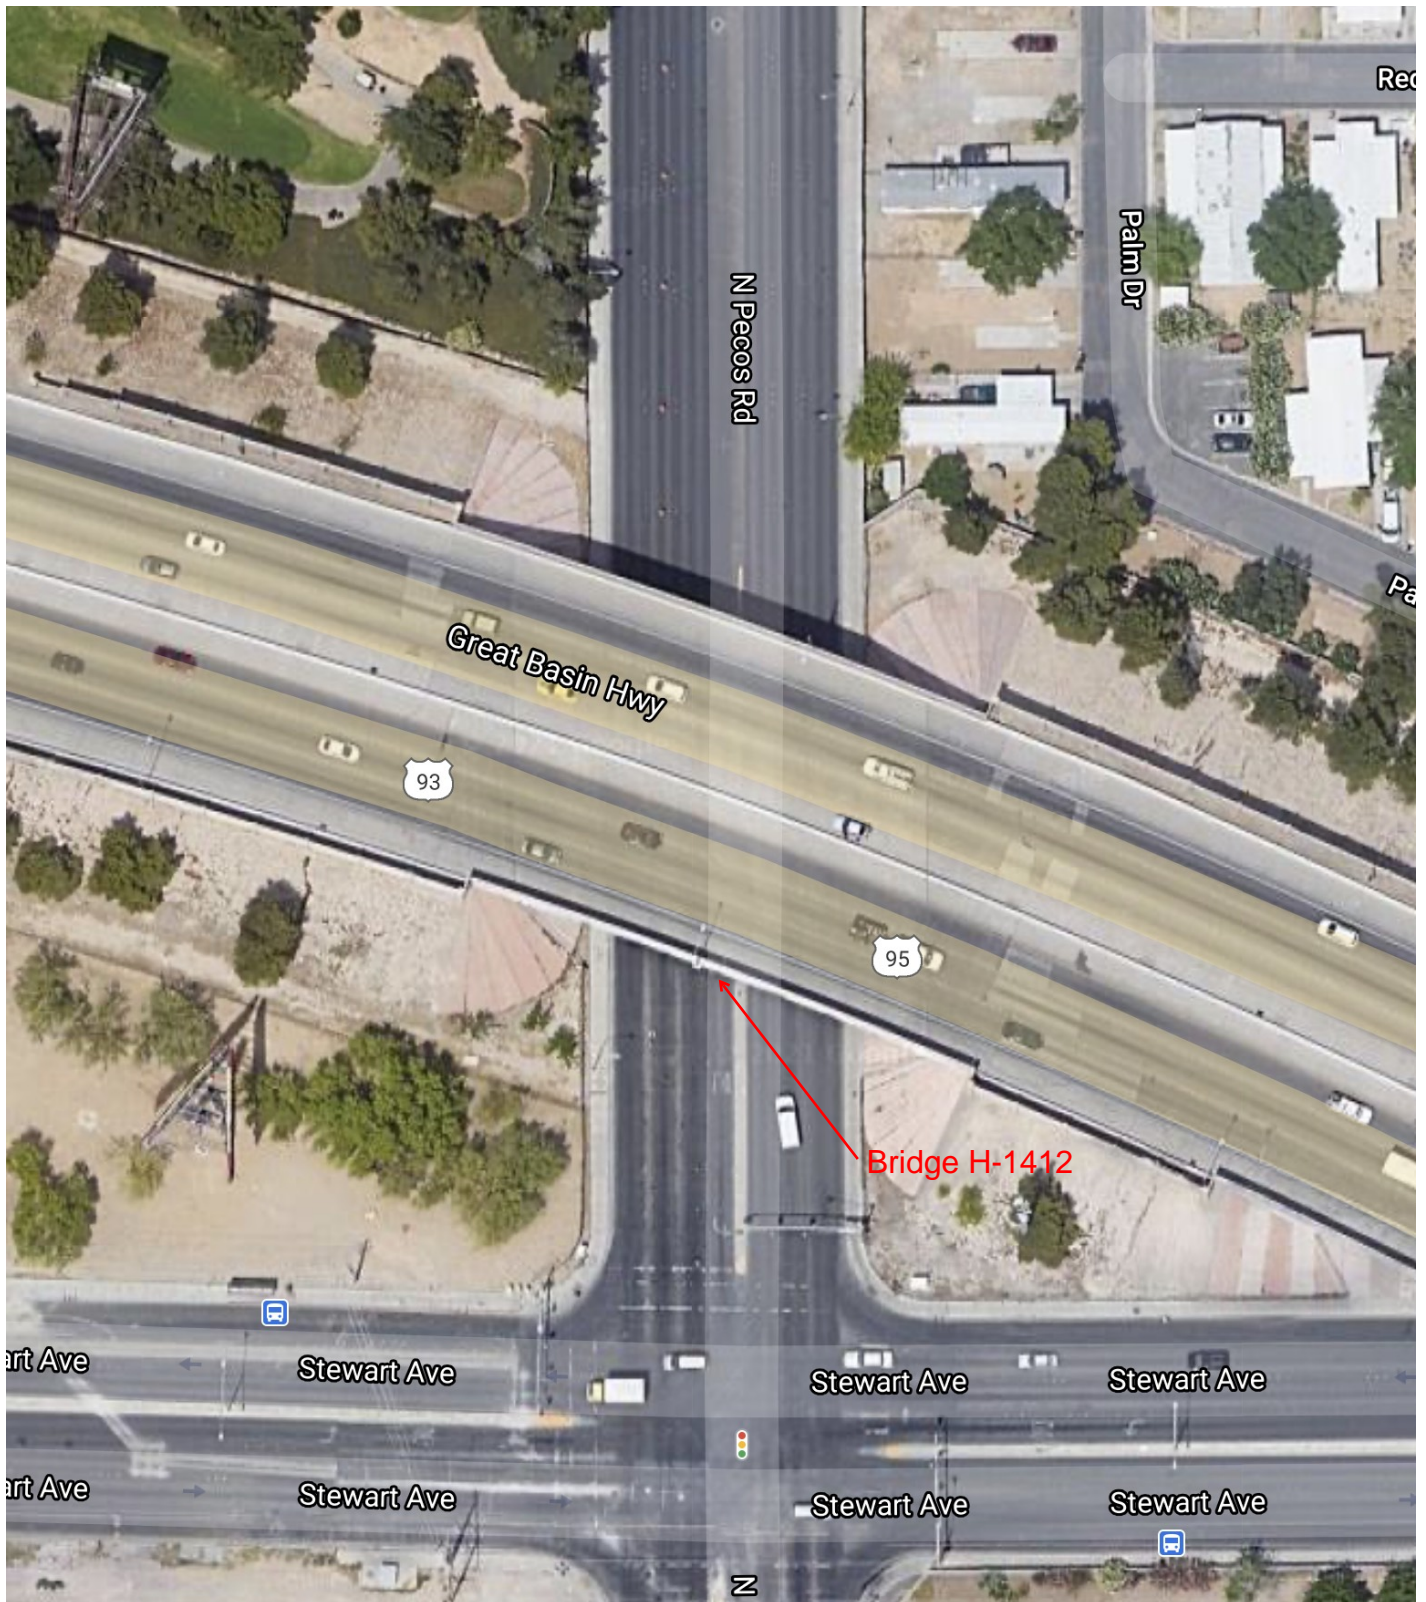

Appendix B
Bridge Photo Log

PHOTOGRAPHIC DOCUMENTATION

**NDOT Hazardous Materials Survey
Bridge H-1412
I-515
Las Vegas, Nv**

PHOTO 1

DATE:
1/20/2021

DIRECTION:
North

TAKEN BY:
Brian Reed

DESCRIPTION:
Bridge H-1412.



PHOTO 2

DATE:
1/20/2021

DIRECTION:
West

TAKEN BY:
Brian Reed

DESCRIPTION:
Abutment and stemwall.



PHOTOGRAPHIC DOCUMENTATION

**NDOT Hazardous Materials Survey
Bridge H-1412
I-515
Las Vegas, Nv**

PHOTO 3

DATE:
1/20/2021

DIRECTION:
Northwest

TAKEN BY:
Brian Reed

DESCRIPTION:
Abutment,
wingwall, parapet
and soundwalls



PHOTO 4

DATE:
1/20/2021


DIRECTION:
East

TAKEN BY:
Brian Reed

DESCRIPTION:
Abutment and
stemwall.



Appendix C
Asbestos Sample(s)
Analytical Results

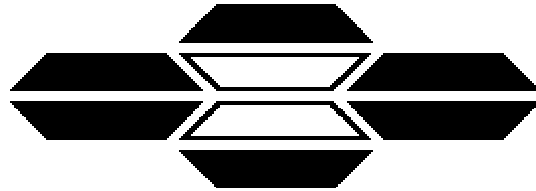

ASBESTOS TEM LABORATORIES, INC.

**EPA Method 600/R-93/116
Polarized Light Microscopy
Analytical Report**

Report No. 143641

1350 Freeport Blvd., Unit 104
Sparks, NV 89431
(775) 359-3377
FAX (775) 359-2798

Main Office Located At:
3431 Ettie Street Oakland, CA 94608
Ph. (510) 704-8930 Fax (510) 704-8929



ASBESTOS TEM LABORATORIES, INC



NVLAP Lab Code 200104-0

Jan-29-21

Robert Piekarz
Nevada Department of Transportation
1263 South Stewart Street
Carson City, NV 89712

RE: LABORATORY JOB # 9092-00054
Polarized light microscopy analytical results for 26 bulk sample(s).
Job Site: D1 Las Vegas
Job No.:
Report No.: 143641

Enclosed please find the bulk material analytical results for one or more samples submitted for asbestos analysis. The analyses were performed in accordance with EPA Method 600/R-93/116 or 600/M4-82-020 for the determination of asbestos in bulk building materials by polarized light microscopy (PLM). Please note that while PLM analysis is commonly performed on non-friable and fine grained materials such as floor tiles and dust, the EPA method recognizes that PLM is subject to limitations. In these situations, accurate results may only be obtainable through the use of more sophisticated and accurate techniques such as transmission electron microscopy (TEM) or X-ray diffraction (XRD).

Prior to analysis, samples are logged-in and all data pertinent to the sample recorded. The samples are checked for damage or disruption of any chain-of-custody seals. A unique laboratory ID number is assigned to each sample. A hard copy log-in sheet containing all pertinent information concerning the sample is generated. This and all other relevant paper work are kept with the sample throughout the analytical procedures to assure proper analysis.

Each sample is opened in a class 100 HEPA negative air hood. A representative sampling of the material is selected and placed onto a glass microscope slide containing a drop of refractive index oil. The glass slide is placed under a polarizing light microscope where standard mineralogical techniques are used to analyze and quantify the various materials present, including asbestos. The data is then compiled into standard report format and subjected to a thorough quality assurance check before the information is released to the client.

Please note all samples will be held for 3 months from the date of receipt unless otherwise requested by client.

Sincerely Yours,

Laboratory Analyst
ASBESTOS TEM LABORATORIES, INC.

--- These results relate only to the samples tested and must not be reproduced, except in full, with the approval of the laboratory. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. ---



NVLAP Lab Code 200104-0

POLARIZED LIGHT MICROSCOPY ANALYTICAL REPORT

EPA Method 600/R-93/116 or 600/M4-82-020

Page: 1 of 3

Contact: Robert Piekarz	Samples Indicated: 26	Report No. 143641
Address: Nevada Department of 1263 South Stewart Street Carson City, NV 89712	Reg. Samples Analyzed: 26	Date Submitted: Jan-22-21
	Split Layers Analyzed: 0	Date Reported: Jan-29-21
Job Site / No. D1 Las Vegas		

SAMPLE ID	ASBESTOS % TYPE	OTHER DATA 1) Non-Asbestos Fibers 2) Matrix Materials 3) Date/Time Collected 4) Date Analyzed	DESCRIPTION
			FIELD LAB
DECK-1 Lab ID # 9092-00054-001	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq	Grey concrete - bridge deck/ mornlone(?)
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
DECK-2 Lab ID # 9092-00054-002	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - bridge deck/ mornlone(?)
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
DECK-3 Lab ID # 9092-00054-003	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - bridge deck/ mornlone(?)
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
S-WALL-1 Lab ID # 9092-00054-004	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Red/ grey concrete - sound wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
S-WALL-2 Lab ID # 9092-00054-005	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Red/ grey concrete - sound wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
S-WALL-3 Lab ID # 9092-00054-006	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Red/ grey concrete - sound wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
WW-1 Lab ID # 9092-00054-007	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - wing wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
WW-2 Lab ID # 9092-00054-008	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - wing wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
WW-3 Lab ID # 9092-00054-009	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - wing wall
		3) 1-20-21 4) Jan-29-21	Concrete-Grey
PARA-1 Lab ID # 9092-00054-010	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op.Prop. Same as in</i>	Grey concrete - parapet, original
		3) 1-20-21 4) Jan-29-21	Concrete-Grey

Limit of quantitation of method is estimated to be 1% asbestos using a visual area estimation technique. Split samples are inhomogeneous.

Laboratory Analyst
Greg Hanes



NVLAP Lab Code 200104-0

POLARIZED LIGHT MICROSCOPY ANALYTICAL REPORT

EPA Method 600/R-93/116 or 600/M4-82-020

Contact: Robert Piekarz	Samples Indicated: 26	Report No. 143641
Address: Nevada Department of 1263 South Stewart Street Carson City, NV 89712	Reg. Samples Analyzed: 26	Date Submitted: Jan-22-21
	Split Layers Analyzed: 0	Date Reported: Jan-29-21
Job Site / No. D1 Las Vegas		

SAMPLE ID	ASBESTOS % TYPE	OTHER DATA 1) Non-Asbestos Fibers 2) Matrix Materials 3) Date/Time Collected 4) Date Analyzed	DESCRIPTION
			FIELD LAB
PARA-2 Lab ID # 9092-00054-011	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - parapet
			Concrete-Grey
PARA-3 Lab ID # 9092-00054-012	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - parapet
			Concrete-Grey
STEM-1 Lab ID # 9092-00054-013	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - stem wall
			Concrete-Grey
STEM-2 Lab ID # 9092-00054-014	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - stem wall
			Concrete-Grey
STEM-3 Lab ID # 9092-00054-015	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - stem wall
			Concrete-Grey
N-PARA-1 Lab ID # 9092-00054-016	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - new parapet
			Concrete-Grey
N-PARA-2 Lab ID # 9092-00054-017	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - new parapet
			Concrete-Grey
N-PARA-3 Lab ID # 9092-00054-018	None Detected	1) None Detected 2) 99-100% Qtz, Calc, Opq <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Grey concrete - new parapet
			Concrete-Grey
ABT-1 Lab ID # 9092-00054-019	None Detected	1) None Detected 2) 99-100% Opq, Calc, Qtz 3) 1-20-21 4) Jan-29-21	Reddish concrete - abutment
			Concrete-Red
ABT-2 Lab ID # 9092-00054-020	None Detected	1) None Detected 2) 99-100% Opq, Calc, Qtz <i>Fib. Op. Prop. Same as in</i> 3) 1-20-21 4) Jan-29-21	Reddish concrete - abutment
			Concrete-Red

Limit of quantitation of method is estimated to be 1% asbestos using a visual area estimation technique. Split samples are inhomogeneous.

Laboratory Analyst
Greg Hanes



NVLAP Lab Code 200104-0

POLARIZED LIGHT MICROSCOPY ANALYTICAL REPORT

EPA Method 600/R-93/116 or 600/M4-82-020

Contact: Robert Piekarz	Samples Indicated: 26	Report No. 143641
Address: Nevada Department of 1263 South Stewart Street Carson City, NV 89712	Reg. Samples Analyzed: 26	Date Submitted: Jan-22-21
	Split Layers Analyzed: 0	Date Reported: Jan-29-21
Job Site / No. D1 Las Vegas		

SAMPLE ID	ASBESTOS % TYPE	OTHER DATA	DESCRIPTION
		1) Non-Asbestos Fibers 2) Matrix Materials 3) Date/Time Collected 4) Date Analyzed	FIELD LAB
ABT-3 Lab ID # 9092-00054-021	None Detected	1) None Detected 2) 99-100% Opq. Calc, Qtz <i>Fib. Op. Prop. Same as in</i>	Reddish concrete - abutment
		3) 1-20-21 4) Jan-29-21	Concrete-Red
EXP-1 Lab ID # 9092-00054-022	None Detected	1) 70-80% Cellulose 2) 20-30% Opq	Brown fiberboard - expansion joints
		3) 1-20-21 4) Jan-29-21	Fiberboard-Brown
EXP-2 Lab ID # 9092-00054-023	None Detected	1) 70-80% Cellulose 2) 20-30% Opq <i>Fib. Op. Prop. Same as in</i>	Brown fiberboard - expansion joints
		3) 1-20-21 4) Jan-29-21	Fiberboard-Brown
ABT PAINT Lab ID # 9092-00054-024	None Detected	1) None Detected 2) 99-100% Opq. Paint	Reddish paint - abutment
		3) 1-20-21 4) Jan-29-21	Paint-Orange/Red
TXT-1 Lab ID # 9092-00054-025	None Detected	1) None Detected 2) 99-100% Opq. Calc	White/ grey texturing - texturing
		3) 1-20-21 4) Jan-29-21	Texture-Grey/White
TXT-2 Lab ID # 9092-00054-026	None Detected	1) None Detected 2) 99-100% Opq. Calc <i>Fib. Op. Prop. Same as in</i>	White/ grey texturing - texturing
		3) 1-20-21 4) Jan-29-21	Texture-Grey/White
Lab ID #		1)	
		2)	
Lab ID #		3)	
		4)	
Lab ID #		1)	
		2)	
Lab ID #		3)	
		4)	
Lab ID #		1)	
		2)	
Lab ID #		3)	
		4)	

Limit of quantitation of method is estimated to be 1% asbestos using a visual area estimation technique. Split samples are inhomogeneous.

Laboratory Analyst
Greg Hanes

Survey Data

Inspectors: Brian Reed/Robert Plekarz		Project Name: <u>Bridge H 1412</u>		Project Number:		Date Sampled: <u>1/20/21</u>		
Phone: 775-888-7892 Fax: 775-888-7104		Project Location: <u>DP: Falls Vegas</u>		Analysis Type: Asbestos		Air <u>Built</u>		
Turn-A-Round Time: Rush 24-Hour <u>Day</u>		Requests: <u>Verbal</u>		Fax		Test to First Positive: Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
Lab #	Sample ID	Material Description	Sample Location	Location of Materials	Quantity	Condition	Friable	Asbestos %
1	<u>Deck-1</u>	<u>Grey concrete</u>	<u>Bridge Deck/Main</u>	<u>Bridge H 1412</u>	<u>1</u>	<u>G</u>	<u>N</u>	
2	<u>Deck-2</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
3	<u>Deck-3</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
4	<u>S-Wall-1</u>	<u>red/grey concrete</u>	<u>Sound wall</u>		<u>1</u>	<u>G</u>	<u>N</u>	
5	<u>S-Wall-2</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
6	<u>S-Wall-3</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
7	<u>WW-1</u>	<u>grey concrete</u>	<u>wing wall</u>		<u>1</u>	<u>G</u>	<u>N</u>	
8	<u>WW-2</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
9	<u>WW-3</u>	↓	↓		<u>1</u>	<u>G</u>	<u>N</u>	
10	<u>Para-1</u>	<u>Grey concrete</u>	<u>parapet - original</u>		<u>1</u>	<u>G</u>	<u>N</u>	

Comments/Additional Information

MATERIAL	CONDITION	UNITS	ASBESTOS %
GF1 - Pipe Fitted Insulation	G - Good	LF - Linear Feet	A - Asbestos Asbestos
PR1 - Pipe Run Insulation	D - Damaged	SF - Square Feet	C - Chrysotile Asbestos
DI - Duct Insulation	SD - Significant Damage	CF - Cubic Feet	NDA - No Asbestos Detected
TI - Tank Insulation			Assumed ACM - No Samples Taken
EJ - Expansion Joint			
RI - Ruler Insulation			
GA - Gasket			
D - Debris			
TBI - Thermal System Insulation			
CBM - Cove Base Mastic			
AT - Acoustical Tile			
SA - Spray Acoustic			
W - Wall			
DW - Drywall			
P - Plaster			
IC - Joint Compound			

Relinquished By: RTN Relinquished By: _____
 Date/Time: 1/22/21 10:55 Date/Time: _____
 Received By: Andrew Stroud ATEM Received By: _____

Survey Data

Inspectors: Brian Reed/Robert Piekarz		Project Name: <u>Bridge H-1412</u>		Project Number:		Date Sampled: <u>1/20/21</u>		
Phone: 775-888-7892		Fax: 775-888-7104		Analysis Type: Asbestos		Air		
Turn-A-Round Time: <u>Rush</u>		24-Hour: <u>2 Day</u>		Requests: Verbal		Fax		
Lab #	Sample ID	Material Description	Sample Location	Location of Materials	Quantity	Condition	Friable	Asbestos %
1	Para-2	Grey Concrete	Parapet	Bridge H-1412	1	G	N	
2	Para-3		Stem wall		1	G	N	
3	Stem-1				1	G	N	
4	Stem-2				1	G	N	
5	Stem-3	↓	↓	1	G	N		
6	N-Para-1		New Parapet		1	G	N	
7	N-Para-2				1	G	N	
8	N-Para-3				1	G	N	
9	Abt-1	reddish concrete	Abutment		1	G	N	
10	Abt-2	↓	↓		1	G	N	

Comments/Additional Information

MATERIAL	CONDITION	UNITS	ASBESTOS %
VT - Vinyl Tile GA - Gasket D - Debris TSI - Thermal System Insulation R - Roof DW - Drywall JC - Joint Compound	G - Good D - Damaged SD - Significant Damage	LF - Linear Feet SF - Square Feet CF - Cubic Feet	A - Asbestos C - Chrysotile NDA - No Asbestos Detected Assumed ACM - No Samples Taken

Relinquished By: [Signature] Relinquished By: _____
 Date/Time: 1/20/21 1055 Date/Time: _____
 Received By: _____ Received By: _____

Survey Data

Inspectors: Brian Reed/Robert Piekarz		Project Name: <u>Bridge H-1412</u>		Project Number:		Date Sampled: <u>1/20/21</u>		
Phone: 775-888-7892		Fax: 775-888-7104		Analysis Type: Asbestos		Air <u>Bulk</u>		
Turn-A-Round Time: Rush		24-Hour <u>2 Day</u>		Requests: Verbal		Fax		
Lab #	Sample ID	Material Description	Sample Location	Location of Materials	Quantity	Condition	Friable	Asbestos %
1	Abb-3	reddish concrete	Abutment	Bridge H-1412	1	G	N	
2	Exp-1	Brown fiberboard	expansion joints		1	G	N	
3	Exp-2	↓	↓		1	G	N	
4	Abt Pink	reddish paint	Abutment		1	G	N	
5	Test-1	white/grey texturing	texturing		1	G	N	
6	Test-2	↓	↓		1	G	N	
7								
8								
9								
10								

Comments/Additional Information

MATERIAL	CONDITION	UNITS	ASBESTOS %
VF - Vinyl Tile	G - Good	LF - Linear Feet	A - Asbestos Asbestos
M - Mastic	D - Damaged	SF - Square Feet	C - Chrysotile Asbestos
CBM - Cover Base Mastic	SD - Significant Damage	CF - Cubic Feet	NDA - No Asbestos Detected
AT - Acoustical Tile			Assumed ACM - No Samples Taken
SA - Spray Acoustic			
W - Wall			
P - Plaster			
GA - Gasket			
D - Debris			
ISI - Thermal System			
Insulation			
R - Roof			
DW - Drywall			
JC - Joint Compound			

Relinquished By: B. Reed Relinquished By: _____
 Date/Time: 1/20/21 1055 Date/Time: _____
 Received By: _____ Received By: _____

Appendix D
Material Coating Sample(s)
Analytical Results



Alpha Analytical, Inc.
255 Glendale Ave, #21
Sparks, Nevada 89431
TEL: (775) 355-1044 FAX: (775) 355-0406
Website: www.alpha-analytical.com

February 02, 2021

Robert Piekarz
Nevada DOT Environmental (NDOT)
1263 S. Stewart St.
Carson City, NV 89712
TEL: (775) 888-7692
FAX: (775) 888-7104

RE: Bridges D1

Order No.: NDO2101114

Dear Robert Piekarz:

The result of this report apply to the sample(s) as received.

There were no problems with the analytical events associated with this report unless noted.

Quality control data is within laboratory defined or method specified acceptance limits except if noted.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,

A handwritten signature in black ink that reads "Roger Scholl".

Roger Scholl
Laboratory Director
255 Glendale Ave, #21
Sparks, Nevada 89431



Alpha Analytical, Inc.
255 Glendale Ave, #21
Sparks, Nevada 89431
TEL: (775) 355-1044 FAX: (775) 355-0406
Website: www.alpha-analytical.com

Analytical Report

WO#: NDO2101114

Report Date: 2/2/2021

CLIENT: Nevada DOT Environmental (NDOT)

Collection Date: 1/20/2021 2:00:00 PM

Project: Bridges D1

Lab ID: 2101114-01

Matrix: OTHER

Client Sample ID: Abt Paint-1412

Analyses	Result	RL	Qual	Units	Date Analyzed	Method
Chromium (Cr)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Arsenic (As)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Selenium (Se)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Silver (Ag)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Cadmium (Cd)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Barium (Ba)	ND	1.0		mg/L	1/26/2021	Metals by EPA 6020
Mercury (Hg)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Lead (Pb)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020

NOTES:

This analysis was performed on a TCLP extract.



Alpha Analytical, Inc.
 255 Glendale Ave, #21
 Sparks, Nevada 89431
 TEL: (775) 355-1044 FAX: (775) 355-0406
 Website: www.alpha-analytical.com

Analytical Report

WO#: NDO2101114

Report Date: 2/2/2021

CLIENT: Nevada DOT Environmental (NDOT)

Collection Date: 1/20/2021 2:10:00 PM

Project: Bridges D1

Lab ID: 2101114-02

Matrix: OTHER

Client Sample ID: Texture-412

Analyses	Result	RL	Qual	Units	Date Analyzed	Method
Chromium (Cr)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Arsenic (As)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Selenium (Se)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Silver (Ag)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Cadmium (Cd)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Barium (Ba)	ND	1.0		mg/L	1/26/2021	Metals by EPA 6020
Mercury (Hg)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020
Lead (Pb)	ND	0.10		mg/L	1/26/2021	Metals by EPA 6020

NOTES:

This analysis was performed on a TCLP extract.



Alpha Analytical, Inc.
 255 Glendale Ave, #21
 Sparks, Nevada 89431
 TEL: (775) 355-1044 FAX: (775) 355-0406
 Website: www.alpha-analytical.com

QC SUMMARY REPORT

WO#: 2101114

02-Feb-21

Client: Nevada DOT Environmental (NDOT)

Project: Bridges D1

TestCode: METALS_T_6020

Sample ID: MB-12294	SampType: MBLK	TestCode: METALS_T_6	Units: mg/L
Client ID: PBW	Batch ID: 12294	TestNo: E200.8	
Prep Date: 1/26/2021	RunNo: 10900	SeqNo: 309185	
Analysis Date: 1/26/2021			

Analyte	Result	PQL	SPK Value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Chromium (Cr)	ND	0.01									
Arsenic (As)	ND	0.005									
Selenium (Se)	ND	0.005									
Silver (Ag)	ND	0.005									
Cadmium (Cd)	ND	0.002									
Barium (Ba)	ND	0.005									
Mercury (Hg)	ND	0.001									
Lead (Pb)	ND	0.005									

Sample ID: LCS-D-12294	SampType: LCS-D	TestCode: METALS_T_6	Units: mg/L
Client ID: LCSS02	Batch ID: 12294	TestNo: E200.8	
Prep Date: 1/26/2021	RunNo: 10900	SeqNo: 309187	
Analysis Date: 1/26/2021			

Analyte	Result	PQL	SPK Value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Chromium (Cr)	0.252	0.01	0.25	0	101	79.51	120.49	0.243	3.7	20	
Arsenic (As)	0.258	0.005	0.25	0	103	79.51	120.49	0.244	5.5	20	
Selenium (Se)	0.252	0.005	0.25	0	101	79.51	120.49	0.237	6	20	
Silver (Ag)	0.239	0.005	0.25	0	95.7	79.51	120.49	0.232	3	20	
Cadmium (Cd)	0.239	0.002	0.25	0	95.7	79.51	120.49	0.235	1.9	20	
Barium (Ba)	0.243	0.005	0.25	0	97.4	79.51	120.49	0.231	5.4	20	
Mercury (Hg)	0.00442	0.001	0.005	0	88.3	79.51	120.49	0.00412	7	20	
Lead (Pb)	0.237	0.005	0.25	0	94.9	79.51	120.49	0.224	5.8	20	

Sample ID: LCS-12294	SampType: LCS	TestCode: METALS_T_6	Units: mg/L
Client ID: LCSW	Batch ID: 12294	TestNo: E200.8	
Prep Date: 1/26/2021	RunNo: 10900	SeqNo: 309186	
Analysis Date: 1/26/2021			

Analyte	Result	PQL	SPK Value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Chromium (Cr)	0.243	0.01	0.25	0	97.1	79.51	120.49				
Arsenic (As)	0.244	0.005	0.25	0	97.6	79.51	120.49				
Selenium (Se)	0.237	0.005	0.25	0	94.9	79.51	120.49				
Silver (Ag)	0.232	0.005	0.25	0	92.8	79.51	120.49				
Cadmium (Cd)	0.235	0.002	0.25	0	93.9	79.51	120.49				
Barium (Ba)	0.231	0.005	0.25	0	92.3	79.51	120.49				
Mercury (Hg)	0.00412	0.001	0.005	0	82.4	79.51	120.49				
Lead (Pb)	0.224	0.005	0.25	0	89.5	79.51	120.49				

Qualifiers: B Analyte detected in the associated Method Blank
 ND Not Detected at the Reporting Limit
 R RPD outside accepted recovery limits
 S Spike Recovery outside accepted recovery limit



Alpha Analytical, Inc.
 255 Glendale Ave, #21
 Sparks, Nevada 89431
 TEL: (775) 355-1044 FAX: (775) 355-0406
 Website: www.alpha-analytical.com

QC SUMMARY REPORT

WO#: 2101114

02-Feb-21

Client: Nevada DOT Environmental (NDOT)

Project: Bridges D1

TestCode: METALS_T_6020

Sample ID: LCS-12294	SampType: LCS	TestCode: METALS_T_6	Units: mg/L								
Client ID: LCSW	Batch ID: 12294	TestNo: E200.8									
Prep Date: 1/26/2021	RunNo: 10900	SeqNo: 309186									
Analysis Date: 1/26/2021											
Analyte	Result	PQL	SPK Value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Qualifiers:

- B Analyte detected in the associated Method Blank
- ND Not Detected at the Reporting Limit
- R RPD outside accepted recovery limits
- S Spike Recovery outside accepted recovery limit



Alpha Analytical, Inc.
255 Glendale Ave, #21
Sparks, Nevada 89431
TEL: (775) 355-1044 FAX: (775) 355-0406
Website: www.alpha-analytical.com

Definition Only

WO#: 2101114
Date: 2/2/2021

Definitions:

ND = Not Detected

C = Reported concentration includes additional compounds uncharacteristic of common fuels and lubricants.

D = Reporting Limits were increased due to high concentrations of non-target analytes.

H = Reporting Limits were increased due to the hydrocarbons present in the sample.

J = The analyte was positively identified; the associated numerical value is the approximate concentration of the analyte in the sample.

K = DRO concentration may include contributions from lighter-end hydrocarbons (e.g. gasoline) that elute in the DRO range.

L = DRO concentration may include contributions from heavier-end hydrocarbons (e.g. motor oil) that elute in the DRO range.

O = Reporting Limits were increased due to sample foaming.

V = Reporting Limits were increased due to high concentrations of target analytes.

X = Reporting Limits were increased due to sample matrix interferences.

Z = DRO concentration may include contributions from lighter-end (e.g. gasoline) and heavier-end (e.g. motor oil) hydrocarbons that elute in the DRO range.

S50 = The analysis of the sample required a dilution such that the surrogate concentration was diluted below the laboratory acceptance criteria. The laboratory control sample was acceptable.

S51 = Surrogate recovery could not be determined due to the presence of co-eluting hydrocarbons.

S52 = Surrogate recovery was above laboratory acceptance limits. Probable matrix effect.

S53 = Surrogate recovery was below laboratory acceptance limits. Probable matrix effect.

S54 = Surrogate recovery was below laboratory acceptance limits.

S55 = Surrogate recovery was above laboratory acceptance limits.

Report CC's Dan Twichell
Robert Piekarz

WORKORDER SUMMARY

NV

WorkOrder: NDO2101114
Report Due By: 05-Feb-21
EDD Required: NO

Alpha Analytical, Inc.

255 Glendale Ave, #21 Sparks, Nevada 89431
TEL: (775) 355-1044 FAX: (775) 355-0406

Report Attention: Robert Piekarz


Client:
Nevada DOT Environmental (NDOT)
1263 S. Stewart St.
Carson City, NV 89712

TEL: 7758887692
FAX: 7758887104
ProjectNo: Bridges D1

Date Received: 22-Jan-21

Alpha Sample ID	Client Sample ID	Matrix	Collection Date	No. of Bottles			Requested Tests						Sample Remarks	
				Alpha	Sub	TAT	METALS_T_60 20							
NDO2101114-01	Abt Paint-1412	OTHER	1/20/2021 2:00:00 PM	1	0	10	A - TCLP_8							
NDO2101114-02	Texture-412	OTHER	1/20/2021 2:10:00 PM	1	0	10	A - TCLP_8							
NDO2101114-03	I-Beam Paint-1443	OTHER	1/20/2021 3:30:00 PM	1	0	10	A - TCLP_8							
NDO2101114-04	Bridge Paint-1443	OTHER	1/20/2021 3:45:00 PM	1	0	10	A - TCLP_8							
NDO2101114-05	Column Paint-1443	OTHER	1/20/2021 4:00:00 PM	1	0	10	A - TCLP_8							
NDO2101114-06	973 Paint	OTHER	1/21/2021 9:00:00 AM	1	0	10	A - TCLP_8							
NDO2101114-07	1109 Paint	OTHER	1/21/2021 10:30:00 AM	1	0	10	A - TCLP_8							

Comments: Paint chips

Signature	Print Name	Company	Date/Time
	Daija Nordyke	Alpha Analytical, Inc.	1.22.21 11:35

NOTE: Samples are discarded 60 days after sample receipt unless other arrangements are made. Hazardous samples will be returned to client or disposed of at client expense.

Appendix E
Inspector Certifications
and
Licenses

mm


STATE OF NEVADA
DEPARTMENT OF BUSINESS AND INDUSTRY
DIVISION OF INDUSTRIAL RELATIONS
Occupational Safety and Health Administration
Asbestos Control Program

Certifies That Robert Piekarz
State of Nevada-DOT
is Licensed As Asbestos Abatement Consultant

License No. IJ-1049

Expiration Date 11/24/2021

Signature Of Licensee _____

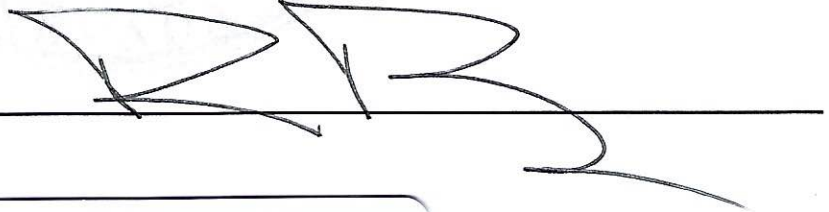

STATE OF NEVADA
DEPARTMENT OF BUSINESS AND INDUSTRY
DIVISION OF INDUSTRIAL RELATIONS
Occupational Safety and Health Administration
Asbestos Control Program

mm

Certifies That Robert Piekarz
State of Nevada-DOT
is Licensed As Asbestos Abatement Consultant

License No. IJ-1049 Expiration Date 11/24/2021

Signature Of Licensee _____

M & C Environmental Training

Asbestos Inspector
Refresher Training Course

Robert Piekarz

Has successfully completed the Asbestos Inspector Refresher course approved by the California Division of Occupational Safety and Health for purposes of certification required by Title 8, Article 2.7, Chapter 3.2, Section 341.16 and the accreditation required under the Toxic Substances Control Act, Title II. Conducted by M&C Environmental Training Inc., P.O. Box 6419, Concord, California Tel. # (510 499-5646

Course Approval Number: CA-003-06

Location: Concord, California

Expiration: November 24, 2021

Dates: November 24, 2020

Director of Training: John McGinnis



Certificate Number 48309 IR

M & C Environmental Training

Asbestos Management Planner Refresher Training Course

Robert Piekarz

Has successfully completed the Asbestos Management Planner Refresher course approved by the California Division of Occupational Safety and Health for purposes of certification required by Title 8, Article 2.7, Chapter 3.2, Section 341.16 and the accreditation required under the Toxic Substances Control Act, Title II. Conducted by M&C Environmental Training Inc., P.O. Box 6419, Concord, California. Tel. # (510) 499 - 5646

Course Approval Number: CA-003-08

Location: Concord, California

Dates: November 24, 2020

Director of Training: John McGinnis



Expiration: November 24, 2021

Certificate Number **48327 PR**