

STATE OF NEVADA
STANDARD PLANS

FOR

ROAD AND BRIDGE
CONSTRUCTION

1976



DEPARTMENT OF HIGHWAYS
CARSON CITY, NEVADA 89712

STANDARD PLANS

FOR

ROAD AND BRIDGE CONSTRUCTION



MIKE O'CALLAGHAN, GOVERNOR, CHAIRMAN

ROBERT LIST, ATTORNEY GENERAL

WILSON MCGOWAN, STATE CONTROLLER

GRANT BASTIAN
STATE HIGHWAY ENGINEER

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS
1263 SOUTH STEWART STREET
CARSON CITY, NEVADA 89712

February 1976

INTRODUCTION

The standards contained in this publication have been formally approved for State highway construction and to be instigated for use on all future roadway construction projects.

The user of this publication is cautioned to consult other contractual documents (special provisions, plans, Standard Specifications, etc.) for additional details which may be pertinent to the application of specific standard plans to any given project.

Additional copies of this standard book and full size sheets may be obtained from the Headquarters Building, State of Nevada, Department of Highways, 1263 South Stewart Street, Carson City, Nevada 89712 at the following costs:

Book of Standards-----	\$3.00
Full Size Standards (22" X 36")-----	0.50 each

TABLE OF CONTENTS
ROADWAY SECTION

SHEET NO.		PAGE
R-S1.1 (000)	Superelevation, 2 Lane	R1
R-S1.2 (000)	Superelevation, 4 Lane, Undivided	R2
R-S1.3 (000)	Superelevation, 4 Lane, Divided	R3
R-S2.1 (000)	Type 1, 2, and 3 Approach Roads	R4
R-S2.2 (000)	Type 4 and 5 Approach Roads-Urban Driveway Details	R4A
R-S3.1 (000)	Exit and Entrance Gore Islands	R5
R-1.1.1 (206, 207)	Structure Excavation and Backfill Method of Measurement	R6
R-1.1.2 (206, 207)	Structure Excavation and Backfill Method of Measurement	R7
R-1.1.3 (206, 207)	Structure Excavation and Backfill Method of Measurement	R8
R-1.1.4 (206,207)	Structure Excavation and Backfill Method of Measurement	R9
R-1.1.5 (206, 207)	Structure Excavation and Backfill Method of Measurement	R9A
R1.1.6 (206, 207)	Structure Excavation and Backfill Method of Measurement	R10
R-1.2.1 (203)	Drainage Ditches and Dikes	R11
R-1.3.1 (601, 606)	Allowable Fill Heights for Culverts	R12
R-2.1.1 (601, 606)	Culvert Installation	R13
R-2.1.2 (604)	Culvert Installation Anchor Block for Culverts 48" to 84"	R14
R-2.1.3 (604)	Slotted CMP Drain Details	R15
R-2.1.4 (601, 606)	Culvert Installation	R16
R-2.2.1 (604)	Metal End Sections 12" CMP to 84" CMP 17" x 13" CMAP to 83" x 57" CMAP	R17
R-2.3.1 (603)	End Sections, 12" RCP to 54" RCP	R18
R-2.4.1 (502)	Culvert Headwalls, 12" CMP to 42" CMP	R19
R-2.4.2 (502)	Culvert Headwalls, 48" CMP to 72" CMP	R20
R-2.4.3 (213)	Conduit Installation for Future Water Lines	R21
R-2.5.1 (502)	Culvert Headwalls, 12" RCP to 36" RCP	R22
R-2.5.2 (502)	Culvert Headwalls, 42" RCP to 72" RCP	R23

TABLE OF CONTENTS
ROADWAY SECTION

SHEET NO.		PAGE
R-2.6.1 (502)	Culvert Headwalls 17" x 13" CMAP to 83" x 57" CMAP	R24
R-2.7.1 (502)	Culvert Headwalls 23" x 14" Oval RCP to 60" x 38" Oval RCP	R25
R-2.7.2 (502)	Culvert Headwalls 68" x 43" Oval RCP to 91" x 58" Oval RCP	R26
R-2.8.1 (604)	Coupling Band Details, CMP & Pipe Arches	R27
R-2.8.2 (604)	C.S.P. Coupling Band Details	R27A
R-3.1.1 (608)	Embankment Protectors, Type 1 2, and 3	R28
R-3.1.2 (608)	Embankment Protectors, Type 4	R29
R-4.1.1 (609)	Pipe Riser Inlet, Type 1 and 2	R30
R-4.1.2 (609)	Pipe Riser Inlet, Type 3	R31
R-4.2.1 (609)	Type 1 and 2 Drop Inlets	R32
R-4.2.2 (609)	Type 2A Drop Inlet	R33
R-4.3.1 (609)	Type 3 Drop Inlet	R34
R-4.4.1 (609)	Type 3A Drop Inlet	R35
R-4.5.1 (609)	Type 4,5 & 6 Drop Inlet	R36
R-4.6.1 (609)	Type 7 and 8 Drop Inlets	R37
R-4.7.1 (609)	Type 1, 2, 3 and 4 Manholes	R38
R-4.8.1 (609)	Type 9 and 10 Drop Inlets	R39
R-5.1.1 (613)	Curb and Gutter and Driveway	R40
R-6.1.1 (616)	Fence Details	R41
R-6.1.2 (616)	Fence Details	R42
R-6.1.3 (616)	Fence Details	R43
R-6.2.1 (630)	Bench Fence and Cattle Pass Fencing	R44
R-7.1.1 (617)	Steel Cattle Guard 12' to 20' Roadbed	R45
R-7.1.2 (617)	Steel Cattle Guard 26' to 40' Roadbed	R46
R-7.1.3 (617)	Steel Cattle Guard, Type B	R47
R-7.1.4 (617)	Steel Cattle Guard, Type C	R48
R-8.1.1 (618)	Guardrail and Cable End Anchors	R49
R-8.1.2 (618)	Guardrail Installation	R50
R-8.1.3 (618)	Guardrail Installation	R51

TABLE OF CONTENTS
ROADWAY SECTION

SHEET NO.		PAGE
R-8.1.4 (618)	Guardrail Expansion Joint Details	R52
R-8.1.5 (618)	Methods of Attaching Guardrail to Existing Structures	R53
R-8.1.6 (618)	Breakaway Cable Terminal	R54
R-8.2.1 (618)	Metal Beam Barrier Rail	R55
R-8.3.1 (502)	Concrete Barrier Rail	R56
R-8.3.2 (502)	Barrier Rail Connection	R56A
R-8.3.3 (502)	Portable Precast Concrete Barrier Rail	R56B
R-8.4.1 (632)	Headlight Glare Screen (Type B)	R57
R-8.4.2 (632)	Headlight Glare Screen (Type A)	R58
R-8.4.3 (632)	Headlight Glare Screen (Type C)	R58A
R-8.4.4 (632)	Headlight Glare Screen (Type D)	R58B
R-9.1.1 (619)	Guide Posts	R59
R-9.2.1 (619), (621)	Object Markers, Right of Way Markers, Survey Monuments, and Reference Monuments	R60
R-10.1.1(409)	Concrete Pavement	R61

TABLE OF CONTENTS

BRIDGE INDEX


SHEET NO.		PAGE
B-20.1.1 (502)	RCB Culverts, General Notes	B1
B-20.1.2 (502)	Single RCB Culverts, 5' and 6' Spans	B2
B-20.1.3 (502)	Single RCB Culverts, 7' to 12' Spans	B3
B-20.1.4 (502)	Double RCB Culverts	B4
B-20.1.5 (502)	Triple RCB Culverts	B5
B-20.1.6 (502)	RCB Culverts, Type II Headwalls	B6
B-20.1.7 (502)	RCB Culverts, Type I Headwalls	B7
B-20.1.8 (502)	Estimate of Quantities, Type I Headwalls	B8
B-20.1.9 (502)	Method of Extending RCB Culvert	B9
B-21.1.1 (612)	Design Data for Metal Retaining Wall	B10
B-21.1.2 (612)	Construction Details for Metal Retaining Wall	B11
B-22.1.1 (502)	Approach Slab Details	B12
B-23.1.1 (508)	Precast Prestressed Concrete Pile Details	B13
B-23.1.2 (508)	Cast-In-Drilled Hole Concrete Pile Details	B14
B-23.1.3 (508)	Concrete Pile Details	B15
B-24.1.1 (502)	Steel Reinforced Elastomeric Expansion Joint Seal (4" and 2" Movement)	B16
B-24.1.2 (502)	Steel Reinforced Elastomeric Expansion Joint Seal (4" and 2½" Movement)	B17
B-25.1.1 (506)	Bridge Rail, Type "AC"	B18
B-25.1.2 (506)	Bridge Rail, Type "H"	B19
B-25.1.3 (506)	Aluminum Bridge Rail, Type "H"	B20
B-25.1.4 (506)	Pedestrian Rail, Type "M"	B21
B-25.1.5 (506)	Pedestrian Rail, Type "R"	B22
B-26.1.1 (611)	Concrete Slope Paving Details	B23

TABLE OF CONTENTS
TRAFFIC INDEX

SHEET NO.		PAGE
T-30.1.1 (623)	Lighting and Signals	T1
T-30.1.2 (623)	Lighting and Signals	T2
T-30.1.3 (623)	Lighting and Signals	T3
T-30.1.4 (623)	Safety Base for Light Poles	T4
T-30.1.5 (623)	Lighting and Signals	T5
T-30.1.6 (623)	Lighting and Signals	T6
T-30.1.7 (623)	Lighting and Signals	T7
T-30.1.8 (623)	Lighting and Signals	T8
T-30.1.9 (623)	Lighting Fixtures Overhead Fluorescent	T9
T-31.1.1 (626)	Ground Mounted Sign Supports (Round Metal Posts)	T10
T-31.1.2 (626)	Ground Mounted Sign Supports (Round Metal Posts)	T11
T-31.1.3 (626)	Ground Mounted Sign Supports (Round Metal Posts)	T12
T-31.1.4 (626)	Ground Mounted Sign Supports (Round Metal Posts)	T13
T-31.1.5 (626)	Ground Mounted Sign Supports (Round Metal Posts)	T14
T-31.1.6 (625)	Ground Mounted Sign Supports (Timber Posts)	T15
T-31.1.7 (625)	Ground Mounted Sign Supports (Square Metal Posts)	T15A
T-35.1.1 (625) (626)	Typical Crossover Signing	T16
T-35.1.2 (625) (626)	Typical Lane Closure Signing	T17
T-35.1.3 (625) (626)	Typical 2 Lane 4 Lane Connection Signing (Rural)	T18
T-35.1.4 (625) (626)	Typical Road Construction Signing	T19
T-35.1.5 (625) (626)	Barricades	T20
T-35.1.6 (626)	Temporary Barricades (Special)	T20A
T-36.1.1 (627)	Overhead Sign Details, Instructions and Examples	T21
T-36.1.2 (627)	Overhead Signs, Single Post Type II thru VIII	T22
T-36.1.3 (627)	Overhead Signs, Type 1-S thru VII-S	T23
T-36.1.4 (627)	Overhead Signs, Single Post Type Structural Frame Members	T24

SHEET NO.		PAGE
T-36.1.5 (627)	Overhead Signs, Two Post Type, Structural Frame Members	T25
T-36.1.6 (627)	Overhead Signs, Structural Frame Details	T26
T-36.1.7 (627)	Overhead Signs, Frame Juncture Details	T27
T-36.1.8 (627)	Overhead Signs, Removable Sign Panel Frames	T28
T-36.1.9 (627)	Overhead Signs, Walkway Details, No. 1	T29
T-36.1.10 (627)	Overhead Signs, Walkway Details, No. 2	T30
T-36.1.11 (627)	Overhead Signs, Walkway Safety Railing Details	T31
T-36.1.12 (627)	Overhead Signs, Alternative Pile Foundation	T32

LIMITING SPEED ON HORIZONTAL CURVES

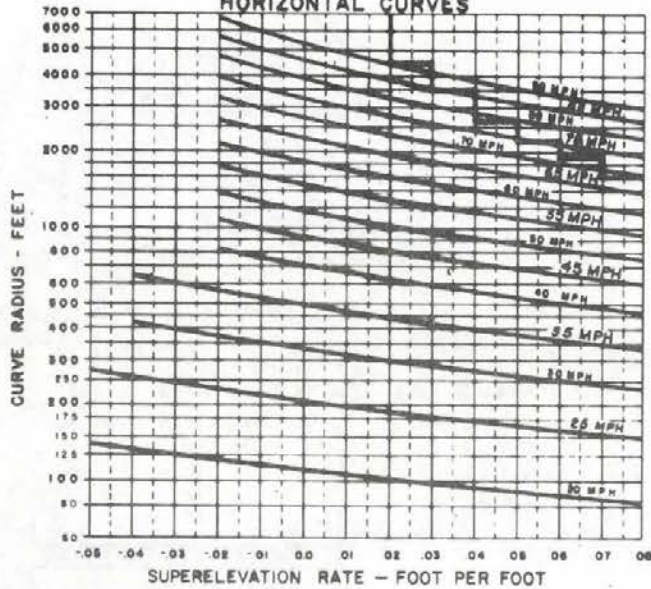

SPEED	FRICTION FACTOR
30	0.16
40	0.15
50	0.14
60	0.13
70	0.12
80	0.11
90	0.10 (EXTRAPOLATED)

NOTE
Broken line indicates standard superelevation rate. Higher value at steps is the proper superelevation for indicated curve radius.



E= SUPERELEVATION
F= FRICTION FACTOR
V= SPEED IN MILES PER HOUR
R= RADIUS IN FEET

$$E+F = \frac{0.067V^2}{R}$$

MINIMUM RADIUS CURVES (SIGHT DISTANCE NEGLECTED)

DESIGN SPEED (mph)	MINIMUM RADIUS USING MAXIMUM SUPER. (.08) (feet)	MINIMUM RADIUS USING NORMAL CROWN (-2%) (feet)
30	250	430
40	464	820
50	758	1390
60	1143	2180
70	1633	3270
80	2245	4740

* Normal crown may be used on city streets where speed is controlled.

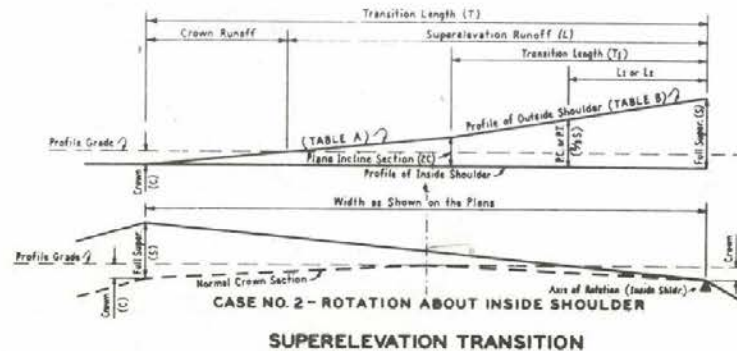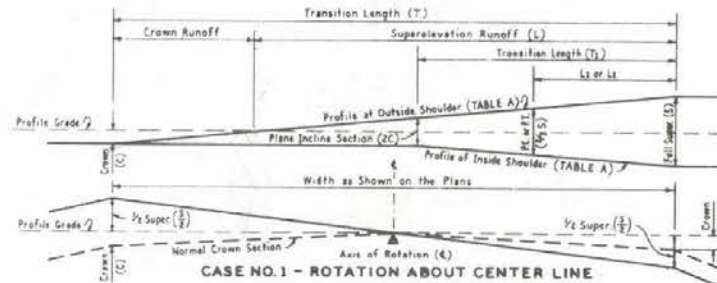

GENERAL NOTES

- All curves shall be superelevated as shown unless otherwise noted on plans.
- Axis of rotation shall be the center line of the road on grades of one percent or greater and shall be the inside shoulder on grades flatter than one percent.
- Superelevation may cause drainage pockets where easement occurs. Drainage shall be checked and pockets eliminated by constructing roadway ditches to grade, changing the axis of rotation, or, in extreme cases, by installing pipe culverts.
- Short vertical curves shall be inserted by age adjustment of grades at beginning and end of easement.
- When the tangent between curves is too short to permit easement lengths shown, the transition may be extended onto the curve or the easement length may be decreased.

Note:
deter-
MINES
Case #

FORMULAE

Rate of Easement ft per ft	TABLE B ft per ft	Length in Feet
.004	.008	$T = 250 \left(\frac{L}{.004} + C \right)$
.004	.008	$L = 250 \left(\frac{L}{.004} - C \right)$
.004	.008	$L = 125 S$
.004	.008	$L = \frac{.008 T^2}{.004}$
.004	—	$L = T - 250 \left(\frac{L}{.004} \right)$

Where:
S = Full Superelevation (ft)
C = Crown (ft)
T = Total Length of Transition
T₁ = Transition Length - Plane Incline Section to Full Super
L = Total Length of Superelevation Runoff
L₁ = Length from P.C. or P.T. to Full Superelevation where Super Rate is .00 ft per ft or greater.
L₂ = Length from P.C. or P.T. to Full Superelevation where Super Rate is less than .00 ft per ft.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

SUPERELEVATION 2-LANE

Robert L. Blaylock
CHIEF ROAD DESIGN ENGINEER

R-S11-(000)
ADOPTED: 2/74 REVISION

LIMITING SPEED ON HORIZONTAL CURVES

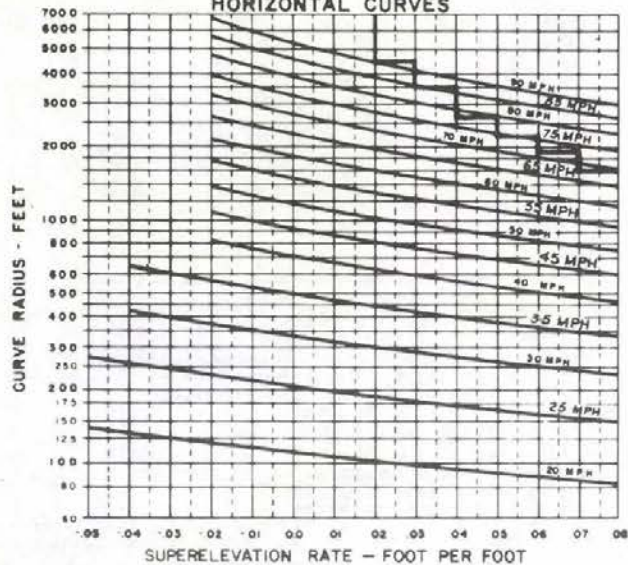

SPEED	FRICTION FACTOR
30	0.16
40	0.15
50	0.14
60	0.13
70	0.12
80	0.11
90	0.10 (EXTRAPOLATED)

NOTE
Broken line indicates standard superelevation rate. Higher value at steps is the proper superelevation for indicated curve radius.


E=SUPERELEVATION
F=FRICTION FACTOR
V=SPEED IN MILES PER HOUR
R=RADIUS IN FEET

$$E+F = \frac{0.067V^2}{R}$$

MINIMUM RADIUS CURVES (SIGHT DISTANCE NEGLECTED)

SPEED (mph)	MINIMUM RADIUS USING MAXIMUM SUPER (.08) (feet)	MINIMUM RADIUS USING NORMAL CROWN (-2%) (feet)
30	290	430
40	464	620
50	758	1090
60	1143	1680
70	1633	2370
80	2245	3240

* Normal crown may be used on city streets where speed is controlled.

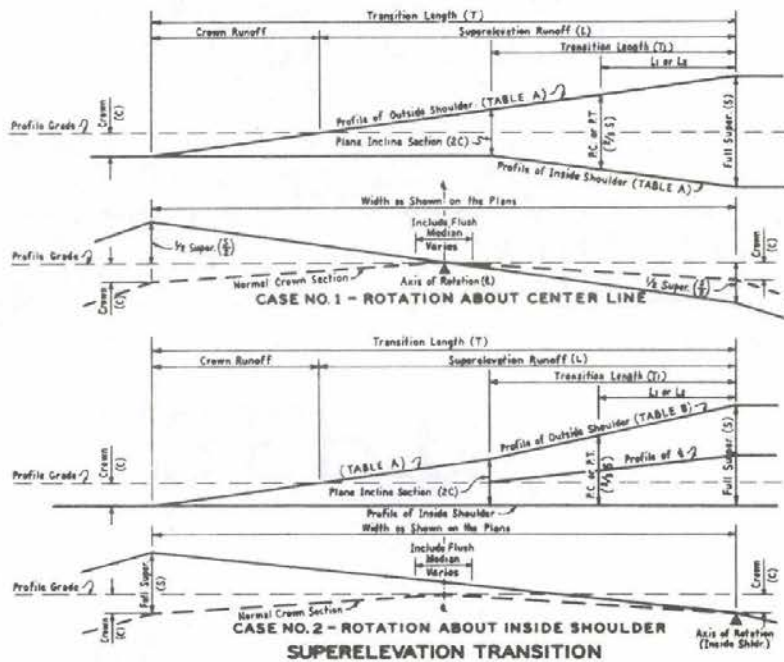

GENERAL NOTES

- All curves shall be superelevated as shown unless otherwise noted on plans.
- The axis of rotation shall be the center line of the roadbed on grades of one percent or greater and shall be the inside shoulder on grades flatter than one percent.
- Superelevation may cause drainage pockets where easement occurs. Drainage shall be checked and pockets eliminated by constructing roadway ditches to grade, changing the axis of rotation, or, in extreme cases, by installing pipe culverts.
- Short vertical curves shall be inserted by eye adjustment of stakes at beginning and end of easement.
- When the tangent between curves is too short to permit easement lengths shown, the transition may be extended onto the curve or the easement length may be decreased.

FORMULAE

Rate of Easement TABLE A FL per FL	Rate of Easement TABLE B FL per FL	Length in Feet
.005	.01	$T = 200 \left(\frac{S}{F} + C \right)$
.005	.01	$T = 200 \left(\frac{S}{F} - C \right)$
.005	.01	$L = 100 S$
.005	.01	$L = \frac{V^2}{.68}$
.005	—	$L = T - 200 \left(\frac{S}{F} \right)$


Where:
S=Fall Superelevation (FL)
C=Crown (Ft)
T=Total Length of Transition
T₁=Total Length of Transition - Plane Incline Section in Fall Super.
L=Total Length of Superelevation Runoff
L₁=Length from P.C. or P.T. to Full Superelevation where Super Rate is .08 FL or greater
L₂=Length from P.C. or P.T. to Full Superelevation where Super Rate is less than .08 FL per FL

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

SUPERELEVATION 4-LANE, UNDIVIDED

R-51.2- (000)
ADDPED: 2/74 REVISION 1

LIMITING SPEED ON HORIZONTAL CURVES

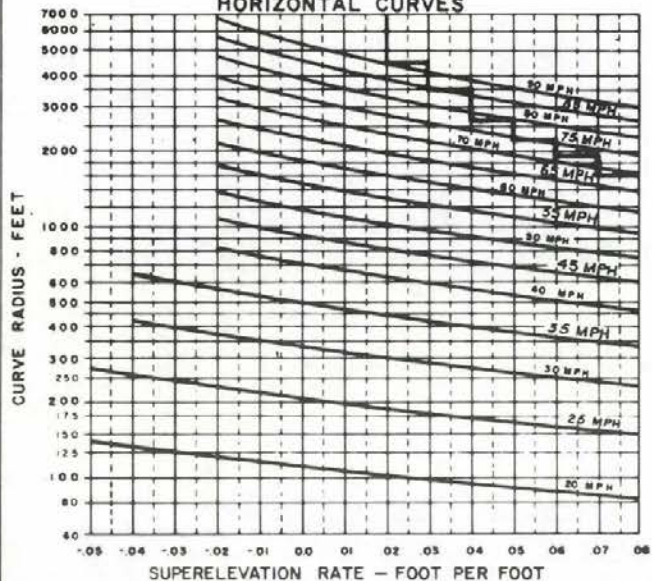

R3

SPEED	FRICTION FACTOR
30	0.16
40	0.15
50	0.14
60	0.13
70	0.12
80	0.11
90	0.10 (EXTRAPOLATED)

NOTE

Broken line indicates standard superlevation rate. Higher value at steps is the proper superlevation for indicated curve radius.

E= SUPERELEVATION
 F= FRICTION FACTOR
 V= SPEED IN MILES PER HOUR
 R= RADIUS IN FEET

$$E + F = \frac{0.067V^2}{R}$$

MINIMUM RADIUS CURVES
 (SIGHT DISTANCE NEGLECTED)

DESIGN SPEED (mph)	MINIMUM RADIUS USING MAXIMUM SUPER. (.08) (feet)	MINIMUM RADIUS USING NORMAL CROWN (-2%) (feet)
30	250	430
40	464	820
50	758	1390
60	1143	2130
70	1635	3270
80	2245	4740

* Normal crown may be used on city streets where speed is controlled.

FORMULAE


OUTSIDE LANE		INSIDE LANE	
Rate of Easement	Length in Feet	Rate of Easement	Length in Feet
.005	$T = 200(S + C_1)$.005	$T_1 = 200(S - C_2)$
.005	$L = 200S$.005	$L_1 = \frac{S - C_2}{.015}$
.005	$L_1 = \frac{S}{.015}$		

Where:

S = Full Superlevation (Ft.)
 C₁ & C₂ = Crown (Ft.)
 T = Total Length of Transition
 T₁ = Total Length of Transition and Superlevation Runoff
 L = Total Length of Superlevation Runoff
 L₁ = Length from P.C. or P.T. to Full Superlevation

GENERAL NOTES

- All curves shall be superelevated as shown unless otherwise noted on plans.
- Superelevation may cause drainage pockets where easement occurs. Drainage shall be checked and pockets eliminated by constructing roadway ditches to grade, changing the axis of rotation, or, in extreme cases, by installing pipe culverts.
- Short vertical curves shall be inserted by eye adjustment of stakes at beginning and end of easement.
- When the tangent between curves is too short to permit easement lengths shown, the transition may be extended onto the curve or the easement length may be decreased.

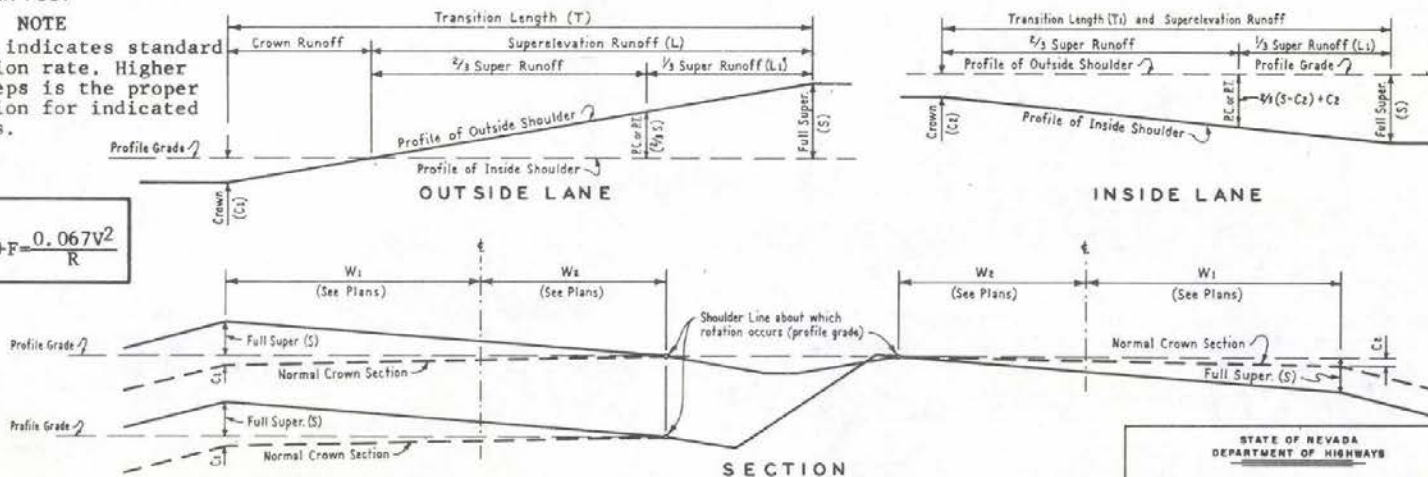


SECTION SUPERELEVATION TRANSITION

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

SUPERELEVATION 4-LANE, DIVIDED

Robert T. Blum
 CHIEF ROAD DESIGN ENGINEER

R-S1.3-(000)
 ADOPTED: 2/74 REVISION

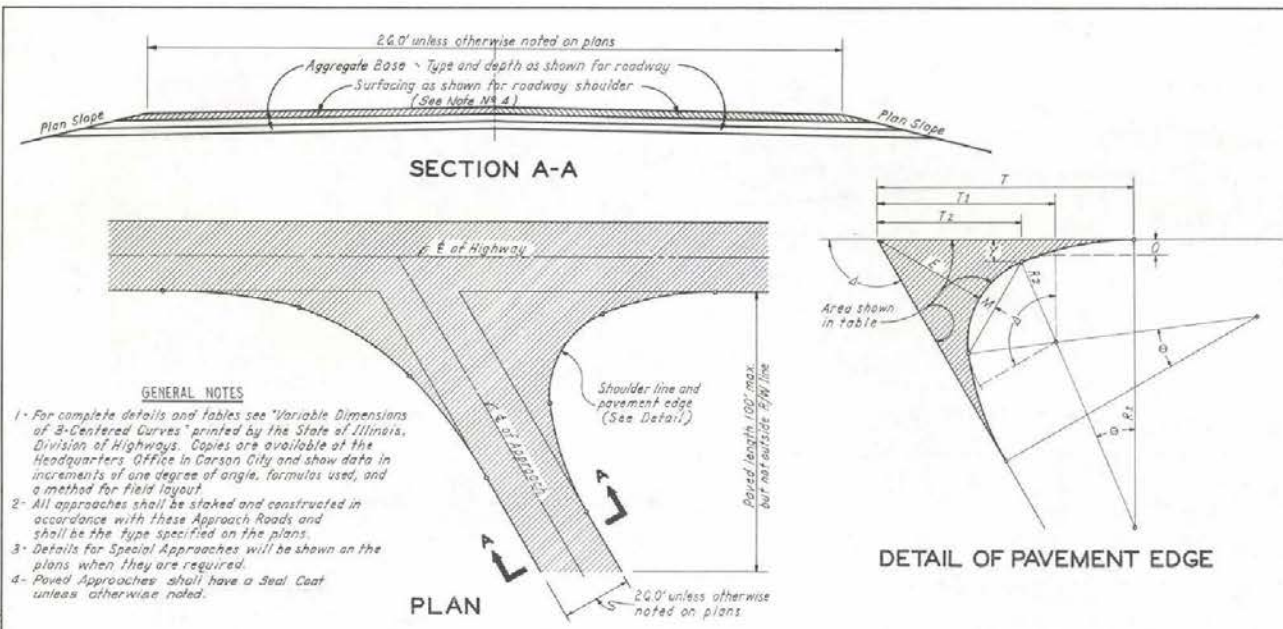

- GENERAL NOTES**
- 1- For complete details and tables see "Variable Dimensions of 3-Centered Curves" printed by the State of Illinois, Division of Highways. Copies are available at the Headquarters Office in Carson City and show data in increments of one degree of angle, formulas used, and a method for field layout.
 - 2- All approaches shall be staked and constructed in accordance with these Approach Roads and shall be the type specified in the plans.
 - 3- Details for Special Approaches will be shown on the plans when they are required.
 - 4- Paved Approaches shall have a Seal Coat unless otherwise noted.

DIMENSIONS FOR 3-CENTERED CURVES

TYPE 1-P APPROACH (PASSENGER)

ANGLE DEGREE	G	R ₁	R ₂	O	V	T ₁	T ₂	T	E	M	AREA #	AREA #
						IN	IN	FEET			SQ FT	SQ YD
40	1815.60	100	25	2.0	2.67	9.86	15.55	35.79	6.18	1.06	108.9	12.1
70	1191.60	100	25	2.0	2.67	13.17	18.31	36.17	7.85	1.78	148.3	16.0
80	1015.44	100	25	2.0	2.67	14.83	20.24	37.86	10.25	2.47	192.2	21.2
90	842.78	100	25	2.0	2.67	17.54	22.60	42.34	13.32	3.79	256.2	28.1
100	712.78	100	25	2.0	2.67	20.81	25.46	46.66	17.00	5.35	338.8	37.0
110	612.78	100	25	2.0	2.67	24.71	28.81	50.98	21.33	7.26	442.5	48.4
120	535.64	100	25	2.0	2.67	29.24	32.66	55.23	26.00	9.49	577.0	62.9

TYPE 1-SU APPROACH (SINGLE UNIT)

ANGLE DEGREE	G	R ₁	R ₂	O	V	T ₁	T ₂	T	E	M	AREA #	AREA #
						IN	IN	FEET			SQ FT	SQ YD
40	1911.80	120	45	2.0	3.20	15.88	27.14	44.34	9.27	1.61	224.0	24.9
70	1315.60	120	45	2.0	3.20	22.59	34.9	50.17	12.33	3.20	318.7	34.4
80	1118.44	120	45	2.0	3.20	25.12	38.24	55.64	16.33	4.81	448.8	48.3
90	950.18	120	45	2.0	3.20	28.11	42.00	59.28	20.40	6.74	573.0	57.7
100	795.80	120	45	2.0	3.20	31.62	46.23	62.81	24.62	8.99	724.5	77.3
110	665.80	120	45	2.0	3.20	35.67	50.92	66.34	29.00	11.56	901.4	96.2
120	555.80	120	45	2.0	3.20	40.24	56.06	70.00	33.53	14.44	1104.4	118.3

TYPE 1-C43 APPROACH (SEMITRAILER COMBINATION INTERMEDIATE)



ANGLE DEGREE	G	R ₁	R ₂	O	V	T ₁	T ₂	T	E	M	AREA #	AREA #
						IN	IN	FEET			SQ FT	SQ YD
40	1847.88	120	45	4.0	4.40	13.79	23.23	33.45	11.88	0.86	350.0	38.9
70	1347.88	120	45	4.0	4.40	19.8	30.3	38.48	14.85	1.78	468.0	50.1
80	1147.88	120	45	4.0	4.40	22.62	34.11	41.38	18.51	3.05	588.0	63.1
90	997.14	120	45	4.0	4.40	25.9	37.8	43.64	22.24	4.64	718.0	76.3
100	867.10	120	45	4.0	4.40	29.62	41.6	45.47	26.00	6.49	873.0	92.1
110	757.10	120	45	4.0	4.40	33.73	45.47	47.18	29.76	8.64	1042.0	111.2
120	667.10	120	45	4.0	4.40	38.23	49.34	48.83	33.51	11.00	1234.0	132.8

TYPE 1-C50 APPROACH (SEMITRAILER COMBINATION LARGE)

ANGLE DEGREE	G	R ₁	R ₂	O	V	T ₁	T ₂	T	E	M	AREA #	AREA #
						IN	IN	FEET			SQ FT	SQ YD
40	1918.40	200	75	3.5	3.50	27.70	45.37	74.70	15.64	3.05	639.1	71.0
70	1365.44	200	75	3.5	3.50	32.51	53.82	71.57	17.6	3.32	826.7	90.3
80	1165.44	200	75	3.5	3.50	35.73	58.27	74.38	20.45	4.19	982.0	106.4
90	1015.44	200	75	3.5	3.50	39.38	63.20	76.54	23.44	5.17	1111.4	120.3
100	885.44	200	75	3.5	3.50	43.47	68.47	78.11	26.54	6.26	1260.0	136.2
110	775.44	200	75	3.5	3.50	48.01	74.01	79.11	29.76	7.48	1431.0	154.3
120	685.44	200	75	3.5	3.50	52.94	79.84	79.63	33.00	8.79	1624.0	174.7

* Total approach area equals area shown in table for Δ plus area shown for 180° minus Δ plus pavement area for rectangular portion of approach.


TYPE 1 APPROACH

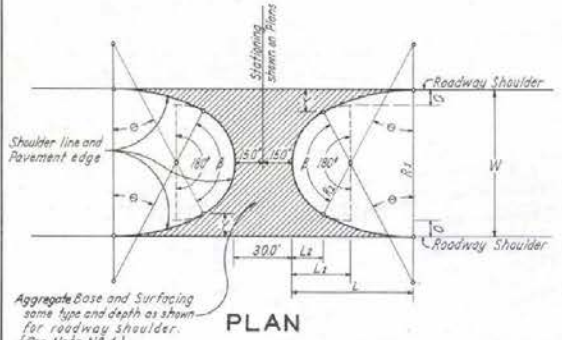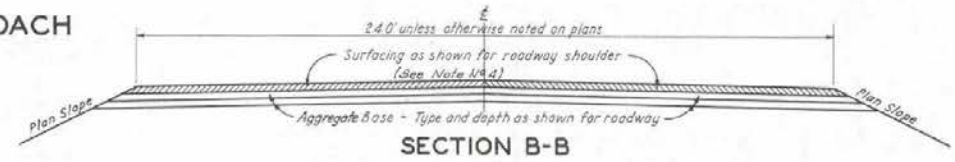

DIMENSIONS FOR 3 CENTERED CURVES FOR MEDIAN U-TURN


W	B	DEGREE	R ₁	R ₂	O	V	L ₁	L ₂	L	AREA #	AREA #
IN	FT	DEGREE					IN	IN	FEET	SQ FT	SQ YD
50.0	625.18	53.07	75	20	5.0	8.18	10.92	20.00	44.98	250.3	27.1
75.0	1244.07	73.38	100	30	8.0	11.43	14.07	30.00	628.0	418.1	45.1
100.0	1853.13	89.31	120	40	10.0	14.67	17.89	40.00	982.3	676.8	72.8

** Area shown is total area for Median U-Turn

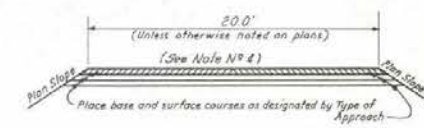


SECTION C-C

Type 2A - Aggregate base and surfacing courses same type and depth as adjacent roadway shoulder.
 Type 2B - Place aggregate base course only.
 Type 3 - Grade approach area only.

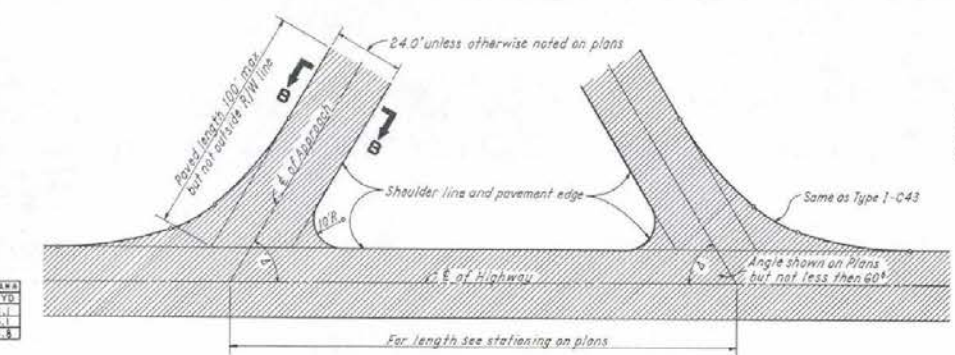

SERVICE TYPE APPROACH

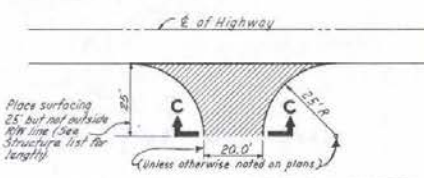


TYPE 2 & 3 APPROACHES

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS


**TYPES 1, 2 AND 3
 APPROACH ROADS**

REVISION 1
 ADOPTED: 8/69


R-52.1-(000)

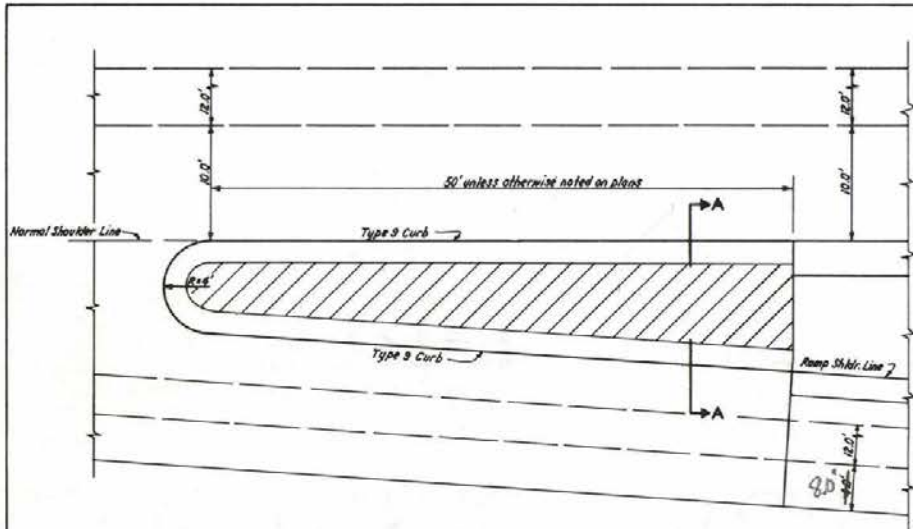


EXIT RAMP GORE ISLAND

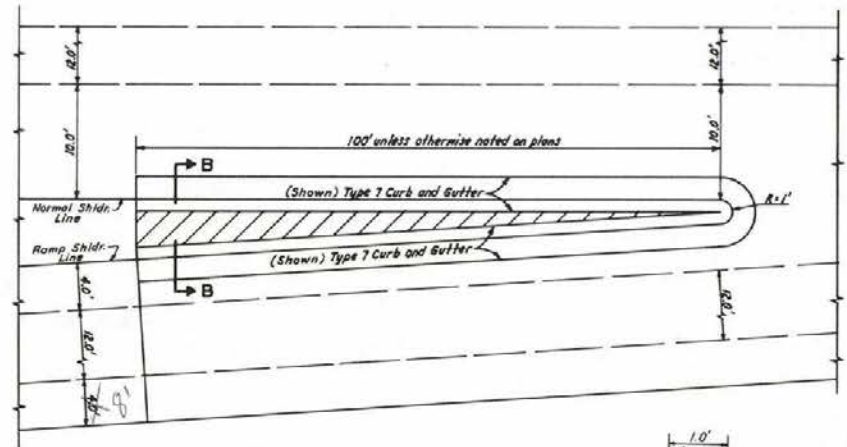

ENTRANCE RAMP GORE ISLAND

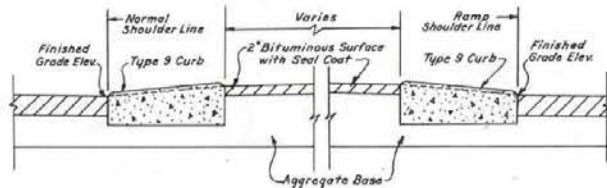


SECTION A-A

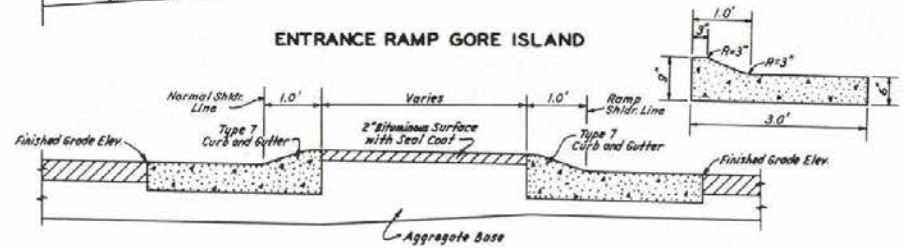

SECTION B-B



FOR INFORMATION ONLY	
TYPE	AMOUNT OF CONCRETE
7 C & G	0.0613 CU. YD. PER FT.
9 CURB	0.0470 CU. YD. PER FT.
10 CURB	0.0235 CU. YD. PER FT.

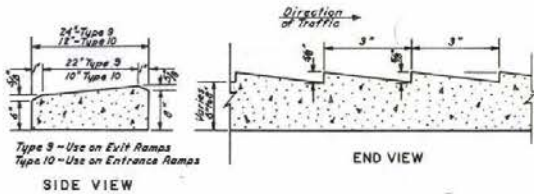

SIDE VIEW

END VIEW

TYPE 9 AND 10 CURB

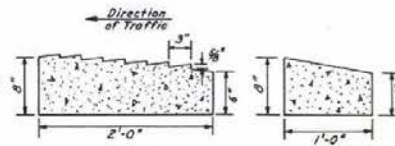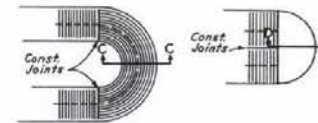

SECTION C-C
Type 9 Curb


SECTION D-D
Type 10 Curb

END DETAILS

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


EXIT AND ENTRANCE GORE ISLANDS

R-53.1-(000)
ADOPTED: 5/73

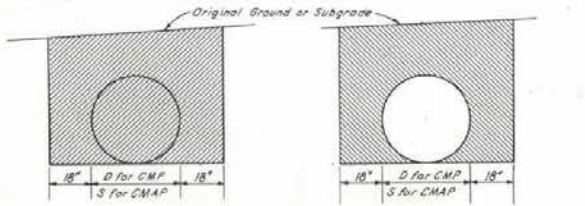


CULVERT IN EXCAVATION

Excavation Depth is less than 5 feet

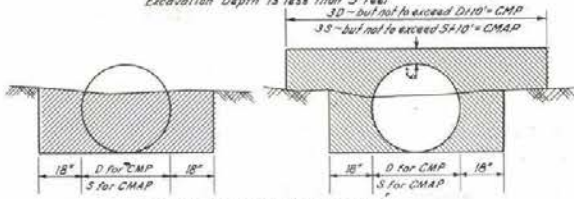


CULVERT IN EMBANKMENT

CMP OR CMAP CULVERTS

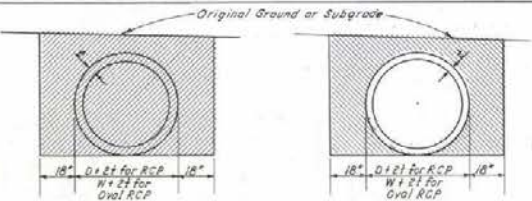


CONCRETE PIPE CULVERT IN EXCAVATION


All RCP and Oval RCP sizes
Excavation Depth is less than 5 feet

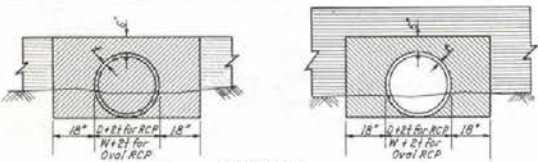

24" RCP or less
38" x 24" Oval RCP or less

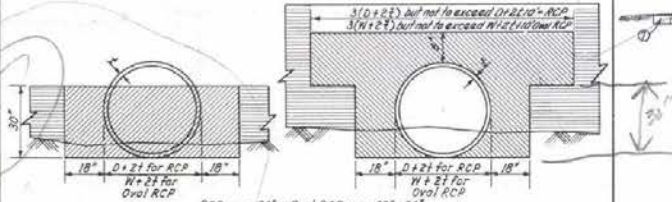


CONCRETE PIPE CULVERT IN EMBANKMENT (METHOD A)

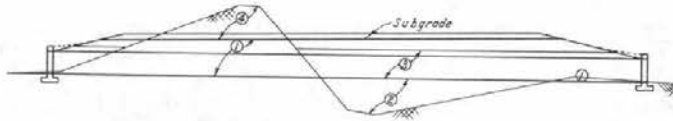


- ① Structure Excavation and Backfill in excavation to be paid below subgrade and within designated limits.
- ② Embankment to be constructed to flowline prior to installation.
- ③ Backfill in embankment to be paid from flowline to the designated maximum limits.
- ④ Roadway Excavation to be paid to subgrade.

CULVERT INSTALLATION IN ROUGH TERRAIN




- ⑤ CMP or RCP - When the pipe is laid in a trench in rock, hard clay, shale or other hard material, the unsuitable material shall be removed to a depth of not less than 12" below the bottom of the pipe grade and the trench backfilled with suitable material. In no place shall the pipe be laid directly on unsuitable material.
- ⑥ No additional excavation is necessary under headwalls when rock or other hard material is encountered.
- ⑦ When a firm foundation is not encountered, all soft, spongy or other unsuitable material under the culvert shall be removed, and the space filled with Foundation Fill. (Depth of Foundation Fill as indicated on the plans or ordered by the Engineer, but not less than 1'-6").


CULVERT INSTALLATION WITH UNSUITABLE FOUNDATIONS

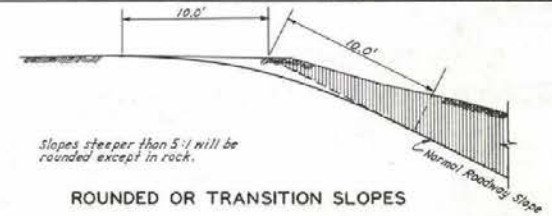


ROUNDED OR TRANSITION SLOPES



V-TYPE DITCH AND DIKE

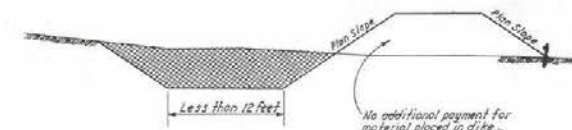

FLAT BOTTOM DITCH EXCAVATION

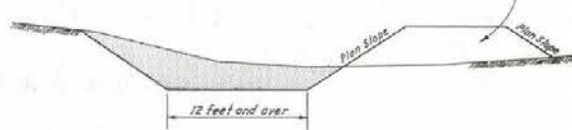

GENERAL NOTES

1. Excavation for multiple pipe, or RCB, installations exceeding 12 feet in width will be paid as Channel or Roadway Excavation.









LEGEND

- Structure Excavation
- Backfill
- Roadway Excavation
- Channel Excavation
- Drainage Excavation
- Roadway Embankment

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STRUCTURE EXCAVATION AND BACKFILL (METHOD OF MEASUREMENT)

R-1.11 - (206,207)
ADOPTED: 8/69 REVISION 3/79

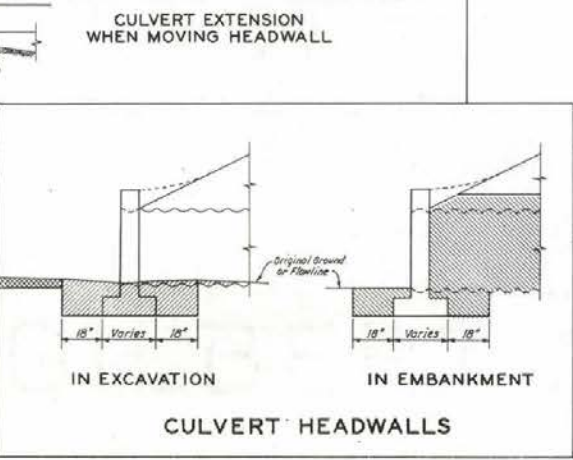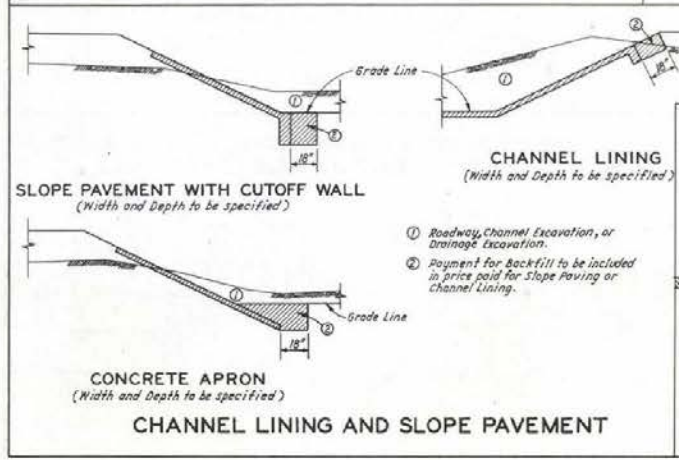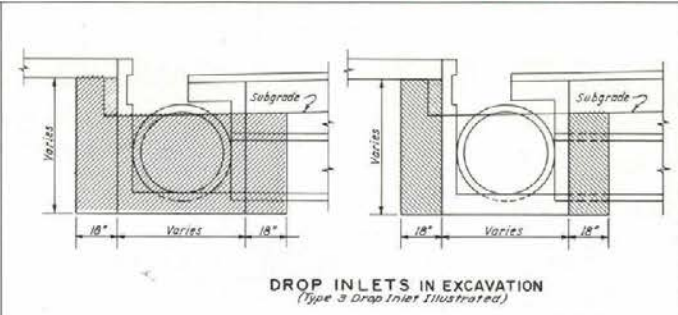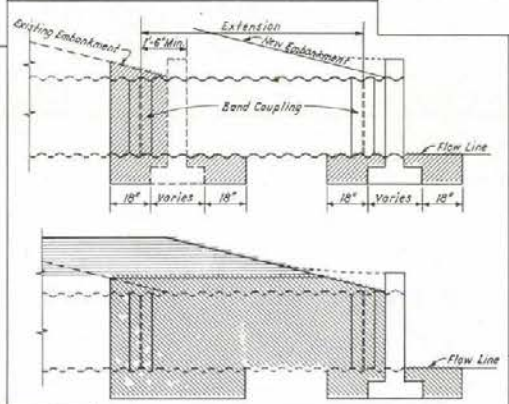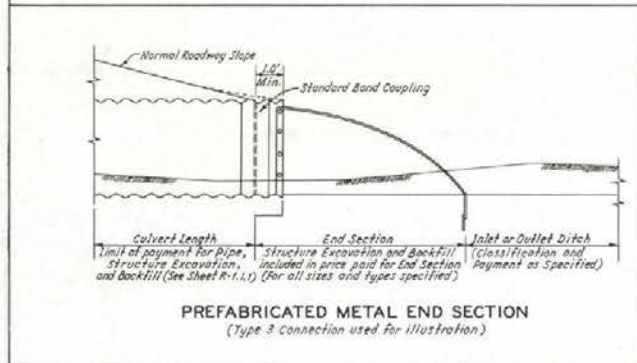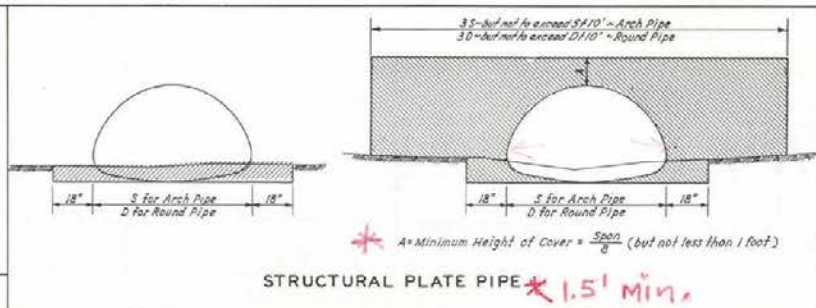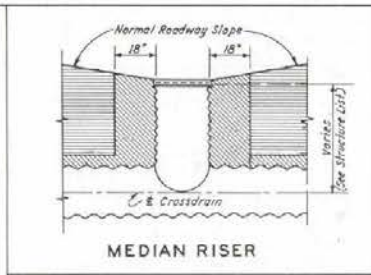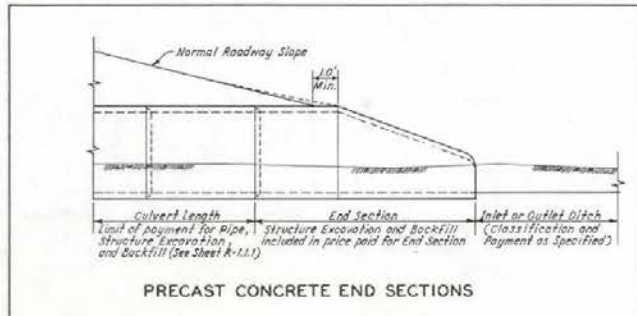

LEGEND

- Structure Excavation
- Backfill
- Roadway Excavation
- Channel Excavation
- Drainage Excavation
- Roadway Embankment


See R-1.1.1 for General Notes.

DROP INLETS IN EMBANKMENT
(Type 3 Drop Inlet Illustrated)


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STRUCTURE EXCAVATION AND BACKFILL (METHOD OF MEASUREMENT)


R-1.1.2 - (206, 207)
ADOPTED: 1/69 REVISION: 3/72

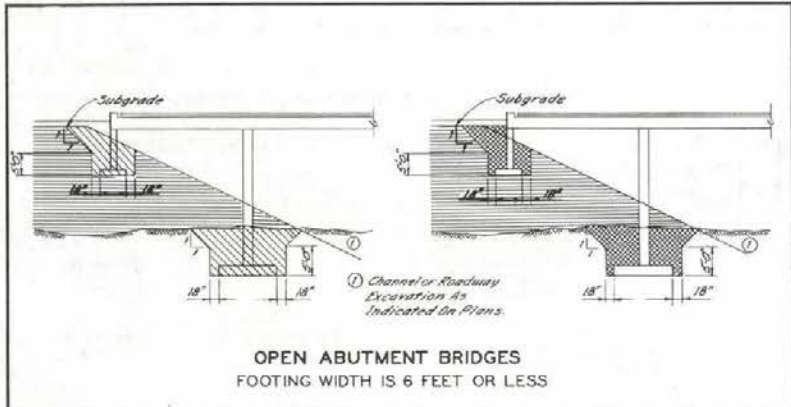


OPEN ABUTMENT BRIDGES
FOOTING WIDTH IS 6 FEET OR LESS

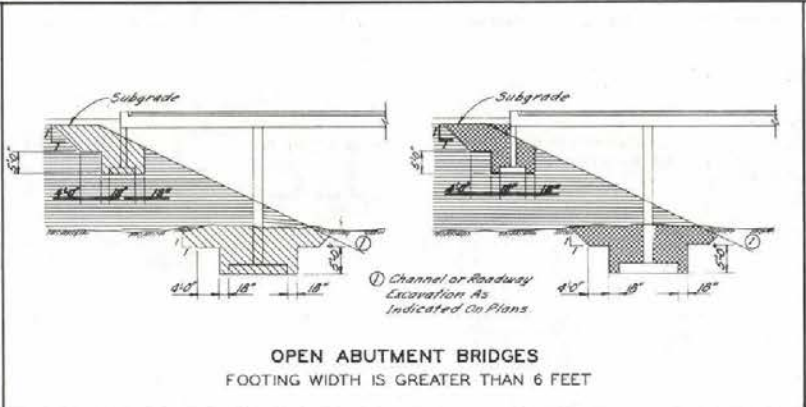


OPEN ABUTMENT BRIDGES
FOOTING WIDTH IS GREATER THAN 6 FEET

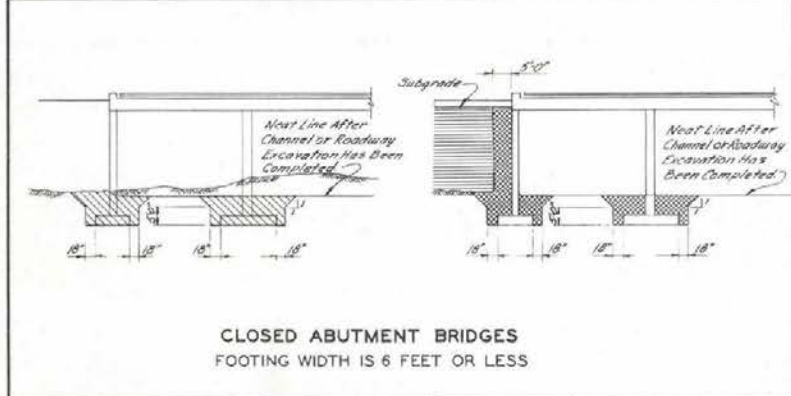

CLOSED ABUTMENT BRIDGES
FOOTING WIDTH IS 6 FEET OR LESS

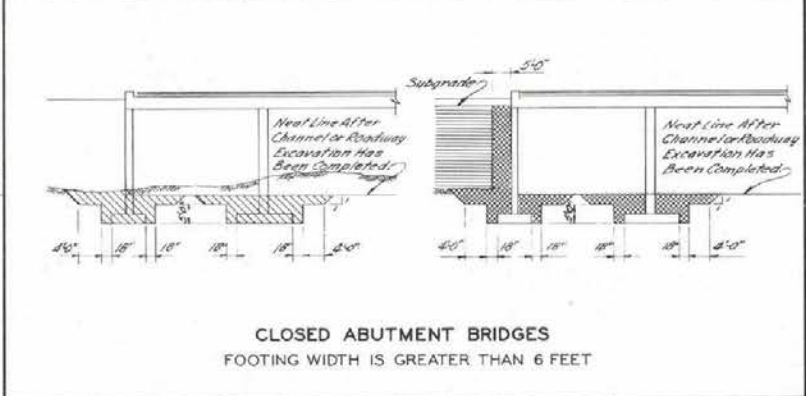


CLOSED ABUTMENT BRIDGES
FOOTING WIDTH IS GREATER THAN 6 FEET

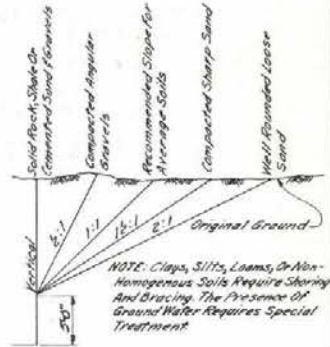


APPROXIMATE ANGLE OF REPOSE FOR SLOPING OF SIDES OF EXCAVATIONS

- GENERAL NOTES
- TRENCHES MORE THAN 5 FEET DEEP SHALL BE SHORED, LAID BACK TO AT LEAST THE ANGLE OF REPOSE FOR EXISTING FIELD CONDITIONS, OR SOME OTHER MEANS OF PROTECTION SHALL BE PROVIDED.
 - IF HAZARDOUS FIELD CONDITIONS INDICATE EROSION MOVEMENT MAY BE EXPECTED, TRENCHES LESS THAN 5 FEET DEEP SHALL ALSO BE PROTECTED AS INDICATED IN NOTE 1.
 - FOR THE PURPOSE OF PAYMENT, STRUCTURE EXCAVATION AND BACKFILL QUANTITIES ARE BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE.
 - IF SHORING IS USED, PAYMENT WILL BE MADE FOR STRUCTURE EXCAVATION AND BACKFILL BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE FOR SHORING.
 - REINFORCEMENT REQUIREMENTS FOR SHORING ARE AS SHOWN IN THE TABLE ON SHEET R-11.4.
 - THE QUANTITY OF STRUCTURE EXCAVATION AND BACKFILL MEASURED FOR PAYMENT SHALL BE THE NUMBER OF CUBIC YARDS CALCULATED MINUS ANY DUPLICATION OF LIMITS WHICH OVERLAP.

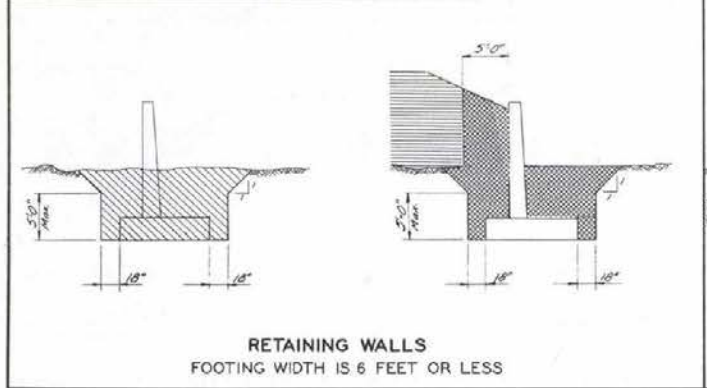

RETAINING WALLS
FOOTING WIDTH IS 6 FEET OR LESS

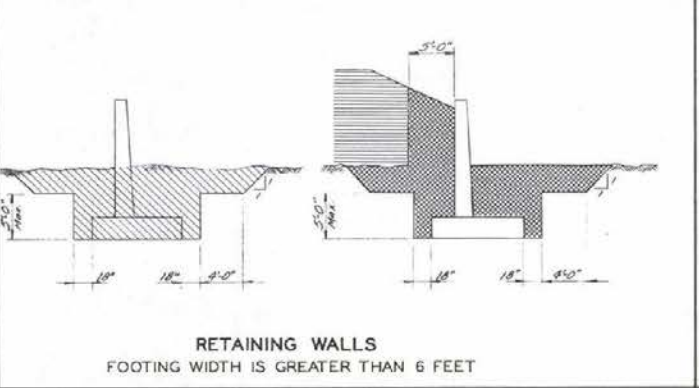

RETAINING WALLS
FOOTING WIDTH IS GREATER THAN 6 FEET

- Structure Excavation
- Backfill
- Roadway Embankment


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STRUCTURE EXCAVATION AND BACKFILL (METHOD OF MEASUREMENT)


R-11.3-(206.207)
ADOPTED 11/73 REVISION 11-1/75



CULVERT IN EXCAVATION

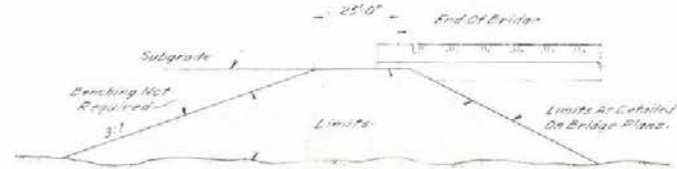

LIMITS OF SELECTED BORROW AT BRIDGE ABUTMENTS

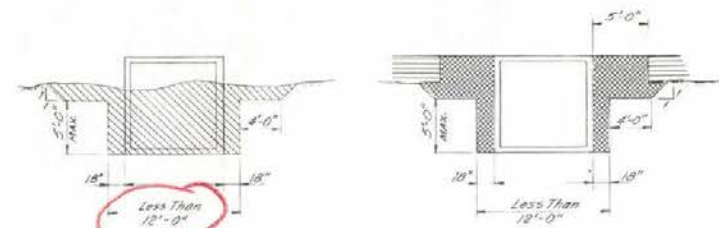

CULVERT IN EMBANKMENT

TRENCH SHORING - MINIMUM REQUIREMENTS

Depth of Trench	Kind or condition of earth	Type and spacing of members											
		Uprights		Struts		Cross braces				Maximum Spacing			
		Min. Dia.	Max. Spac.	Min. Dia.	Max. Spac.	width of Trench				Vert.	Horiz.		
1 to 5 feet	Hard, compact	2x4 or 2x6	6	2x6	4x4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
5 to 10 feet	Likely to crack	2x4 or 2x6	3	4x4	4	2x6	4x4	4x4	4x4	4x4	4x4	4	6
	Soft, sandy, or filled	2x4 or 2x6	Close Sheeting	4x4	4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
10 to 15 feet	Hydrostatic pressure	2x4 or 2x6	Close Sheeting	4x4	4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
	Hard	2x4 or 2x6	2	4x4	4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
15 to 20 feet	Likely to crack	2x4 or 2x6	2	4x4	4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
	Soft, sandy, or filled	2x4 or 2x6	Close Sheeting	4x4	4	4x4	4x4	4x4	4x4	4x4	4x4	4	6
20 to 30 feet	Hydrostatic pressure	2x4	Close Sheeting	6x10	4	2x6	4x4	4x4	4x4	4x4	4x4	4	6
	All kinds or conditions	2x4	Close Sheeting	4x12	4	4x12	4x4	4x4	4x4	4x4	4x4	4	6
Deep 30 feet	All kinds or conditions	2x4	Close Sheeting	6x8	4	4x12	4x4	4x4	4x4	4x4	4x4	4	6

Trench Jacks may be used in lieu of, or in combination with, cross braces. Shoring is not required in solid rock, hard shale, or hard clay. Where desirable, steel sheet piling and bracing of equal strength may be substituted for wood.




APPROXIMATE ANGLE OF REPOSE FOR SLOPING OF SIDES OF EXCAVATIONS

NOTE: Clays, Silts, Loams or Nonhomogeneous Soils Require Shoring and Bracing. The Presence of Ground Water Requires Special Treatment.

GENERAL NOTES

- TRENCHES MORE THAN 5 FEET DEEP SHALL BE SHORED, LASHED BACK TO AT LEAST THE ANGLE IN REPOSE FOR EXISTING FIELD CONDITIONS, OR SOME OTHER MEANS OF PROTECTION SHALL BE PROVIDED.
- IF HAZARDOUS FIELD CONDITIONS INDICATE GROUND MOVEMENT MAY BE EXPECTED, TRENCHES LESS THAN 5 FEET DEEP SHALL ALSO BE PROTECTED AS INDICATED IN NOTE 1.
- FOR THE PURPOSE OF PAYMENT, STRUCTURE EXCAVATION AND BACKFILL QUANTITIES ARE BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE.
- IF SHORING IS USED, PAYMENT WILL BE MADE FOR STRUCTURE EXCAVATION AND BACKFILL BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE FOR SHORING.
- MINIMUM REQUIREMENTS FOR SHORING ARE AS SHOWN IN THE TABLE ON THIS SHEET.
- THE QUANTITY OF STRUCTURE EXCAVATION AND BACKFILL MEASURED FOR PAYMENT SHALL BE THE NUMBER OF CUBIC YARDS CALCULATED PLUS ANY UTILIZATION OF LIMITS WHICH OVERLAP.

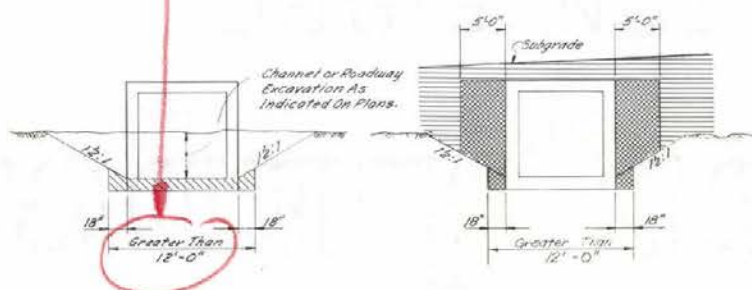

CULVERT IN EXCAVATION OR EMBANKMENT


- Structure Excavation
- Backfill
- Roadway Embankment

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STRUCTURE EXCAVATION AND BACKFILL (METHOD OF MEASUREMENT)

R-1.1.4(206.207)
ADOPTED 11/73 REVISION 11-1/75

CHIEF ROAD DESIGN ENGR

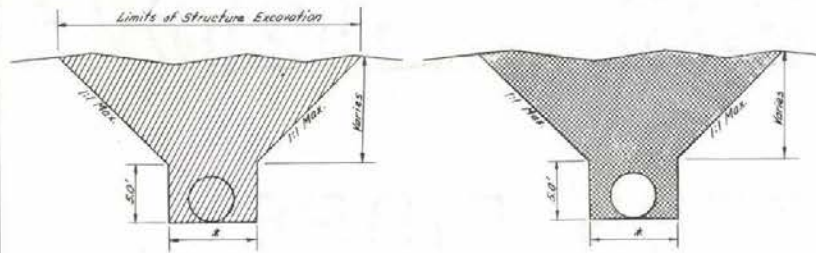

OUTSIDE DIAMETER IS 6 FEET OR LESS


TRENCH SHORING - MINIMUM REQUIREMENTS

Depth of Trench	Kind or Condition of Earth	Size and Spacing of Members										
		Uprights		Diaphragms		Cross Braces						
		Min. Dia.	Max. Spac.	Min. Dia.	Max. Spac.	Width of Trench				Maximum Spacing		
Feet	Inches	Feet	Inches	Inches	Inches	Inches	Inches	Inches	Feet	Feet		
5 to 10	Hard, compact	3x6 to 2x6	6	---	---	2x6	4x6	4x6	4x6	8x8	4	6
	Likely to crack	3x6 to 2x6	7	4x6	4	2x6	4x6	4x6	4x6	8x8	4	6
	Soft, sandy, or filled	3x6 or 2x6	Close Sheeting	4x6	4	2x6	4x6	4x6	4x6	8x8	4	6
10 to 13	Hydrostatic pressure	3x6 or 2x6	Close Sheeting	4x6	4	2x6	4x6	4x6	4x6	8x8	4	6
	Hard	3x6 or 2x6	4	4x6	4	2x6	4x6	4x6	4x6	8x8	4	6
	Likely to crack	3x6 or 2x6	7	4x6	4	2x6	4x6	4x6	4x6	8x8	4	6
13 to 20	Soft, sandy, or filled	3x6 or 2x6	Close Sheeting	4x6	4	2x6	4x6	4x6	4x6	8x10	4	6
	Hydrostatic pressure	3x6	Close Sheeting	4x10	4	2x6	4x6	4x6	4x6	8x10	4	6
	All kinds or conditions	3x6	Close Sheeting	4x12	4	2x6	4x6	4x6	4x6	10x10	4	6
Over 20	All kinds or conditions	3x6	Close Sheeting	4x12	4	2x6	4x6	4x6	4x6	10x12	4	6


Trench jacks may be used in lieu of, or in combination with, cross braces.
 Shoring is not required in solid rock, hard shale, or hard slag.
 Where desirable, steel sheet piling and bracing of equal strength may be substituted for wood.



APPROXIMATE ANGLE OF REPOSE FOR SLOPING OF SIDES OF EXCAVATION

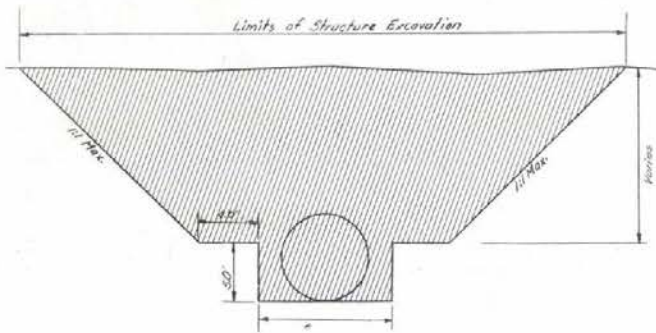

OUTSIDE DIAMETER IS GREATER THAN 6 FEET

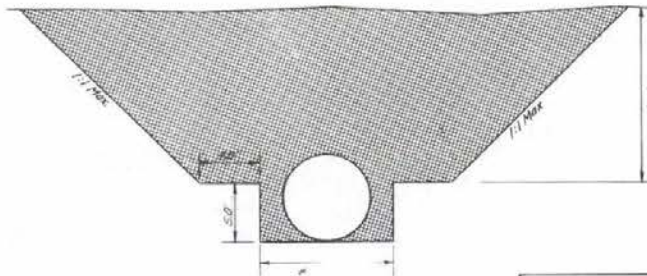

- GENERAL NOTES
- 1) TRENCHES MORE THAN 5 FEET DEEP SHALL BE SHORED, LAID BACK TO AT LEAST THE ANGLE OF REPOSE FOR EXISTING FIELD CONDITIONS, OR SOME OTHER MEANS OF PROTECTION SHALL BE PROVIDED.
 - 2) IF HAZARDOUS FIELD CONDITIONS INDICATE GROUND MOVEMENT MAY BE EXPECTED, TRENCHES LESS THAN 5 FEET DEEP SHALL ALSO BE PROTECTED AS INDICATED IN NOTE 1.
 - 3) FOR THE PURPOSE OF PAYMENT, STRUCTURE EXCAVATION AND BACKFILL QUANTITIES ARE BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE.
 - 4) IF SHORING IS USED, PAYMENT WILL BE MADE FOR STRUCTURE EXCAVATION AND BACKFILL BASED ON THESE STANDARD DRAWINGS AND NO ADDITIONAL PAYMENT WILL BE MADE FOR SHORING.
 - 5) MINIMUM REQUIREMENTS FOR SHORING ARE AS SHOWN IN THE TABLE ON THIS SHEET.
 - 6) THE QUANTITY OF STRUCTURE EXCAVATION AND BACKFILL MEASURED FOR PAYMENT SHALL BE THE NUMBER OF CUBIC YARDS CALCULATED HEREIN ANY DUPLICATION OF LIMITS WHICH OVERLAP.

LEGEND

Structure Excavation



Backfill

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


STRUCTURE EXCAVATION
AND BACKFILL
(METHOD OF MEASUREMENT)

Robert L. ...
CHIEF ROAD DESIGN ENGINEER


R-11.5 (REV. 2017)
APPROVED: 10/17/20
3-1178

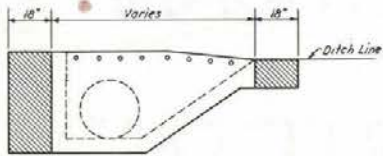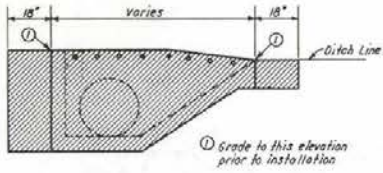

TYPE 7 DROP INLET

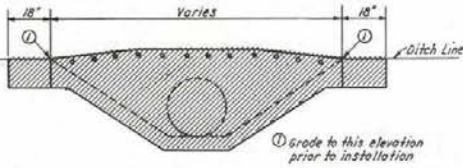


TYPE 8 DROP INLET

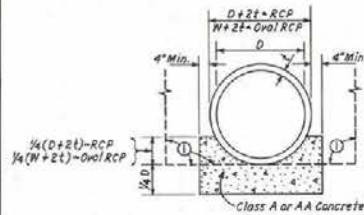


CLASS A BEDDING

Payment for excavated area below the bottom of the pipe grade to be included in the unit bid price per cubic yard of concrete.

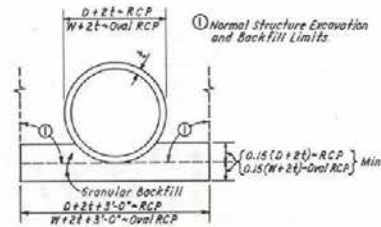


CLASS B BEDDING

Payment for excavated area below the bottom of the pipe grade and the backfill indicated above the flow line is to be included in the unit bid price for granular backfill. Bedding shall be carefully shaped to fit pipe prior to installation. No direct payment for shaping the trench.




CLASS C BEDDING

BEDDING FOR CONCRETE CULVERT

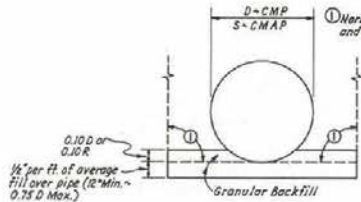

CLASS B BEDDING

Payment for excavated area below the bottom of the pipe grade and the backfill indicated above the flow line is to be included in the unit bid price for granular backfill. Bedding shall be carefully shaped to fit pipe prior to installation. No direct payment for shaping the trench.



CLASS C BEDDING

BEDDING FOR CMP OR CMAP

GENERAL NOTES

- 1.- Minimum depths as specified in "Culvert Installation with Unstable Foundations" as Sheet R-1.1.1, Notes NR5 and 8 will prevail when these conditions are encountered.
- 2.- Excavation for multiple pipe or RC8 installations exceeding 12 feet in width shall be paid for as channel excavation or roadway excavation.

LEGEND

- Structure Excavation
- Backfill
- Roadway Excavation
- Channel Excavation
- Drainage Excavation
- Roadway Embankment


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**STRUCTURE EXCAVATION
AND BACKFILL
(METHOD OF MEASUREMENT)**


ADOPTED: 8/69 REVISION 3 4/78

Robert F. Shugel
CHIEF ROAD DESIGN ENGR.


R 10

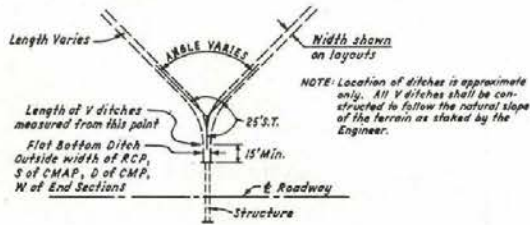

PLAN
DRAINAGE DITCHES

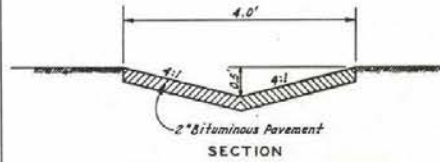


SECTION
BITUMINOUS TURNOUT DITCH
(Plantmix or Roadmix with Seal Coat)




① Inlet and Outlet Ditches to be on same grade as culvert for a distance of 25' minimum.
(See detail below for design of ditches).

CULVERT INSTALLATION
(PREFERRED)

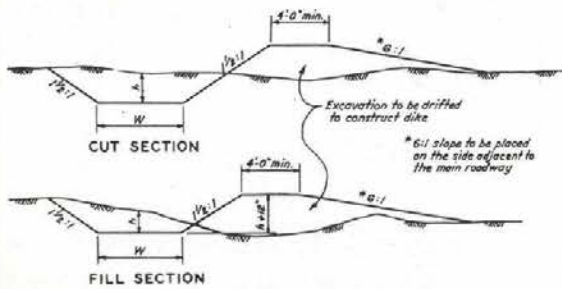


FLAT BOTTOM DITCH AND DIKE

h = Depth of ditch or height of dike as indicated on the plans or as directed by the Engineer.
W = Width of ditch as indicated on the plans or as directed by the Engineer.

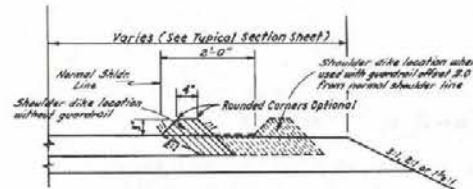


SECTION
BITUMINOUS SHOULDER DIKE
(Plantmix or Roadmix with Seal Coat)




W = Width of ditch as indicated on the plans or as directed by the Engineer

INLET, OUTLET, AND MEDIAN DITCH DETAILS



SECTION
V TYPE DITCH AND DIKE

To be used for surface ditches and where ordered by the Engineer.
h = Depth as ordered by the Engineer (1'-6" min.)
H = Height as ordered by the Engineer (2'-6" min.)

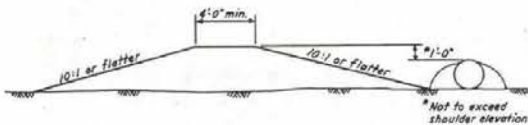

DIKE DETAIL

Inlet and outlet dikes within 30' of roadway shoulder and median dikes. Location as indicated on plans.

Note: Dimensions relating to excavation (ditches) or embankment (dikes) shall be designated as *W* (width) x *H* (height or depth) x *L* (length).

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

DRAINAGE DITCHES
AND DIKES

ADOPTED: 8/09 REVISION 8-17/09

*ROUND CORRUGATED STEEL PIPE
2 2/3" x 1/2" CORRUGATIONS

PIPE DIAMETER	MIN. COVER	PLATE THICKNESS IN INCHES									
		0.064		0.079		0.109		0.138		0.168	
		R	E	R	E	R	E	R	E	R	E
INCHES	INCHES	MAX. FILL HTS. ABOVE TOP OF PIPE IN FEET									
12	12	63		83							
15	12	90		66							
18	12	42		55		84					
24	12	32		42		61		75			
30	12	25		33		49		60		74	
36	12	21		28		41		50		62	
42	12	41		44		46		72	48	76	80
48	12		35		38	45	63	46	67	47	70
54	12				34	43	56	44	59	45	63
60	12				42	50	43	53	44	56	
66	12					41	46	42	49	43	51
72	12							41	45	42	47
78	12								43	36	44
84	12								40	31	42

*ROUND CORRUGATED STEEL PIPE
3" x 1" CORRUGATIONS

PIPE DIAMETER	MIN. COVER	PLATE THICKNESS IN INCHES									
		0.064		0.079		0.109		0.138		0.168	
		R	E	R	E	R	E	R	E	R	E
INCHES	INCHES	MAX. FILL HTS. ABOVE TOP OF PIPE IN FEET									
36	12	37	39	46	48	73	75	85	88	96	100
42	12	33	35	42	44	62	72	69	84	76	87
48	12	30	32	39	41	58	64	59	77	66	79
54	12	27	29	36	38	56	59	57	64	65	71
60	12	25	26	32	34	50	53	51	56	58	64
66	12	23	23	29	31	45	48	46	52	53	58
72	12	21	22	28	29	42	44	43	48	49	53
78	12	19	20	25	26	38	41	42	44	44	49
84	18			23	25	36	38	40	42	42	46
90	18			21	23	33	35	38	40	41	43
96	18					30	33	37	38	40	42
102	24					26	28	34	35	38	41
108	24					22	24	32	34	35	37
114	24					21	23	31	32	34	36
120	24					20	22	29	30	32	32

*ROUND ALUMINUM ALLOY PIPE
2 2/3" x 1/2" CORRUGATIONS

PIPE DIAMETER	MIN. COVER	PLATE THICKNESS IN INCHES									
		0.060		0.075		0.105		0.135		0.164	
		R	E	R	E	R	E	R	E	R	E
INCHES	INCHES	MAX. FILL HT. ABOVE TOP OF PIPE IN FEET									
12	12	41		43		70		73		75	
18	12	27		29		47		49		50	
24	12	20		21		35		37		38	
30	12	16		17		28		29		31	
36	12	14		15		23		24		25	
42	12			23		39		40		41	
48	12					36		37		39	
54	12					31		33		34	
60	12							30		31	
66	12							27		28	
72	12									26	

* RIVETED, WELDED OR HELICAL FABRICATION
 ** TOP OF PIPE TO TOP OF FINISHED GRADE AT SHOULDER LINE.
 R=ROUND E=ELONGATED

*CORRUGATED STEEL PIPE ARCH
2 2/3" x 1/2" CORRUGATIONS

PIPE DIMENSIONS SPAN - RISE	MIN. COVER	CORNER RADIUS	MIN. THICKNESS	MAX. COVER FOR CORNER PRESSURES IN TONS PER SQ. FT.	
INCHES	INCHES	INCHES	INCHES	2 TONS	3 TONS
17X13	18	3	0.064	13	19
21X15	18	3	0.064	12	18
24X18	18	3	0.064	10	16
28X20	18	3	0.064	10	15
35X24	18	3	0.064	9	14
42X29	18	31	0.064	9	12
49X33	18	4	0.079	8	12
57X38	18	5	0.109	8	12
64X43	18	6	0.109	8	12
71X47	18	7	0.138	8	12
77X52	18	8	0.168	8	12
83X57	18	9	0.168	9	13

*CORRUGATED STEEL PIPE ARCH
3" x 1" CORRUGATIONS

PIPE DIMENSIONS SPAN - RISE	MIN. COVER	CORNER RADIUS	MIN. THICKNESS	MAX. COVER FOR CORNER PRESSURES IN TONS PER SQ. FT.	
INCHES	INCHES	INCHES	INCHES	2 TONS	3 TONS
43X27	18	71	0.064	12	18
50X31	18	9	0.064	12	18
58X36	18	101	0.064	12	18
65X40	18	12	0.064	12	18
72X44	18	131	0.064	12	18
73X55	18	18	0.064	16	22
81X59	18	18	0.079	15	21
87X63	18	18	0.079	14	20
95X67	18	18	0.109	13	18
103X71	24	18	0.109	12	17
112X75	24	18	0.109	11	16
117X79	24	18	0.109	10	15
128X83	24	18	0.138	9	14

*CORRUGATED ALUMINUM ALLOY PIPE ARCH
2 2/3" x 1/2" CORRUGATIONS

PIPE DIMENSIONS SPAN - RISE	MIN. COVER	CORNER RADIUS	MIN. THICKNESS	MAX. COVER FOR CORNER PRESSURES IN TONS PER SQ. FT.	
INCHES	INCHES	INCHES	INCHES	2 TONS	3 TONS
18X11	18	4	0.060	13	
22X13	18	4	0.060	12	
25X16	18	4	0.060	10	15
29X18	18	41	0.060	10	15
36X22	18	5	0.060	9	13
43X27	18	51	0.075	9	12
50X31	18	6	0.105	8	12
58X36	18	7	0.135	8	12
65X40	18	8	0.135	8	12
72X44	18	9	0.164	8	12



* RIVETED OF HELICAL FABRICATION
 ** TOP OF PIPE TO TOP OF FINISHED GRADE AT SHOULDER LINE FOR 2 TONS PER SQ. FT.
 *** SHALL BE USED ONLY AFTER FOUNDATION INVESTIGATION

EQUIVALENT GAGE NUMBERS
THICKNESS IN INCHES

GAGE NUMBER	STEEL		
	ZN COAT	UNCOATED	AL.
16	0.064	0.0598	0.060
14	0.079	0.0737	0.075
12	0.109	0.1046	0.105
10	0.138	0.1325	0.135
8	0.168	0.1643	0.164
7	0.188	0.1838	
5	0.218	0.2145	
3	0.249	0.2451	
1	0.280	0.2758	

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS
**ALLOWABLE FILL HEIGHTS
 FOR CULVERTS**

Robert A. Schaper
 CHIEF ROAD DESIGN ENGR R-13.1 (601,606)
 ADOPTED 7/73



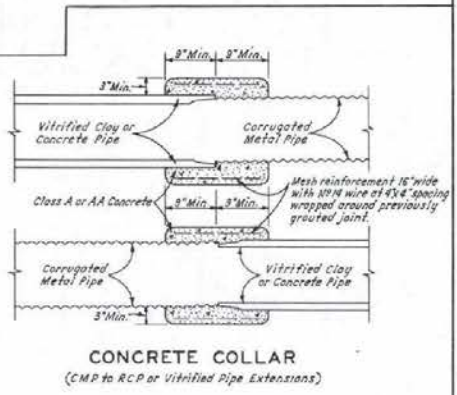
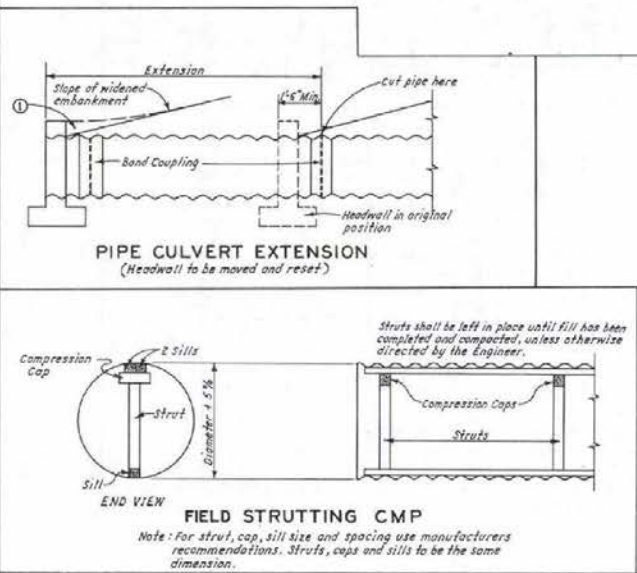


Diameter	Minimum Space Between Pipes
18" to 24"	1'-0"
30" to 66"	One Half Diameter of Pipe
72" to 84"	3'-0"

* When headwalls are used or anticipated for future use, space as per headwalls standard.

Span	Min. Space Between Pipe Arches
17" to 35"	1'-0"
42" to 83"	One Third Span of Pipe Arch

MULTIPLE INSTALLATIONS WITHOUT HEADWALLS

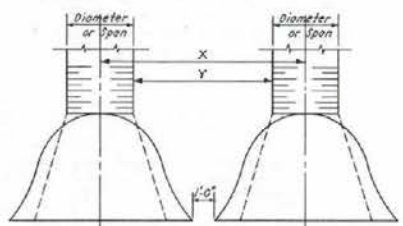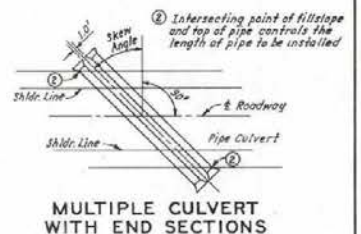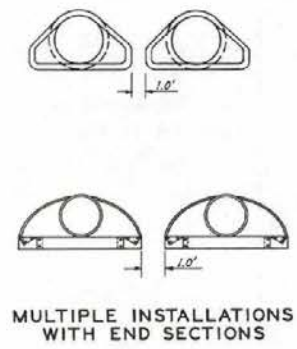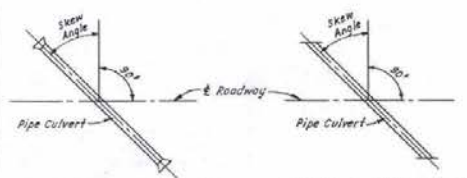

Note: When Y distance exceeds 3'-0", structure Excavation and Backfill quantities shall be calculated for each culvert.

DIA	CMP		SPAN	CMAP		DIA	RCP	
	X	Y		X	Y		X	Y
18"	4'-0"	3'-0"	17' X 13"	4'-8"	8'-2"	18"	3'-0"	2'-0"
18"	4'-8"	3'-5"	20' X 15"	5'-2"	8'-6"	18"	4'-0"	2'-6"
18"	5'-2"	3'-10"	24' X 18"	5'-10"	9'-2"	24"	4'-0"	3'-0"
21"	5'-0"	4'-3"	28' X 20"	6'-0"	10'-1"	30"	6'-0"	3'-6"
24"	6'-8"	4'-8"	35' X 24"	7'-8"	12'-8"	36"	7'-0"	4'-0"
30"	8'-0"	5'-6"	42' X 29"	8'-3"	15'-8"	42"	7'-6"	4'-0"
36"	9'-4"	6'-4"	49' X 33"	10'-3"	18'-1"	48"	8'-0"	4'-0"
42"	10'-8"	7'-2"	57' X 38"	11'-6"	21'-8"	54"	7'-10"	3'-4"
48"	11'-6"	7'-8"	64' X 43"	12'-6"	25'-1"			
54"	12'-2"	7'-10"	71' X 47"	13'-6"	28'-6"			
60"	13'-6"	8'-8"	77' X 52"	14'-6"	32'-11"			
66"	14'-0"	8'-6"	83' X 57"	15'-6"	36'-5"			
72"	14'-8"	8'-6"						
78"	15'-0"	8'-10"						
84"	15'-8"	8'-8"						


TABLE OF SEPARATION FOR MULTIPLE INSTALLATIONS

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT INSTALLATION

Robert L. Shogren
CHIEF ROAD DESIGNER


R-211 (601 THRU 606)
ADOPTED: 8/69 REVISION 3 11/76

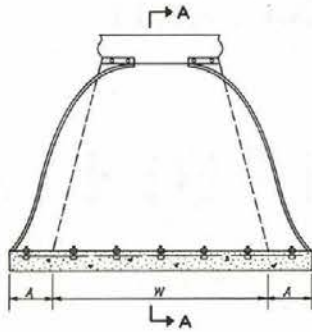


PLAN

DIMENSIONS				* Concrete Cu. Yd.
Pipe Diam.	Gage	A (1" Tol.)	W (2" Tol.)	
48"	12	18"	90"	0.26
54"	12	18"	102"	0.29
60"	12	18"	114"	0.31
66"	12	18"	120"	0.32
72"	12	18"	126"	0.34
78"	12	18"	132"	0.35
84"	12	18"	138"	0.36

* For information only.

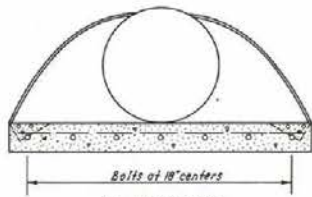

ELEVATION

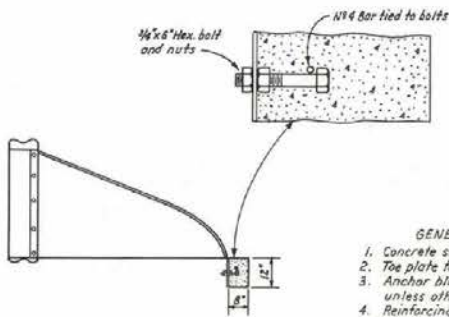

SECTION A-A

GENERAL NOTES

1. Concrete shall be Class A or AA.
2. Toe plate to be eliminated when anchor block is used.
3. Anchor block is to be installed on inlet end only, unless otherwise specified.
4. Reinforcing steel bar to clear 2" on ends of concrete block.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT INSTALLATION
ANCHOR BLOCK FOR CULVERTS
48" TO 84"



 CHIEF ROAD DESIGNER/ENR.

R-2.1.2-(604)

ADOPTED: 8/69 REVISION

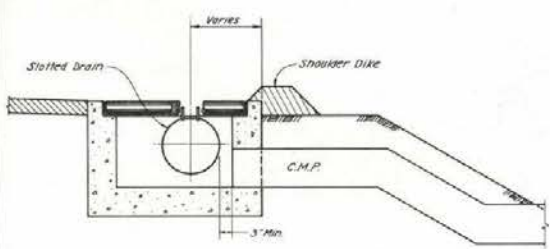


TYPE 4 EMBANKMENT PROTECTOR & SLOTTED DRAIN

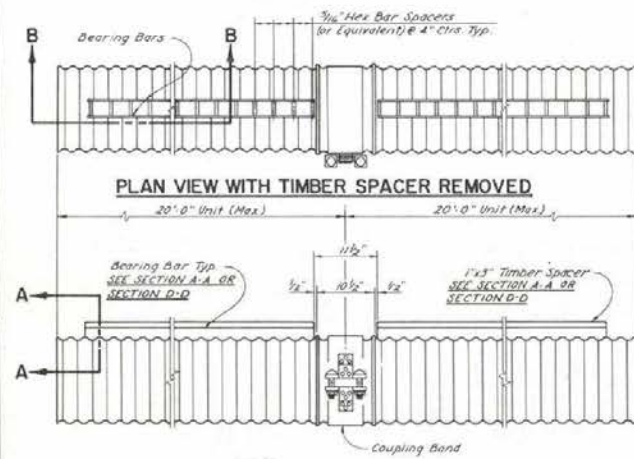


PLAN VIEW WITH TIMBER SPACER REMOVED


SLOTTED DRAIN DETAIL

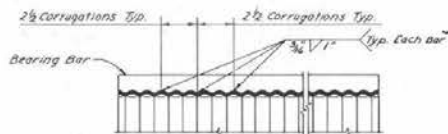


SECTION B-B

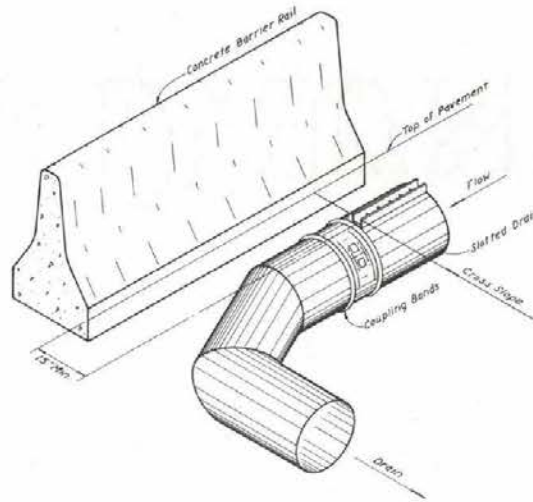


**45° ANGLE SLOTTED DRAIN & CONCRETE BARRIER RAIL
(CAN BE USED WITH SHOULDER DIKE)**

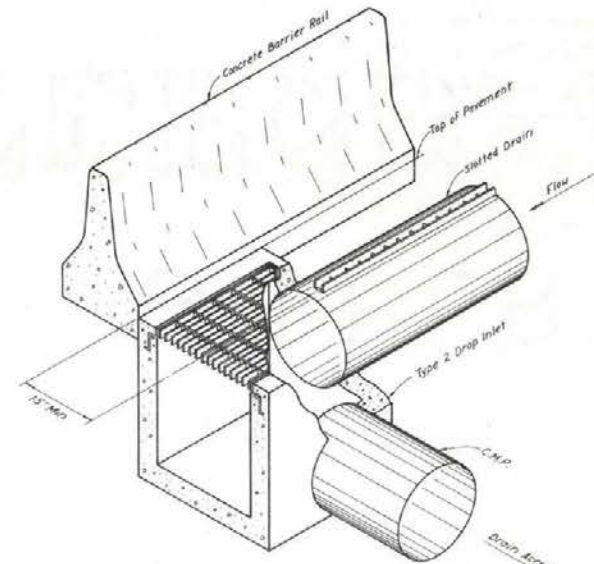

SLOTTED DRAIN, CONCRETE BARRIER RAIL & TYPE 2 DROP INLET

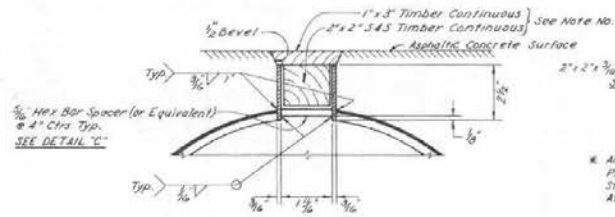


SECTION A-A

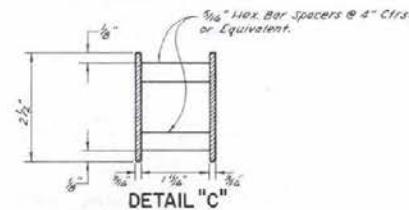

DETAIL "C"


(DOUBLE BAR SPACERS TO BE USED IN URBAN AREAS)

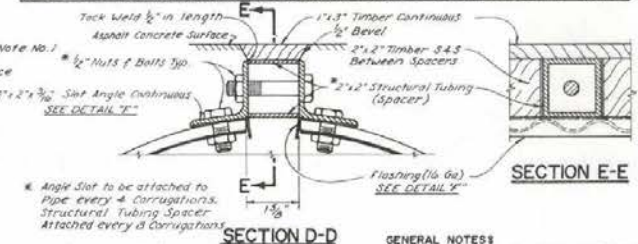

SECTION D-D

SECTION E-E

GENERAL NOTES
1. This continuous timber is nailed together & left in place as shown during paving operations. Remove after compaction.




DETAIL "F"

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**SLOTTED C.M.P. DRAIN
DETAILS**

William L. Dyer R-2.1.3 (604)
CHIEF ROAD DESIGNER ADOPTED 6-71 REVISION

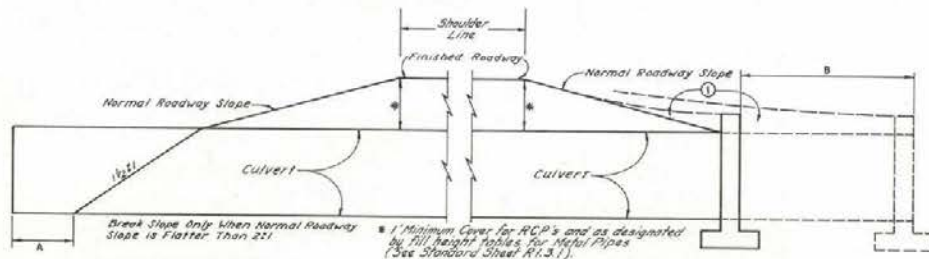


WITHOUT HEADWALL

WITH CONCRETE HEADWALL


A - LENGTH OF CULVERT SHALL BE INCREASED AS FOLLOWS; CONSIDER EACH SIDE SEPARATELY. MEASURE PIPE FROM ROADWAY CENTERLINE TO THE INTERSECTION OF PIPE FLOW LINE AND FILLSLOPE. TO THIS DIMENSION ADD 2.0' WHEN COVER AT SHOULDER IS 1.0' TO 10.0', ADD AN ADDITIONAL 0.5' FOR EACH SUCCEEDING 5.0' OF COVER OR PORTION THEREOF.

B - LENGTH OF CULVERT SHALL BE INCREASED AS FOLLOWS; CONSIDER EACH SIDE SEPARATELY. MEASURE PIPE FROM ROADWAY CENTERLINE TO THE INTERSECTION OF THE TOP OF PIPE AND FILLSLOPE PLUS HEADWALL THICKNESS. TO THIS DIMENSION ADD 1.0' WHEN COVER AT SHOULDER IS 5.0' TO 10.0', ADD AN ADDITIONAL 0.5' FOR EACH SUCCEEDING 5.0' OF COVER OR PORTION THEREOF.

① CONTOUR THIS AREA TO PROVIDE THE MINIMUM AMOUNT OF OBSTRUCTION EXPOSURE.

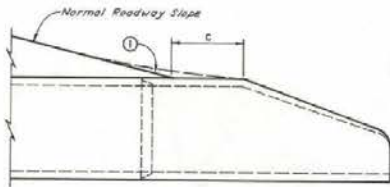



PRECAST CONCRETE END SECTION

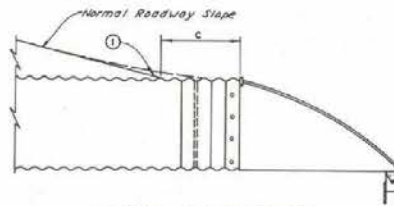


METAL END SECTION

C - LENGTH OF CULVERT SHALL BE INCREASED AS FOLLOWS; CONSIDER EACH SIDE SEPARATELY. MEASURE PIPE FROM ROADWAY CENTERLINE TO THE INTERSECTION OF THE TOP OF PIPE AND FILLSLOPE. TO THIS DIMENSION ADD 1.0' WHEN COVER AT SHOULDER IS 1.0' TO 10.0', ADD AN ADDITIONAL 0.5' FOR EACH SUCCEEDING 5.0' OR PORTION THEREOF.

MINIMUM CULVERT INSTALLATION

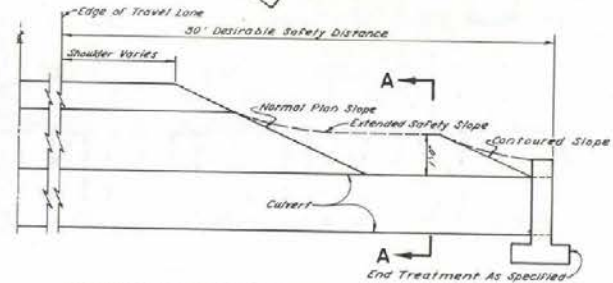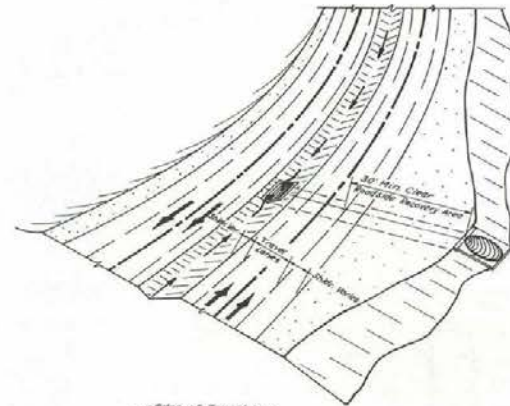

METHOD OF CONTOURING OVER CULVERTS

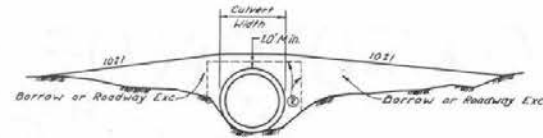

SECTION A-A

**SAFETY CULVERT INSTALLATION
(TO PROVIDE OBSTRUCTION CLEARANCE)**

NOTE: 1. SOMETIMES DUE TO THE RIGHT OF WAY LIMITS OR DRAINAGE CONTROLS, A CULVERT MAY BE EXTENDED A SAFE DISTANCE, AS NOTED ON THE PLANS, AND THE FILL SLOPE MARKED FOR SAFETY AND A PLEASING APPEARANCE, BUT NOT MEET THE 30' MINIMUM SAFETY REQUIREMENTS. IF SUCH CONSTRUCTION IS NOT FEASIBLE, THEN VEHICLES MAY BE PROTECTED BY GUARDRAIL OR SOME OTHER TYPE OF BARRIER.

2. NORMAL STRUCTURE EXCAVATION AND BACKFILL LIMITS

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**CULVERT
INSTALLATION**

Robert E. Brown
CHIEF ROAD DESIGN ENGINEER


R-2.1.4 (601 THRU 606)
ADOPTED 6/72

TYPE CONNECTION	PIPE DIAM.	GAGE	DIMENSIONS					APPROX SLOPE
			A 1" TOL	B MAX	H 1" TOL	L 1/2" TOL	W 2" TOL	
TYPE 1	12"	16	6"	6"	6"	21"	24"	2 1/2 : 1
	15"	16	7"	8"	6"	26"	30"	2 1/2 : 1
	18"	16	8"	10"	6"	31"	36"	2 1/2 : 1
	21"	16	9"	12"	6"	36"	42"	2 1/2 : 1
	24"	16	10"	13"	6"	41"	48"	2 1/2 : 1
TYPE 2	30"	14	12"	16"	8"	51"	60"	2 1/2 : 1
	36"	14	14"	19"	9"	60"	72"	2 1/2 : 1
	42"	12	16"	22"	11"	69"	84"	2 1/2 : 1
TYPE 3	48"	12	18"	27"	12"	78"	90"	2 1/4 : 1
	54"	12	18"	30"	12"	84"	102"	2 : 1
	60"	12	18"	33"	12"	87"	114"	1 3/4 : 1
	66"	12	18"	36"	12"	87"	120"	1 1/2 : 1
	72"	12	18"	39"	12"	87"	126"	1 1/4 : 1
	78"	12	18"	42"	12"	87"	132"	1 1/4 : 1
	84"	12	18"	45"	12"	87"	138"	1 1/4 : 1


TYPE CONNECTION	PIPE ARCH DIMENSIONS		GAGE	DIMENSIONS					APPROX SLOPE
	SPAN	RISE		A 1" TOL	B MAX	H 1" TOL	L 1/2" TOL	W 2" TOL	
TYPE 2	17"	13"	16	7"	9"	6"	19"	30"	2 1/2 : 1
	21"	15"	16	7"	10"	6"	23"	36"	2 1/2 : 1
	24"	19"	16	8"	12"	6"	28"	42"	2 1/2 : 1
	28"	20"	16	9"	14"	6"	32"	48"	2 1/2 : 1
	35"	24"	14	10"	16"	6"	39"	60"	2 1/2 : 1
	42"	29"	14	12"	18"	8"	46"	75"	2 1/2 : 1
TYPE 3	49"	33"	12	13"	21"	9"	53"	85"	2 1/2 : 1
	57"	38"	12	18"	26"	12"	63"	90"	2 1/2 : 1
	64"	43"	12	18"	30"	12"	70"	102"	2 1/4 : 1
	71"	47"	12	18"	33"	12"	77"	114"	2 1/4 : 1
	77"	52"	12	18"	36"	12"	77"	126"	2 : 1
	83"	57"	12	18"	39"	12"	77"	138"	2 : 1




PLAN

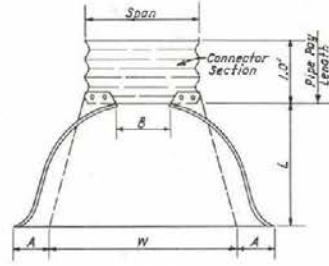


PLAN

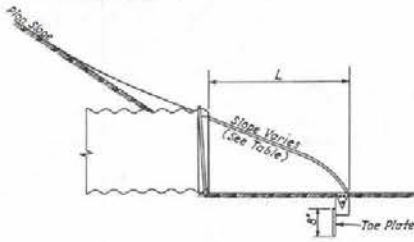


SECTION TYPE 1 OR 2 CONNECTION

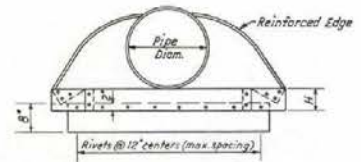


ELEVATION

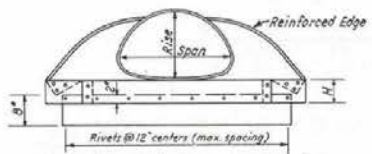

ELEVATION

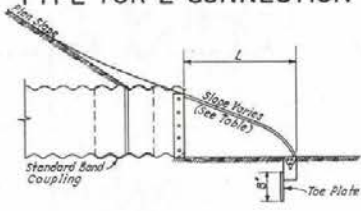

SECTION TYPE 3 CONNECTION

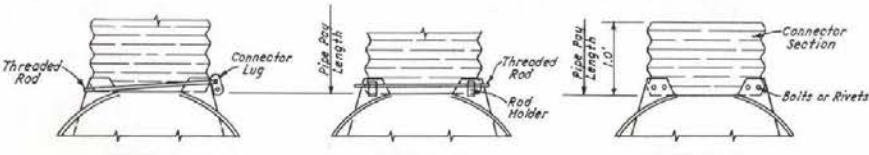

TYPE 1

TYPE 2

TYPE 3

For 12" CMP through 24" CMP only For 30" CMP through 36" CMP only
 For 11" x 13" CMAP through 57" x 38" CMAP only For 42" CMP through 84" CMP only
 For 64" x 43" CMAP through 83" x 57" CMAP only

STANDARD CONNECTIONS

GENERAL NOTES

- The culvert lengths shown on the plans and structure list shall be the pay length as indicated on the standard sheet including connector section lengths when used.
- Pipe on skew shall not be mitered. Sufficient additional length of pipe shall be allowed to provide clearance for end sections.
- Toe plates required on round pipe 24" and over in diameter and on arch pipe 28" x 20" and over unless otherwise specified on the plans or in the Special Provisions.
- Toe plate shall be punched with 7/16" holes to match holes in lip of end section and bolted with 3/8" galvanized bolts.


STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

METAL END SECTIONS
 12" CMP TO 84" CMP AND
 17" x 13" CMAP TO 83" x 57" CMAP

ADOPTED: 8/75 REVISION


DIAMETER	WEIGHT	A	B	C	E	W
18"	610	8"	2'-11"	2'-11"	2'-3"	17'-0"
24"	1520	9"	3'-2"	3'-2"	2'-3"	24'-0"
30"	1850	1'-0"	4'-2"	4'-2"	2'-3"	24'-0"
36"	2520	1'-3"	5'-2"	5'-2"	2'-3"	24'-0"
42"	3210	1'-6"	6'-2"	6'-2"	2'-3"	24'-0"
48"	4150	1'-9"	7'-2"	7'-2"	2'-3"	24'-0"
54"	5150	2'-3"	8'-0"	8'-0"	2'-3"	24'-10"

- GENERAL NOTES
1. CLASS AND TYPE OF CONCRETE SHALL BE AS SPECIFIED FOR REINFORCED CONCRETE PIPE.
 2. STRUCTURAL DESIGN OF END SECTION SHALL CONFORM TO THAT OF STANDARD REINFORCED CONCRETE CULVERT PIPE.
 3. LENGTH OF PIPE SHOWN ON THE PLANS DOES NOT INCLUDE CONNECTOR SECTION (LENGTH C).

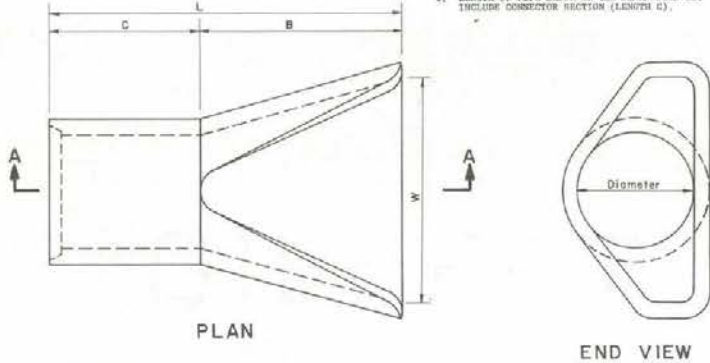

PLAN


END VIEW

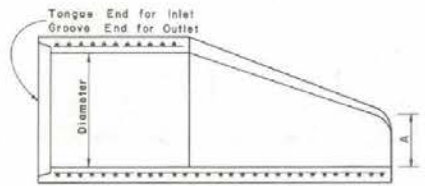


SECTION A-A




CROSS SECTION VIEW
18" RCP TO 54" RCP

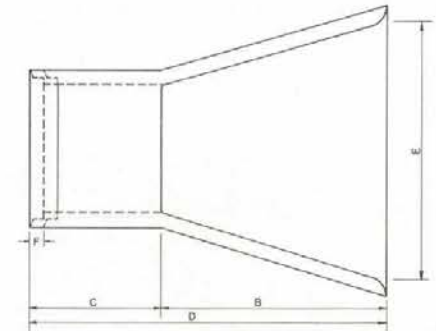



PLAN

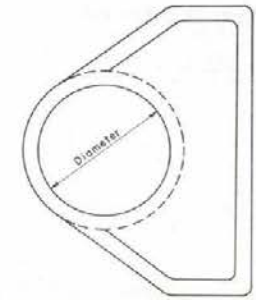

END VIEW

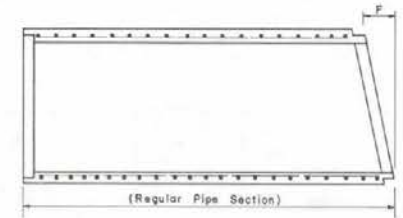

(Regular Pipe Section)

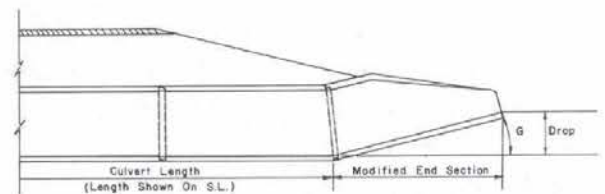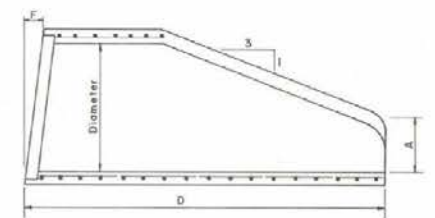

MODIFIED END SECTION

MODIFIED END SECTION DIMENSIONS AND WEIGHTS

Dia.	Wt.	A	B	C	D	E	F	G	Drop
36"	3500	1'-3"	5'-2"	2'-11"	2'-11"	6'-0"	3'-3/8"	104"	1'-0"
48"	6700	2'-0"	6'-0"	2'-2"	2'-2"	7'-0"	5'-7/8"	14"	2'-0"

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

RCP END SECTION

Paul H. ...
CHIEF ROAD DESIGN ENGR

R-2.3.1-(603)
ADOPTED 1/75 REVISION

R 18

CMP SIZE D	CORR AREA S X R	CMP AREA SQ FT	L	SINGLE CMP				DOUBLE CMP											
				0° SKEW		15° SKEW		30° SKEW		15° SKEW		30° SKEW		45° SKEW					
				CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB				
12"		0.79	3'-6"	0.85	3.5	0.92	3.7	0.94	3.7	0.99	3.9	1.21	4.6	1.30	4.9	1.35	5.0	1.49	5.3
15"	18" X 11"	1.23	4'-3"	1.09	4.9	1.19	5.0	1.21	5.1	1.27	5.2	1.51	5.7	1.62	6.4	1.68	6.5	1.85	6.9
18"	22" X 15"	1.77	5'-0"	1.26	5.5	1.48	5.9	1.51	5.9	1.57	6.1	1.83	7.0	1.96	7.3	2.05	7.5	2.24	8.0
24"	29" X 18"	3.14	6'-6"	1.95	7.8	2.12	8.3	2.16	8.4	2.25	8.6	2.53	9.5	2.73	10.0	2.84	10.3	3.08	10.8
30"	35" X 22"	4.31	8'-0"	2.51	10.5	2.85	11.1	2.90	11.2	3.01	11.5	3.39	12.6	3.65	13.2	3.79	13.5	4.11	14.2
36"	43" X 27"	7.07	9'-6"	3.35	12.2	3.66	12.9	3.72	13.1	3.86	13.4	4.34	14.7	4.68	15.5	4.85	15.8	5.25	16.7
42"	50" X 31"	9.52	11'-0"	4.18	15.7	4.56	17.7	4.64	17.9	4.81	18.2	5.39	19.6	5.81	20.6	6.03	21.0	6.52	22.0


Quantities shown above are for two headwalls

Quantities shown below are for one headwall


CMP SIZE D	LENGTH OF REINFORCING BARS															
	SINGLE CMP					SINGLE OR DOUBLE CMP					DOUBLE CMP					
	0°-45°	0°	15°	30°	45°	0°	15°	30°	45°	0°-45°	0°	15°	30°	45°		
	NO. 4	NO. 5	NO. 5	NO. 5	NO. 5	NO. 4	NO. 4	NO. 4	NO. 4	NO. 4	NO. 4	NO. 5	NO. 5	NO. 5		
	K	N	N	N	N	M	M	Q	M	Q	M	K	N	N		
12"	4 @ 2'-6"	2 @ 4'-3"	2 @ 4'-3"	2 @ 4'-3"	2 @ 5'-0"	2 @ 1'-6"	1 @ 1'-4"	1 @ 2'-0"	1 @ 1'-3"	1 @ 2'-1"	1 @ 1'-0"	1 @ 2'-4"	2 @ 2'-6"	2 @ 6'-3"	2 @ 7'-1"	2 @ 7'-10"
15"	6 @ 2'-0"	2 @ 5'-3"	2 @ 5'-3"	2 @ 5'-3"	2 @ 6'-2"	2 @ 1'-8"	1 @ 1'-6"	1 @ 2'-2"	1 @ 1'-5"	1 @ 2'-3"	1 @ 1'-2"	1 @ 2'-6"	2 @ 7'-6"	2 @ 8'-1"	2 @ 8'-5"	2 @ 9'-5"
18"	6 @ 2'-11"	2 @ 6'-3"	2 @ 6'-3"	2 @ 6'-3"	2 @ 7'-4"	2 @ 2'-3"	1 @ 2'-1"	1 @ 2'-11"	1 @ 2'-0"	1 @ 3'-0"	1 @ 1'-9"	1 @ 3'-3"	2 @ 8'-11"	2 @ 9'-5"	2 @ 9'-10"	2 @ 10'-11"
24"	6 @ 3'-5"	2 @ 8'-3"	2 @ 8'-3"	2 @ 8'-3"	2 @ 9'-3"	2 @ 3'-0"	2 @ 2'-9"	2 @ 3'-0"	2 @ 3'-0"	2 @ 3'-0"	2 @ 2'-6"	2 @ 4'-7"	2 @ 3'-5"	2 @ 11'-3"	2 @ 12'-1"	2 @ 14'-0"
30"	6 @ 3'-11"	2 @ 10'-3"	2 @ 10'-3"	2 @ 10'-3"	2 @ 11'-5"	2 @ 3'-0"	2 @ 3'-7"	2 @ 3'-6"	2 @ 3'-6"	2 @ 3'-6"	2 @ 3'-3"	2 @ 5'-0"	2 @ 3'-11"	2 @ 14'-0"	2 @ 15'-0"	2 @ 17'-5"
36"	8 @ 4'-5"	2 @ 12'-3"	2 @ 12'-3"	2 @ 12'-3"	2 @ 13'-4"	2 @ 4'-6"	2 @ 4'-4"	2 @ 4'-3"	2 @ 4'-3"	2 @ 4'-0"	2 @ 5'-11"	2 @ 4'-5"	2 @ 16'-0"	2 @ 16'-0"	2 @ 20'-10"	2 @ 20'-10"
42"	10 @ 4'-11"	2 @ 14'-3"	2 @ 14'-3"	2 @ 14'-3"	2 @ 15'-11"	2 @ 5'-2"	2 @ 5'-1"	2 @ 5'-0"	2 @ 5'-0"	2 @ 6'-7"	2 @ 4'-9"	2 @ 6'-10"	2 @ 4'-11"	2 @ 19'-4"	2 @ 21'-11"	2 @ 24'-3"

GENERAL NOTES


- Concrete shall be Class A or AA.
- Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/2" clear of surface of concrete except as noted. Bar ends shall be kept 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
- Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to scour.
- Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
- For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
 Culverts should be installed on 0°, 15°, 30° or 45° where it is feasible.




PLAN
SINGLE CMP

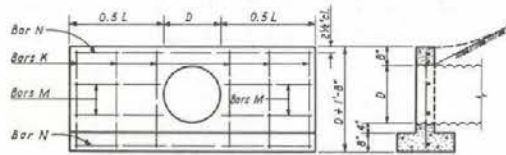


ELEVATION
SINGLE CMP
(For All Headwalls)

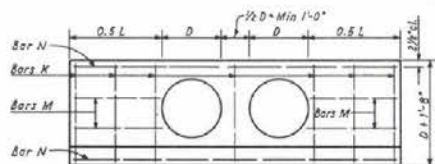


ELEVATION
DOUBLE CMP
0° SKEW

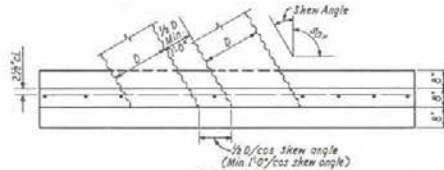

PLAN
DOUBLE CMP

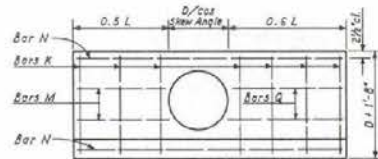

ELEVATION
SINGLE CMP

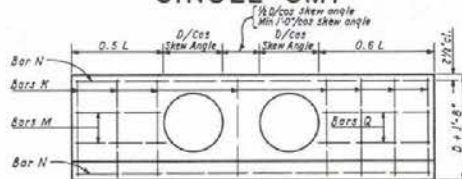

ELEVATION
DOUBLE CMP
15° TO 45° SKEW

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


CULVERT HEADWALLS 12" CMP TO 42" CMP

William L. Nagel
CHIEF ROAD DESIGN ENGR.


R-2.41-(502)

ADOPTED: 8/63


REVISION

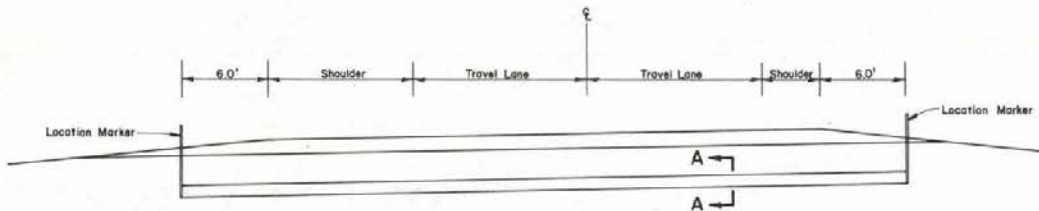


FREEWAY CROSSING DETAIL

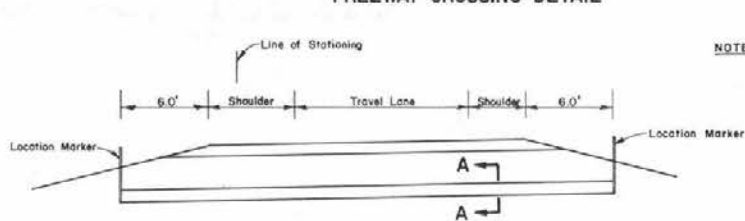

RAMP CROSSING DETAIL

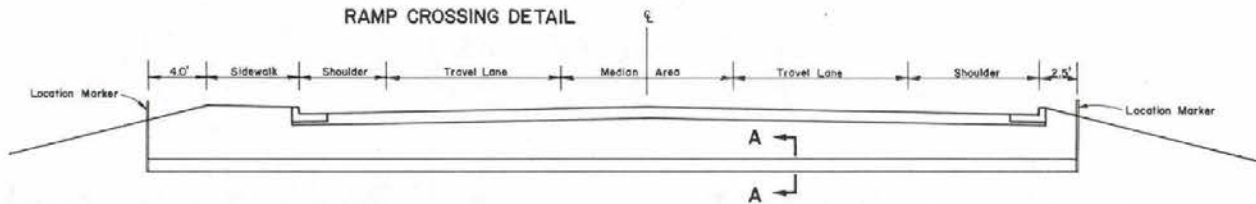


CROSSROAD DETAIL

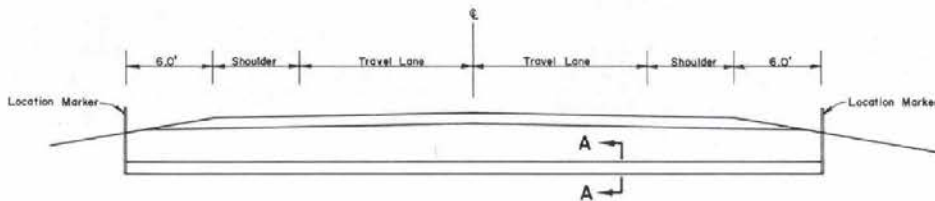

FRONTAGE ROAD DETAIL

6" Min. Sand-Backfill Type

NOTE: Locate Detection Wires in Upper Half of Trench



SECTION A-A

GENERAL NOTES

1. MINIMUM 3.0' COVER OVER TOP OF CONDUIT AT SHOULDER LINE.
2. 12 GAUGE DETECTION WIRE TO LAY IN TRENCH ADJACENT TO CONDUIT AND ATTACH TO LOCATION MARKER AT EACH END.
3. LOCATION MARKER SHALL BE 5.0' STEEL FENCE LINE POST.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**CONDUIT INSTALLATION
FOR
FUTURE WATER LINES**

Paul H. Hays
CHIEF ROAD DESIGN ENGINEER

R-2.4.3 (213)








ADOPTED 5/73 REVISION

Quantities shown below are for two headwalls

RCP SIZE D	RCP AREA SQ. FT.	SINGLE RCP								DOUBLE RCP								X	Y	L	h
		0° SKEW		15° SKEW		30° SKEW		45° SKEW		0° SKEW		15° SKEW		30° SKEW		45° SKEW					
		CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB				
12"	0.79	1.00	46	1.09	49	1.10	49	1.14	50	1.41	59	1.52	62	1.58	64	1.73	67	0'-10"	1'-2"	4'-0"	3'-0"
15"	1.25	1.32	55	1.45	58	1.47	59	1.52	60	1.80	70	1.93	73	2.01	75	2.18	79	0'-10 1/2"	1'-2 1/4"	5'-0"	3'-3 1/2"
18"	1.77	1.62	69	1.77	73	1.80	74	1.85	75	2.15	85	2.31	89	2.40	91	2.60	96	0'-10 1/2"	1'-2 1/2"	5'-9"	3'-7"
21"	2.41	1.95	77	2.13	82	2.16	83	2.23	85	2.59	95	2.75	101	2.90	103	3.13	108	0'-10 1/2"	1'-2 1/4"	6'-6"	3'-10 1/2"
24"	3.14	2.27	96	2.48	102	2.52	103	2.60	105	3.01	116	3.24	122	3.37	125	3.64	131	0'-11"	1'-3"	7'-3"	4'-2"
27"	3.98	2.62	105	2.86	111	2.90	112	2.99	114	3.48	126	3.75	134	3.89	137	4.21	144	0'-11"	1'-3"	8'-0"	4'-5"
30"	4.91	3.08	117	3.37	123	3.41	124	3.44	124	4.07	141	4.38	148	4.55	152	4.90	159	0'-11 1/2"	1'-3 1/4"	9'-0"	4'-9"
33"	5.94	3.50	125	3.82	132	3.87	134	3.88	137	4.62	153	4.98	160	5.17	164	5.56	172	0'-11 1/2"	1'-3 1/4"	9'-9"	5'-1 1/2"
36"	7.07	3.93	161	4.29	169	4.34	171	4.47	174	5.19	190	5.59	200	5.80	204	6.24	213	1'-0"	1'-4"	10'-6"	5'-4"

Quantities shown below are for one headwall

RCP SIZE	LENGTH OF REINFORCING BARS																	
	SINGLE				SINGLE OR DOUBLE								DOUBLE					
	0° To 45°		0°		15°		30°		45°		0°		15°		30°		45°	
	N# 4	N# 5	N# 5	N# 5	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 5	N# 5	N# 5	N# 5	
12"	6@2'-9"	2@4'-5"	2@5'-2"	2@5'-4"	2@5'-7"	2@1'-7"	1@1'-5"	1@2'-1"	1@1'-4"	1@2'-2"	1@1'-1"	1@2'-5"	2@7'-0"	2@7'-1"	2@7'-11"	2@8'-9"		
15"	6@3'-1"	2@6'-0"	2@6'-6"	2@6'-8"	2@6'-11"	2@2'-1"	1@2'-1"	1@2'-8"	1@1'-10"	1@2'-9"	1@1'-7"	1@3'-0"	2@8'-6"	2@8'-2"	2@9'-7"	2@10'-7"		
18"	6@3'-4"	2@7'-0"	2@7'-8"	2@7'-10"	2@8'-2"	4@2'-5"	2@2'-5"	2@3'-1"	2@2'-2"	2@3'-2"	2@1'-11"	2@3'-5"	2@9'-4"	2@9'-9"	2@10'-6"	2@11'-0"		
21"	6@3'-8"	2@8'-0"	2@8'-9"	2@8'-11"	2@9'-5"	4@2'-9"	2@2'-7"	2@3'-6"	2@2'-6"	2@3'-7"	2@2'-5"	2@3'-10"	2@9'-8"	2@9'-12"	2@10'-0"	2@11'-10"		
24"	6@3'-11"	2@9'-0"	2@9'-10"	2@10'-1"	2@10'-11"	4@3'-2"	2@3'-0"	2@4'-0"	2@2'-11"	2@4'-1"	2@2'-8"	2@4'-4"	3@9'-11"	2@10'-2"	2@13'-7"	2@14'-2"		
27"	6@4'-2"	2@10'-0"	2@10'-11"	2@11'-2"	2@11'-9"	4@3'-6"	2@3'-4"	2@4'-4"	2@3'-3"	2@4'-5"	2@3'-0"	2@4'-8"	3@9'-2"	2@10'-4"	2@15'-1"	2@16'-0"		
30"	6@4'-6"	2@11'-3"	2@12'-3"	2@12'-7"	2@13'-2"	4@4'-0"	2@3'-10"	2@5'-0"	2@3'-9"	2@5'-1"	2@3'-6"	2@5'-4"	3@9'-6"	2@10'-11"	2@17'-3"	2@18'-7"		
33"	6@4'-10"	2@12'-3"	2@13'-4"	2@13'-8"	2@14'-4"	4@4'-4"	2@4'-1"	2@5'-3"	2@4'-0"	2@5'-4"	2@3'-9"	2@5'-7"	3@9'-10"	2@10'-3"	2@18'-6"	2@21'-5"		
36"	10@5'-7"	2@13'-3"	2@14'-5"	2@14'-9"	2@15'-7"	6@4'-8"	3@4'-6"	3@6'-3"	3@5'-10"	3@4'-2"	3@6'-1"	11@5'-1"	2@18'-8"	2@20'-0"	2@21'-0"	2@23'-2"		

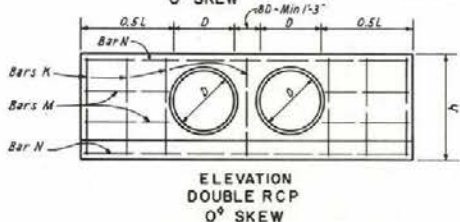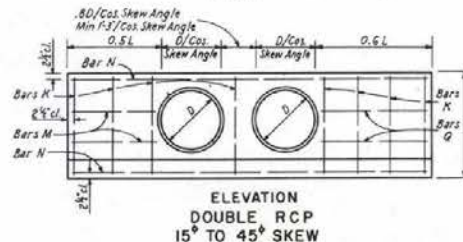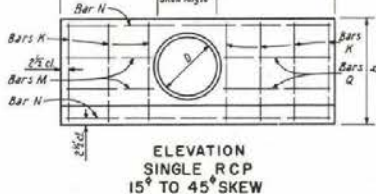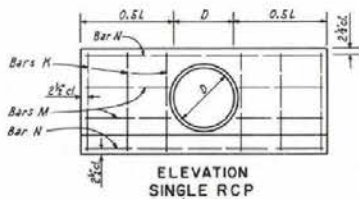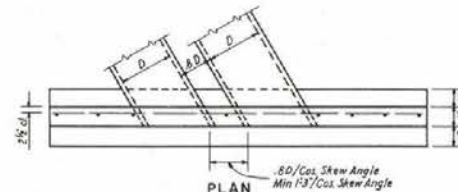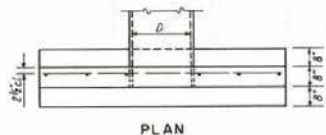

GENERAL NOTES

- Concrete shall be Class A or AA.
- Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/4" clear of surface of concrete except as noted. Bar ends shall be kept 1 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
- Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to scour.
- Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
- For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
 Culverts should be installed on 0°, 15°, 30° or 45° where it is feasible.
- Dimensions X, Y, L and h to remain constant regardless of minor variations in wall thickness due to class of pipe used.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT HEADWALLS

12' RCP TO 36' RCP

CHIEF ROAD DESIGNER
ADOPTED: 9/89 REVISION

R-2.5.1-(502)

Quantities shown below are for two headwalls

RCP SIZE D	RCP AREA SQ. FT.	SINGLE RCP								DOUBLE RCP								X	Y	L	h	RCP SIZE D
		0° SKEW		15° SKEW		30° SKEW		45° SKEW		0° SKEW		15° SKEW		30° SKEW		45° SKEW						
		CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB					
42"	9.62	6.70	5.71	6.66	6.24	6.76	6.27	6.98	6.66	6.18	6.92	6.80	7.48	9.15	7.90	9.91	8.77	1'-0 1/4"	2'-0 1/4"	12'-0"	6'-6 1/2"	42"
48"	12.57	7.41	6.88	8.10	7.45	8.21	7.81	8.46	7.92	8.88	8.29	10.12	8.89	11.07	9.95	11.96	10.30	1'-1"	2'-1"	18'-9"	7'-2"	48"
54"	15.90	9.81	9.90	10.71	10.91	10.87	10.96	11.21	11.46	13.11	12.36	14.12	13.40	14.68	13.95	15.66	15.62	1'-1 1/2"	2'-1 1/2"	15'-6"	7'-3"	54"
60"	19.64	11.29	11.37	12.32	12.44	12.50	12.50	12.66	13.32	15.08	14.07	16.25	15.37	16.88	15.96	18.25	17.74	1'-2"	2'-2"	17'-0"	8'-4"	60"
72"	28.27	15.62	18.26	17.05	20.02	17.30	20.45	17.83	21.70	20.87	22.47	22.49	24.64	23.36	25.96	25.26	28.81	1'-3"	2'-3"	20'-3"	9'-6"	72"

GENERAL NOTES


- Concrete shall be class A or A-A.
- Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/4" clear of surface of concrete except as noted. Bar ends shall be kept 1 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
- Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to seep.
- Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
- For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
- Culverts should be installed on 0°, 15°, 30°, or 45° where it is feasible.
- Dimensions X, Y, L and h to remain constant regardless of minor variations in wall thickness due to class of pipe used.

Quantities shown below are for one headwall


LENGTH OF REINFORCING BARS

RCP SIZE	SINGLE RCP																						
	0° SKEW					15° SKEW					30° SKEW					45° SKEW							
	N# 5		N# 4			N# 5		N# 4			N# 5		N# 4			N# 5		N# 4					
	F	G	M	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K
42"	12@2'9"	10@7'6"	12@5'5"	3@15'3"	10@5'8"	13@2'5"	11@7'6"	6@5'3"	6@6'6"	3@16'7"	11@5'8"	13@2'9"	11@7'6"	6@5'1"	6@6'6"	3@17'0"	11@5'8"	14@2'9"	12@7'6"	6@4'11"	6@6'6"	3@7'11"	12@5'8"
48"	13@2'9"	12@8'1"	12@6'3"	3@17'4"	12@6'3"	14@2'9"	13@8'1"	6@6'1"	6@7'5"	3@19'0"	13@6'3"	15@2'9"	14@8'1"	6@5'11"	6@7'5"	3@19'6"	14@6'3"	15@2'9"	14@8'1"	6@5'9"	6@7'5"	3@20'4"	14@6'3"
54"	21@3'9"	15@3'1"	16@7'5"	10@19'5"	12@6'0"	23@3'5"	18@5'1"	8@6'11"	8@8'5"	10@21'0"	13@6'0"	23@3'9"	18@5'1"	8@6'9"	8@8'5"	10@22'0"	13@6'0"	24@3'9"	15@5'1"	8@6'7"	8@8'5"	10@23'5"	14@6'0"
60"	23@3'9"	18@3'8"	16@7'9"	10@21'9"	14@7'5"	25@3'5"	20@5'8"	8@7'7"	8@9'4"	10@23'0"	15@7'5"	25@3'9"	20@5'8"	8@7'5"	8@9'4"	10@24'3"	15@7'5"	27@3'9"	22@5'8"	8@7'3"	8@9'4"	10@25'6"	16@7'5"
72"	27@4'6"	30@11'7"	20@9'11"	12@26'0"	16@8'7"	28@4'6"	33@11'7"	10@9'2"	10@11'3"	12@28'3"	18@8'7"	30@4'6"	34@11'7"	10@9'0"	10@11'3"	12@29'0"	18@8'7"	32@4'6"	37@11'7"	10@8'10"	10@11'3"	12@30'0"	19@8'7"


DOUBLE RCP																							
0° SKEW					15° SKEW					30° SKEW					45° SKEW								
N# 5		N# 4			N# 5		N# 4			N# 5		N# 4			N# 5		N# 4						
F	G	M	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K	
42"	16@2'9"	11@7'6"	12@5'5"	3@15'3"	11@5'8"	17@2'9"	12@7'6"	6@5'3"	6@6'6"	3@23'1"	12@5'8"	18@2'9"	13@7'6"	6@5'1"	6@6'6"	3@24'3"	13@5'8"	20@2'9"	15@7'6"	6@4'11"	6@6'6"	3@26'10"	15@5'8"
48"	18@2'9"	13@8'1"	12@6'3"	3@24'3"	13@6'3"	19@2'9"	14@8'1"	6@6'1"	6@7'5"	3@26'6"	14@6'3"	20@2'9"	15@8'1"	6@5'11"	6@7'5"	3@27'0"	15@6'3"	22@2'9"	17@8'1"	6@5'9"	6@7'5"	3@30'9"	17@6'3"
54"	25@3'9"	19@3'1"	16@7'5"	10@27'0"	14@6'0"	31@3'9"	21@5'1"	8@6'11"	8@8'5"	10@29'0"	15@6'0"	32@3'9"	22@5'1"	8@6'9"	8@8'5"	10@31'4"	16@6'0"	36@3'9"	26@5'1"	8@6'7"	8@8'5"	10@34'8"	18@6'0"
60"	36@3'9"	21@9'8"	16@7'9"	10@30'9"	14@7'5"	35@3'9"	24@5'8"	8@7'7"	8@9'4"	10@33'0"	16@7'5"	36@3'9"	25@5'8"	8@7'5"	8@9'4"	10@34'8"	17@7'5"	40@3'9"	28@5'8"	8@7'3"	8@9'4"	10@38'3"	19@7'5"
72"	37@4'6"	35@11'7"	20@9'11"	12@36'10"	19@8'7"	40@4'6"	39@11'7"	10@9'2"	10@11'3"	12@39'5"	21@8'7"	42@4'6"	42@11'7"	10@9'0"	10@11'3"	12@41'5"	22@8'7"	40@4'6"	48@11'7"	10@8'10"	10@11'3"	12@45'10"	25@8'7"

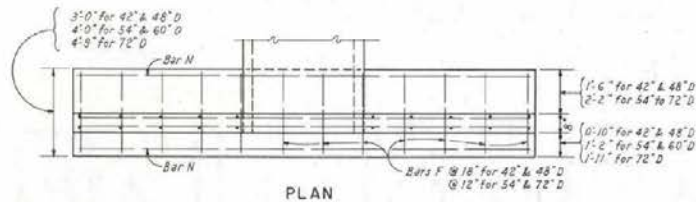

PLAN

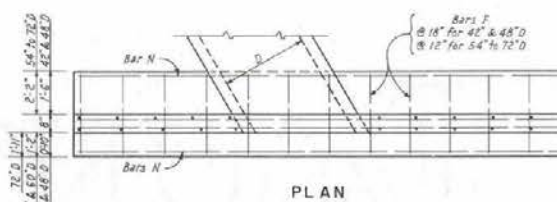


PLAN

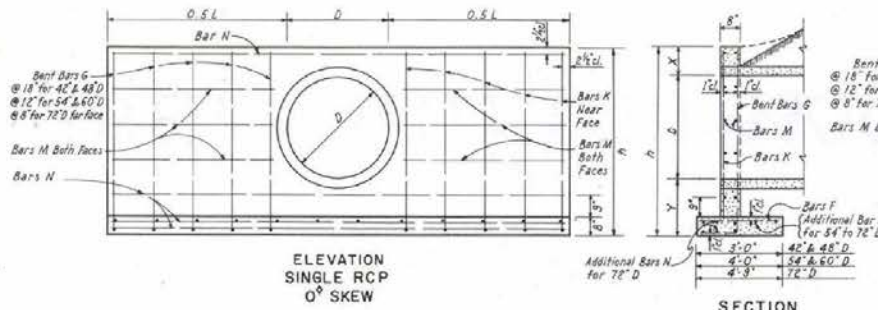


ELEVATION SINGLE RCP 0° SKEW

SECTION

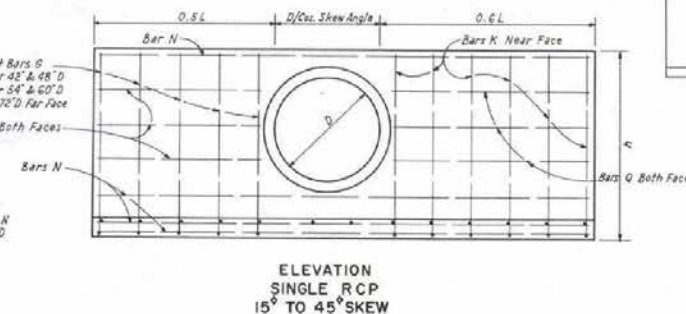

ELEVATION SINGLE RCP 15° TO 45° SKEW

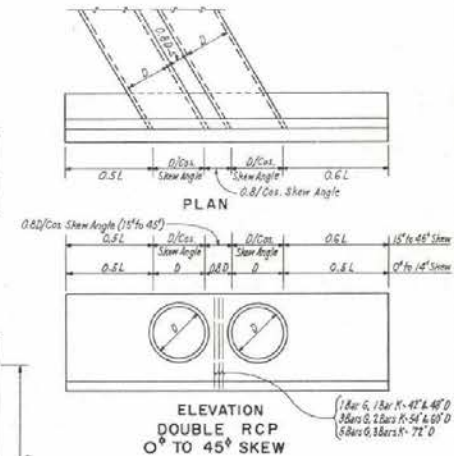

ELEVATION DOUBLE RCP 0° TO 45° SKEW

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT HEADWALLS
42" RCP TO 72" RCP


William L. Hoyle
CHIEF ROAD DESIGN ENGR
R-2.5.2-(502)
ADOPTED: 8/69
REVISION

CMAF SIZE X X X	CMAF DIA.	CMAF AREA SQ. FT.	SINGLE CMAF										DOUBLE CMAF									
			0° SKEW		15° SKEW		30° SKEW		45° SKEW		0° SKEW		15° SKEW		30° SKEW		45° SKEW					
			CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.	CONC. CU. YD.	STEEL LB.				
17" X 13"	13"	1.1	0.87	32	0.88	37	0.87	38	1.03	29	1.30	48	1.38	51	1.48	23	1.86	37				
21" X 15"	15"	1.6	1.05	40	1.13	47	1.17	53	1.25	45	1.54	55	1.64	58	1.76	40	1.86	63				
24" X 18"	18"	2.3	1.47	50	1.53	54	1.58	55	1.87	32	1.99	66	2.13	69	2.24	72	2.52	78				
28" X 20"	20"	3.8	2.07	59	1.86	63	1.88	66	1.79	44	2.13	77	2.29	81	2.42	84	2.87	90				
33" X 24"	24"	5.4	2.92	70	2.09	74	2.13	75	2.28	76	2.67	91	2.86	95	3.00	99	3.32	106				
43" X 29"	29"	6.6	3.53	81	2.70	102	2.18	108	1.84	117	3.41	126	3.66	132	3.84	136	4.26	145				
48" X 33"	33"	8.5	4.33	92	2.99	114	3.25	122	2.52	127	4.10	145	4.39	150	4.61	155	5.08	165				
57" X 38"	38"	11.4	5.94	107	3.49	130	4.00	137	4.10	160	4.33	163	5.03	182	5.29	173	5.49	189				
66" X 43"	43"	15.3	7.97	122	4.27	138	4.53	146	4.21	172	5.82	199	6.24	208	6.52	215	7.11	228				
75" X 47"	47"	19.3	11.26	137	5.20	155	5.37	164	5.25	206	6.66	231	7.14	242	7.49	249	8.25	263				
87" X 52"	52"	25.2	13.76	153	6.33	173	6.48	182	6.32	233	8.35	262	8.68	275	8.89	285	9.74	302				
97" X 57"	57"	32.0	17.60	169	7.61	194	7.73	203	7.72	267	9.44	294	9.87	308	10.00	313	10.98	331				

CMAF SIZE X X X	LENGTH OF REINFORCING BARS																		
	SINGLE CMAF						SINGLE OR DOUBLE CMAF						DOUBLE CMAF						
	0° - 45°	0°	15°	30°	45°	0°	15°	30°	45°	0° - 45°	0°	15°	30°	45°	0° - 45°	0°	15°	30°	45°
17" X 13"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
21" X 15"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
24" X 18"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
28" X 20"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
33" X 24"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
43" X 29"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
48" X 33"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
57" X 38"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
66" X 43"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
75" X 47"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
87" X 52"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0
97" X 57"	4.0	2.4	2.0	4.1	2.0	3.7	2.0	3.4	2.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0	1.2	1.0

GENERAL NOTES

- Concrete shall be class A or AA.
 - Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/4" clear of surface of concrete except as noted. Bar ends shall be kept 1 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
 - Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to scour.
 - Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
 - For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
- Culverts should be installed on 0°, 15°, 30° or 45° where it is feasible.

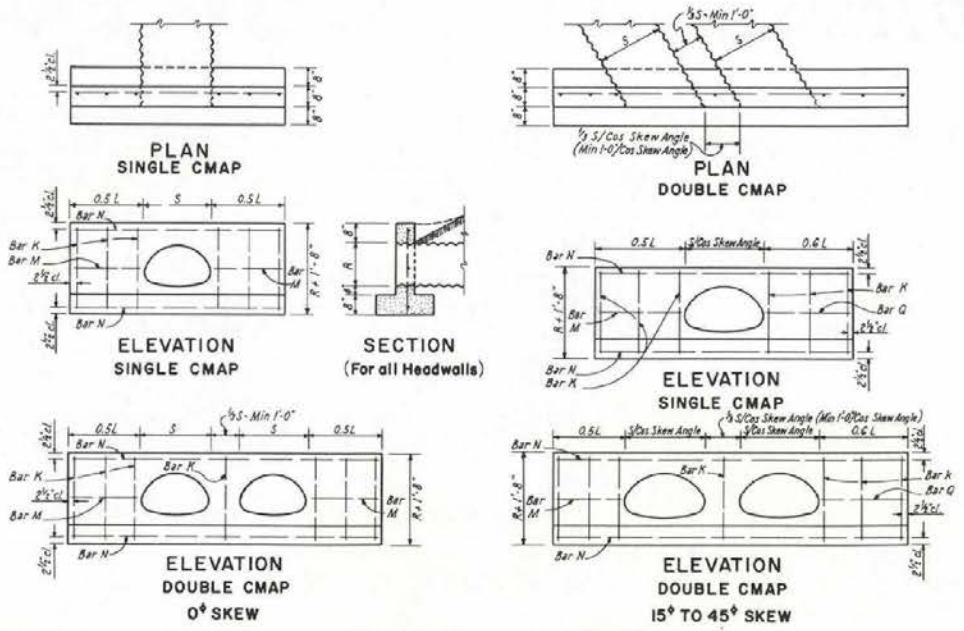

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT HEADWALLS
17" X 13" CMAF TO 83" X 57" CMAF

R-2.6.1. (602)
ADOPTED 8/69 REVISION

Quantities shown below are for two headwalls


OVAL RCP SIZE W & H	RCP SIZE	OVAL RCP AREA SQ FT	SINGLE OVAL RCP										DOUBLE OVAL RCP										X	Y	L	h
			0° SKEW		15° SKEW		30° SKEW		45° SKEW		0° SKEW		15° SKEW		30° SKEW		45° SKEW									
			CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB								
23"x14"	18"	1.82	1.37	57	1.45	60	1.52	61	1.60	63	1.94	74	2.08	77	2.18	80	2.40	86	10'4"	12'6"	4'9"	3'3/2"				
30"x19"	24"	3.21	1.95	79	2.13	82	2.17	83	2.27	86	2.64	98	2.85	103	2.97	106	3.25	113	11'9"	13'9"	6'3"	3'9/2"				
34"x22"	27"	4.20	2.30	87	2.50	92	2.55	93	2.66	96	3.11	110	3.34	116	3.49	119	3.81	127	11'9"	13'9"	7'0"	4'1"				
38"x24"	30"	5.15	2.57	93	2.79	99	2.85	100	2.98	104	3.49	119	3.75	125	4.07	129	4.28	137	11'9"	13'9"	7'6"	4'3/2"				
42"x27"	33"	6.38	2.94	113	3.20	120	3.26	121	3.40	125	4.00	141	4.30	148	4.49	153	4.91	162	11'9"	13'9"	8'3"	4'6'1/2"				
45"x28"	36"	7.37	3.31	122	3.53	128	3.58	130	3.82	134	4.48	152	4.81	159	5.04	164	5.47	174	11'9"	13'9"	9'0"	4'10"				
53"x34"	42"	10.15	4.06	164	4.42	173	4.50	175	4.68	180	5.48	199	5.90	209	6.14	214	6.65	226	11'9"	13'9"	10'3"	5'4"				
60"x38"	48"	12.86	4.81	182	5.24	192	5.33	194	5.54	199	6.49	221	6.98	231	7.26	238	7.90	251	11'9"	13'9"	11'6"	5'9"				

GENERAL NOTES


- Concrete shall be class A or AA.
- Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/2" clear of surface of concrete except as noted. Bar ends shall be kept 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
- Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to scour.
- Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
- Dimension X, Y, L and h to remain constant regardless of minor variations in wall thickness due to class of pipe used.
- For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
 Culverts should be installed on 0°, 15°, 30° or 45° where it is feasible.

Quantities shown below are for one headwall


OVAL RCP SIZE W & H	LENGTH OF REINFORCING BARS																			
	SINGLE OVAL RCP								DOUBLE OVAL RCP											
	SINGLE OR DOUBLE OVAL RCP																			
	0°-45°		0°		15°		30°		45°		0°-45°		0°		15°		30°		45°	
N# 4	N# 5	N# 5	N# 5	N# 5	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 4	N# 5	N# 5	N# 5	N# 5	N# 5	N# 5	
K	N	N	N	N	M	M	Q	Q	M	Q	K	N	N	N	N	N	N	N	N	
23"x14"	2@3'-1"	2@6'-5"	2@7'-0"	2@7'-8"	2@7'-8"	2@7'-11"	1@1'-3"	1@2'-6"	1@1'-6"	1@2'-7"	1@1'-5"	1@2'-10"	2@3'-1"	2@3'-7"	2@10'-10"	2@10'-10"	2@12'-2"			
30"x19"	2@3'-5"	2@6'-4"	2@7'-5"	2@8'-6"	2@10'-2"	2@7'-7"	2@2'-5"	2@3'-5"	2@2'-4"	2@3'-4"	2@2'-7"	2@3'-7"	2@3'-6"	2@12'-3"	2@13'-1"	2@13'-11"	2@15'-6"			
34"x22"	2@3'-10"	2@7'-7"	2@10'-4"	2@10'-9"	2@11'-5"	2@3'-0"	2@2'-10"	2@3'-9"	2@2'-5"	2@3'-10"	2@2'-6"	2@4'-1"	2@3'-10"	2@13'-11"	2@14'-10"	2@15'-4"	2@17'-6"			
38"x24"	2@4'-1"	2@10'-5"	2@11'-3"	2@11'-8"	2@12'-6"	2@3'-2"	2@3'-0"	2@4'-0"	2@2'-11"	2@4'-1"	2@2'-8"	2@4'-4"	2@4'-1"	2@15'-2"	2@16'-3"	2@17'-2"	2@19'-3"			
42"x27"	2@4'-4"	2@11'-6"	2@12'-5"	2@12'-11"	2@13'-9"	2@3'-7"	2@3'-5"	2@4'-6"	2@3'-6"	2@4'-9"	2@3'-3"	2@5'-0"	2@4'-4"	2@16'-10"	2@17'-11"	2@18'-0"	2@21'-3"			
45"x28"	2@4'-7"	2@12'-0"	2@13'-0"	2@13'-10"	2@14'-11"	2@3'-10"	2@3'-8"	2@4'-9"	2@3'-7"	2@4'-10"	2@3'-4"	2@5'-1"	2@4'-7"	2@18'-2"	2@19'-5"	2@20'-7"	2@23'-0"			
53"x34"	10@5'-1"	2@14'-5"	2@15'-7"	2@16'-2"	2@17'-3"	2@4'-6"	2@4'-4"	2@5'-7"	2@4'-3"	2@5'-8"	2@4'-0"	2@5'-11"	11@5'-1"	2@21'-7"	2@22'-0"	2@23'-10"	2@26'-9"			
60"x38"	10@5'-6"	2@16'-3"	2@17'-7"	2@18'-2"	2@19'-3"	2@5'-1"	2@4'-11"	2@6'-3"	2@4'-10"	2@6'-4"	2@4'-7"	2@6'-7"	11@5'-6"	2@23'-9"	2@25'-5"	2@26'-10"	2@30'-2"			

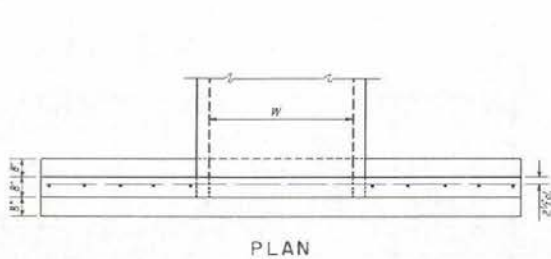



PLAN
ELEVATION SINGLE OVAL RCP 0° SKEW

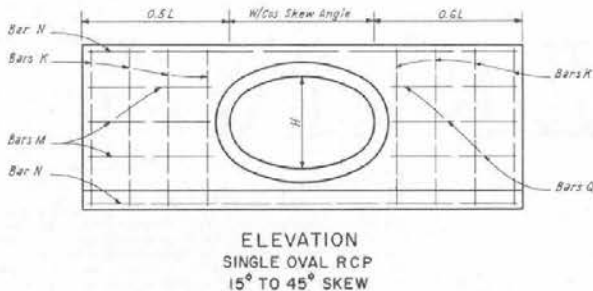

ELEVATION SINGLE OVAL RCP 15° TO 45° SKEW

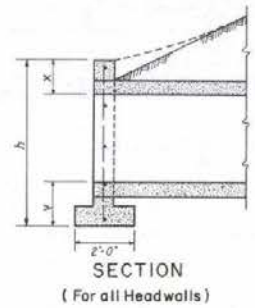

SECTION (For all Headwalls)

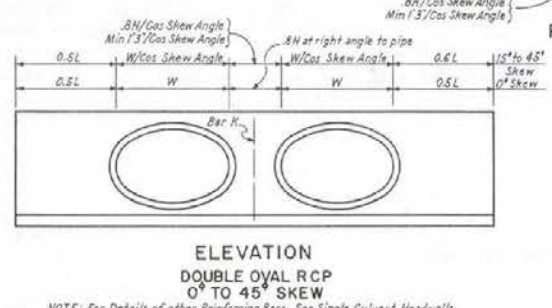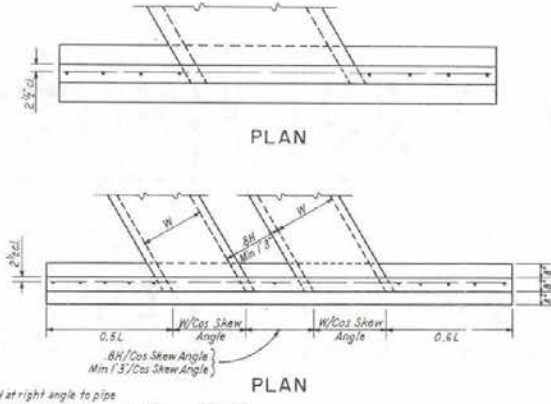

ELEVATION DOUBLE OVAL RCP 0° TO 45° SKEW

NOTE: For Details of other Reinforcing Bars, See Single Culvert Headwalls

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT HEADWALLS
23"x14" OVAL RCP TO
60"x38" OVAL RCP

William L. Magall
CHIEF ROAD DESIGN ENGR.

R-271-(502)
ADOPTED: 8/69 REVISION

Quantities shown below are for two headwalls








OVAL RCP SIZE W & H	RCP SIZE	OVAL RCP AREA SQ FT	SINGLE OVAL RCP								DOUBLE OVAL RCP								X	Y	L	h
			0° SKEW		15° SKEW		30° SKEW		45° SKEW		0° SKEW		15° SKEW		30° SKEW		45° SKEW					
			CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB	CONC CU YD	STEEL LB				
68"x43"	54"	16.62	7.19	628	7.82	683	7.98	720	8.34	767	8.86	789	10.58	848	12.07	897	12.11	1031	142 1/2"	252"	1259"	65 1/2"
76"x48"	60"	20.55	8.39	744	9.13	805	9.32	873	9.71	889	11.47	921	12.31	985	13.06	1075	15.66	1207	142 1/2"	242 1/2"	1418"	75 1/2"
91"x58"	72"	23.71	12.11	1168	13.18	1273	13.43	1321	14.02	1412	16.59	1495	17.82	1616	18.61	1730	20.36	1965	173 1/2"	293 1/2"	1710"	85 1/2"

GENERAL NOTES

- Concrete shall be class A or AA.
 - Reinforcing steel shall be deformed bars with maximum spacing of 18" set 2 1/2" clear of surface of concrete except as noted. Bar ends shall be kept 1/2" clear of surface of concrete. Reinforcing bars may be cut and bent in field.
 - Footings shown are of minimum depth and shall be extended if soil is unsuitable or liable to scour.
 - Culvert pipes to be set on a skew shall be mitered when headwalls are constructed. When headwalls are not constructed the pipes shall not be mitered except in overflow section.
 - Dimensions X, Y, L and h to remain constant regardless of minor variations in wall thickness due to class of pipe used.
 - For estimating headwall quantities on skewed culverts:
 - 0° to 10° - Use quantities for 0° skew.
 - 11° to 25° - Use quantities for 15° skew.
 - 26° to 40° - Use quantities for 30° skew.
 - 41° to 55° - Use quantities for 45° skew.
 - Over 55° - Calculate quantities required.
- Culverts should be installed on 0°, 15°, 30° or 45° where it is feasible.

Quantities shown below are for one headwall

OVAL RCP SIZE W & H	LENGTH OF REINFORCING BARS																						
	SINGLE OVAL RCP																						
	0° SKEW					15° SKEW					30° SKEW					45° SKEW							
	N° 5		N° 4			N° 5		N° 4			N° 5		N° 4			N° 5		N° 4					
F	G	M	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K	F	G	M	Q	N	K	
68" x 43"	13@2'-3"	10@7'-10"	12@5'-8"	3@18'-2"	10@6'-0"	14@2'-5"	12@7'-10"	6@5'-6"	6@6'-10"	3@19'-8"	11@6'-0"	15@2'-9"	12@7'-10"	6@5'-4"	6@6'-10"	3@20'-4"	12@6'-0"	16@2'-9"	13@7'-10"	6@5'-2"	6@6'-10"	3@21'-10"	13@6'-0"
76" x 48"	15@2'-5"	12@6'-4"	12@6'-4"	3@20'-4"	12@6'-5"	16@2'-5"	13@6'-4"	6@6'-2"	6@7'-7"	3@22'-0"	13@6'-6"	16@2'-9"	13@6'-4"	6@6'-0"	6@7'-7"	3@22'-9"	13@6'-6"	17@2'-9"	15@6'-4"	6@5'-10"	6@7'-7"	3@24'-5"	15@6'-6"
91" x 58"	25@3'-5"	18@8'-8"	16@7'-7"	10@20'-4"	12@7'-6"	27@3'-5"	20@8'-8"	8@7'-5"	8@9'-1"	10@26'-4"	13@7'-6"	28@3'-9"	21@8'-8"	8@7'-5"	8@9'-1"	10@27'-9"	14@7'-6"	30@3'-9"	23@9'-8"	8@7'-1"	8@9'-1"	10@29'-2"	15@7'-6"
68" x 43"	15@2'-5"	11@7'-10"	12@6'-4"	3@22'-8"	11@6'-0"	20@2'-5"	12@7'-10"	6@5'-6"	6@6'-10"	3@26'-6"	12@6'-0"	21@2'-5"	13@7'-10"	6@5'-4"	6@6'-11"	3@30'-2"	13@6'-0"	24@2'-3"	16@7'-10"	6@5'-2"	6@6'-10"	3@33'-0"	16@6'-0"
76" x 48"	21@2'-5"	13@8'-4"	12@6'-4"	3@25'-10"	13@6'-6"	22@2'-5"	14@8'-4"	6@6'-2"	6@7'-7"	3@31'-0"	14@6'-6"	24@2'-9"	16@8'-4"	6@6'-0"	6@7'-7"	3@34'-2"	15@6'-6"	26@2'-3"	19@8'-4"	6@5'-10"	6@7'-7"	3@37'-10"	19@6'-6"
91" x 58"	37@3'-5"	21@9'-5"	18@7'-7"	10@35'-5"	14@7'-6"	33@3'-5"	23@9'-8"	8@7'-5"	8@9'-1"	10@38'-2"	16@7'-6"	41@3'-9"	26@8'-8"	8@7'-5"	8@9'-1"	10@40'-5"	17@7'-6"	46@3'-9"	31@9'-8"	8@7'-1"	8@9'-1"	10@45'-4"	20@7'-6"

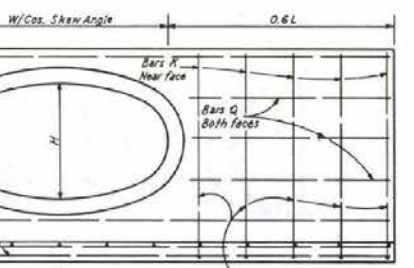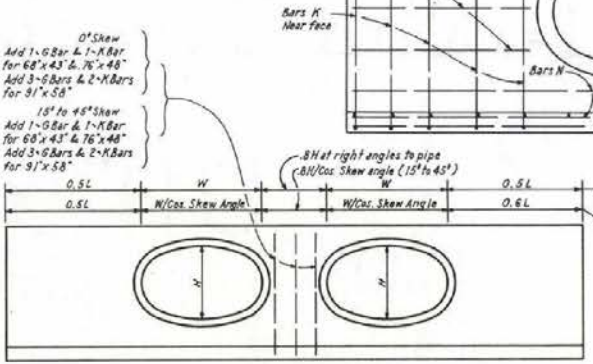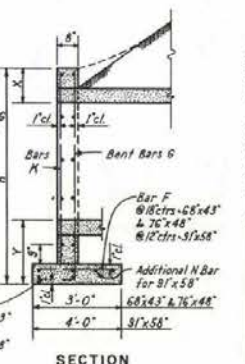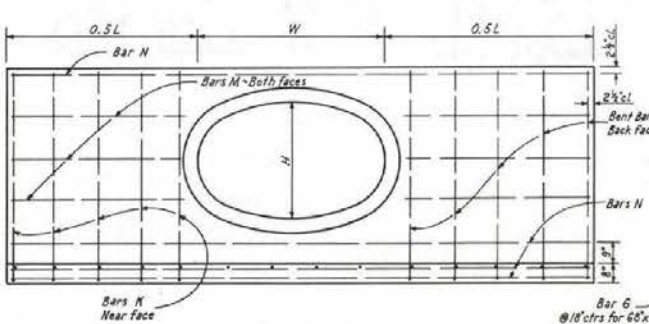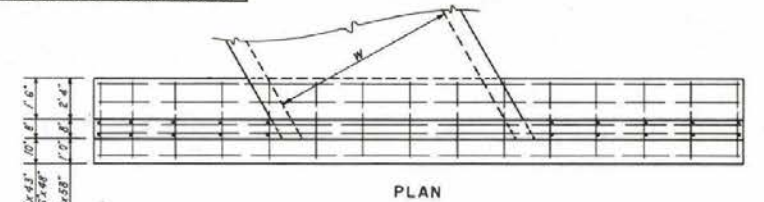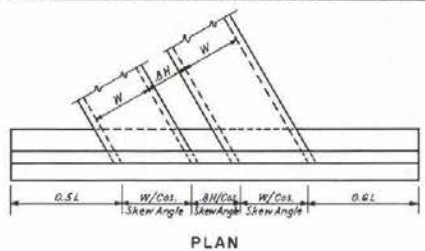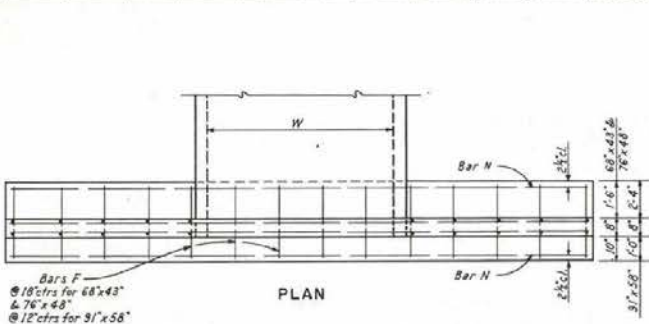

ELEVATION SINGLE OVAL RCP 15° TO 45° SKEW


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CULVERT HEADWALLS
68" X 43" OVAL RCP TO
91" X 58" OVAL RCP


William L. Dugan
CHIEF ROAD DESIGN ENGINEER

R-2.7.2-(502)
ADOPTED: 8/69 REVISION


NOTE: For Details of other Reinforcing Bars, See Single Culvert Headwalls

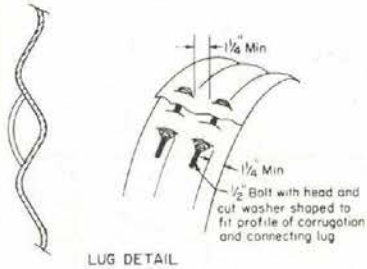



LUG DETAIL



12" HELICALLY CORRUGATED BAND WITH INTEGRAL FORMED CONNECTING LUG FOR USE ON 12"-24" H.C.M.P.




DETAIL "A"
NOTE: For H.C.M.P. Overside Drains and Slotted Drains

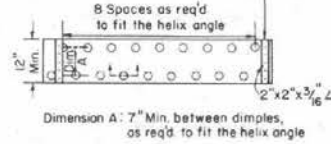


SECTION THRU DIMPLES

UNIVERSAL COUPLING BAND FOR USE ON C.M.P. THRU 36" INCLUSIVE




TOP VIEW

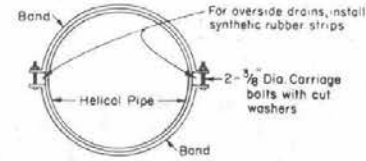


END VIEW

TWO PIECE INTEGRAL FLANGE DIE FORMED FOR USE ON 6", 8" & 10" H.C.M.P.

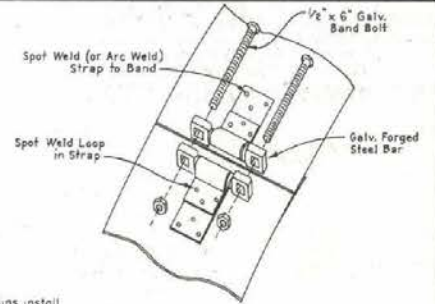


BAR & STRAP CONNECTOR

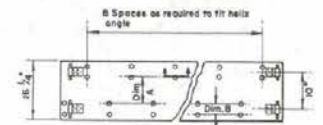


Dimension A as required to fit helix angle, 7" Min. Dimension B as required to fit helix angle, 2 1/2" Min. One piece band optional on 42" diameter. Two piece band required above 42" diameter.

UNIVERSAL COUPLING BAND FOR USE ON C.S.P. 42" THRU 60" INCLUSIVE

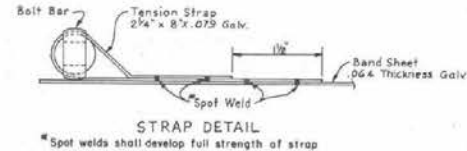

STRAP DETAIL

Spot welds shall develop full strength of strap



FRONT VIEW

LEFT SIDE VIEW

BAR DETAIL

GENERAL NOTES

- All coupling band connecting hardware shall be galvanized.
- For helically corrugated coupling bands, the connection angles may be oriented parallel to the pipe axis, provided connecting nuts are slotted lengthwise sufficiently to allow adjustment for the helix angle.
- For pipe arches use same width band as for round pipe of equal diameter.
- For watertight and siphon joints on alternating annular coupling band place elastic sealant strip 1/2 inch x 1/2 inch x 8' long in lap between bands.
- For alternative annular coupling band, 2 bar and strap assemblies required for pipe greater than 42" diameter, optional for sizes less than 42".


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

COUPLING BAND DETAILS
C.M.P. AND PIPE ARCHES


William J. Neal
CHIEF ROAD DESIGNER

R-2.81-(604)
ADOPTED: 6/71 REVISION


7" WIDE COUPLING BAND WITH INTEGRAL FORMED CONNECTING LUGS FOR USE ON C.M.P. THRU 30" INCLUSIVE





ANNULAR COUPLING BAND



ALTERNATIVE ANNULAR COUPLING BAND FOR H.C.M.P. THRU 84"





JOINT CROSS SECTION ALTERNATIVE ANNULAR COUPLING BAND FOR HELICAL WELD SEAM ONLY




HELICAL COUPLING BAND

ANNULAR COUPLING BAND				
CORRUGATION	PIPE SIZE	W (In. Min. (Use Each Connection))	1/2" BOLTS	
2 2/3" x 1/2"	Thru 30"	7	7	2
2 2/3" x 1/2"	Thru 60"	12	12	3
2 2/3" x 1/2"	Thru 84"	24	24	5
3" x 1"	54" thru 60"	14	14	3
3" x 1"	Thru 96"	26	26	5
HELICAL COUPLING BAND				
2 2/3" x 1/2"	12" thru 60"	12	12	3
2 2/3" x 1/2"	Thru 84"	24	24	5

R 27A

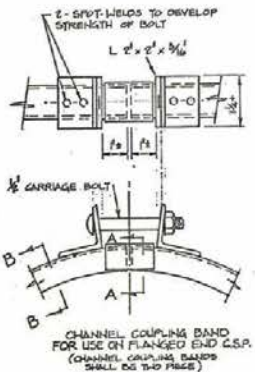

NOMINAL DIMENSIONS
 THICKNESS $\frac{3}{8}$ " FOR USE WITH C.S.P.
 0.075" $\frac{3}{8}$ " 0.101" THICK OR LIGHTER
 0.101" 1" 0.188" THICK OR HEAVIER
 SECTION A-A



C.S.P. COUPLING BAND DETAILS






CHANNEL COUPLING BAND FOR USE ON FLANGED END C.S.P., TO 30" DIAMETER (CHANNEL COUPLING BANDS SHALL BE TWO PIECE)

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

**C.S.P.
 COUPLING BAND
 DETAILS**

Robert R. Shaw
 CHIEF ROAD DESIGNER

R-282 (804)
 ADOPTED 1/76 REVISION

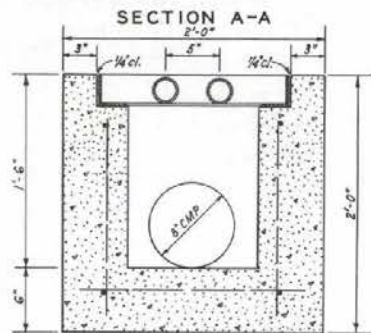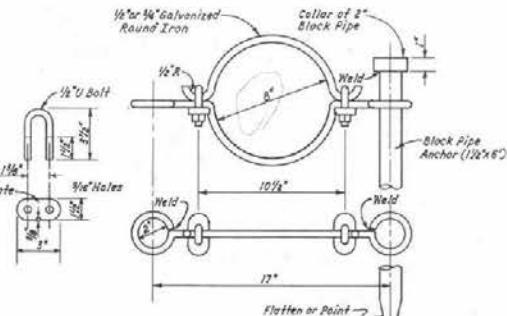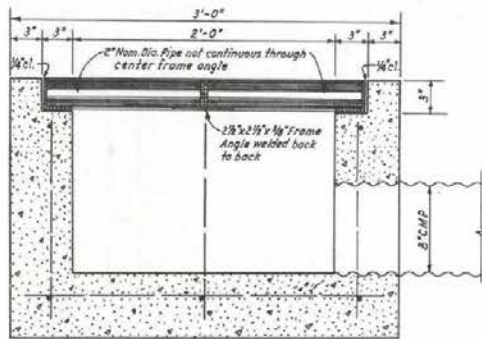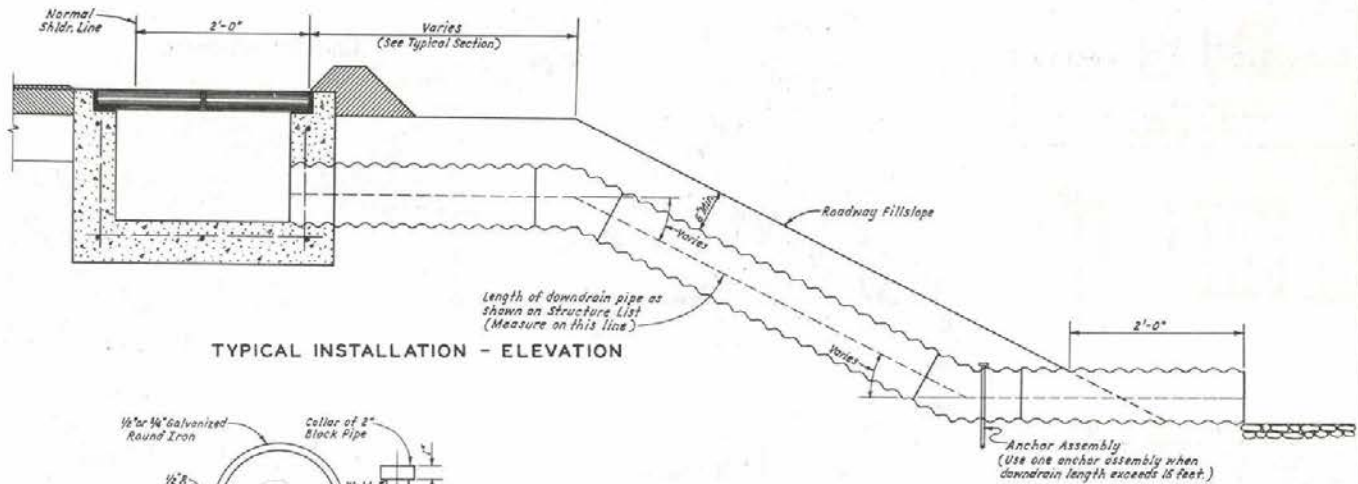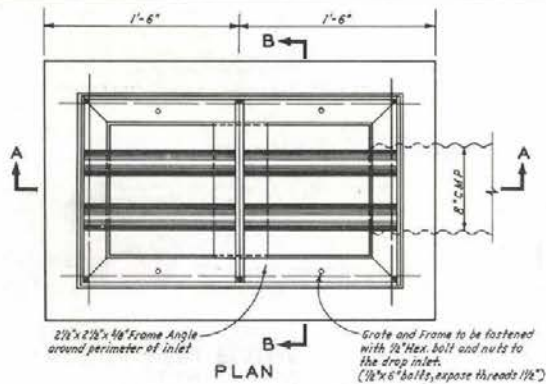

QUANTITIES*		
CONCRETE	REINF. STEEL	STRUCT. STEEL
0.27 cu yd.	17 lbs.	85 lbs.

* For information only.

GENERAL NOTES


1. All concrete shall be Class A or AA.
2. Reinforcing bars shall be #4 bars with maximum spacing of 18" centers. Bars to be embedded a minimum of two inches and bar ends must clear concrete surface by one and one half inch.
3. All exposed concrete edges shall be chamfered one inch.
4. Structural steel weight includes the 2" pipe and the 2 1/2" x 2 1/2" x 1/8" frame angles.
5. Grate and frame angle and pipes to be welded at all contact points.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


EMBANKMENT PROTECTORS
(TYPE 4)

R-3.1.2- (608)
ADOPTED: 8/69 REVISION

Walter J. Nease
CHIEF ROAD DESIGN ENGINEER

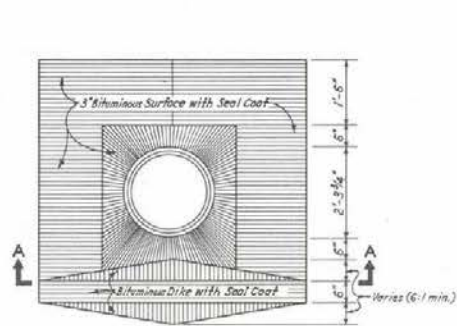


PLAN

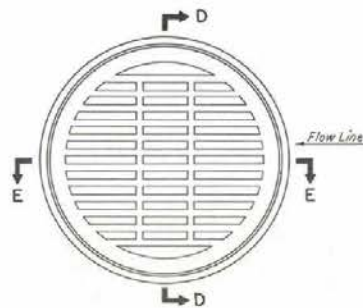


PLAN OF FRAME AND GRATE (CASTING)

WEIGHT OF CASTINGS	
Grate	128 lbs
Frame	142 lbs
Total	270 lbs

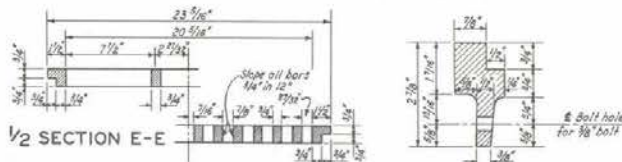


1/2 SECTION E-E 1/2 SECTION D-D SECTION OF FRAME

WEIGHT OF CASTINGS	
Grate	99 lbs
Frame	36 lbs
Total	135 lbs

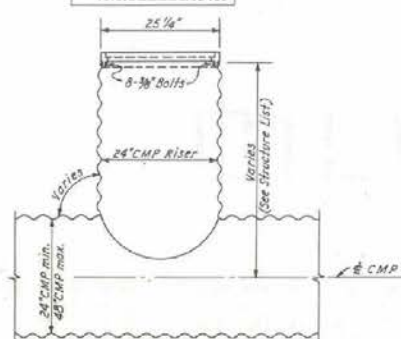


SECTION

TYPE 2 RISER INLET

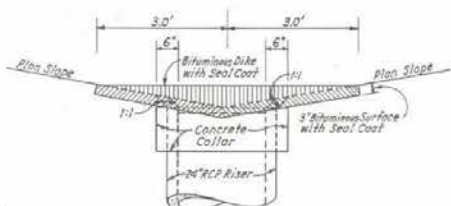


SECTION A-A (With RCP Riser)

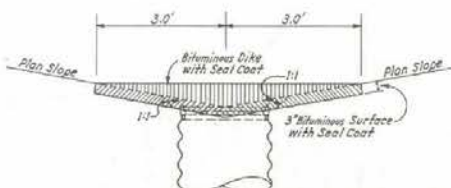

SECTION A-A (With CMP Riser)

PAVED APRON AND DIKE FOR TYPE 1 AND 2 RISER INLET

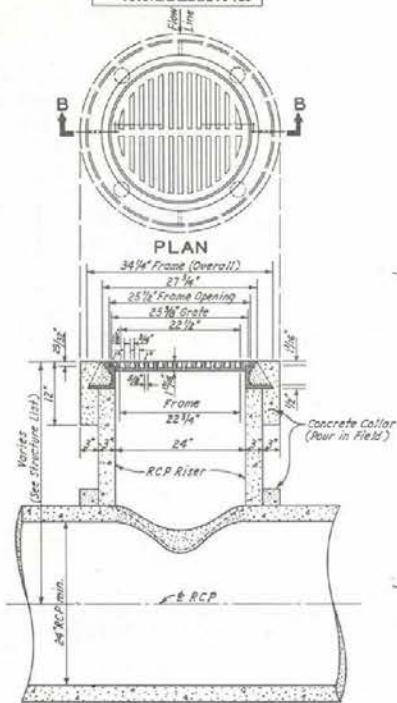


SECTION B-B

TYPE 1 RISER INLET

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

PIPE RISER INLET
(TYPE 1 & TYPE 2)

ADOPTED: 8/69 REVISION 1

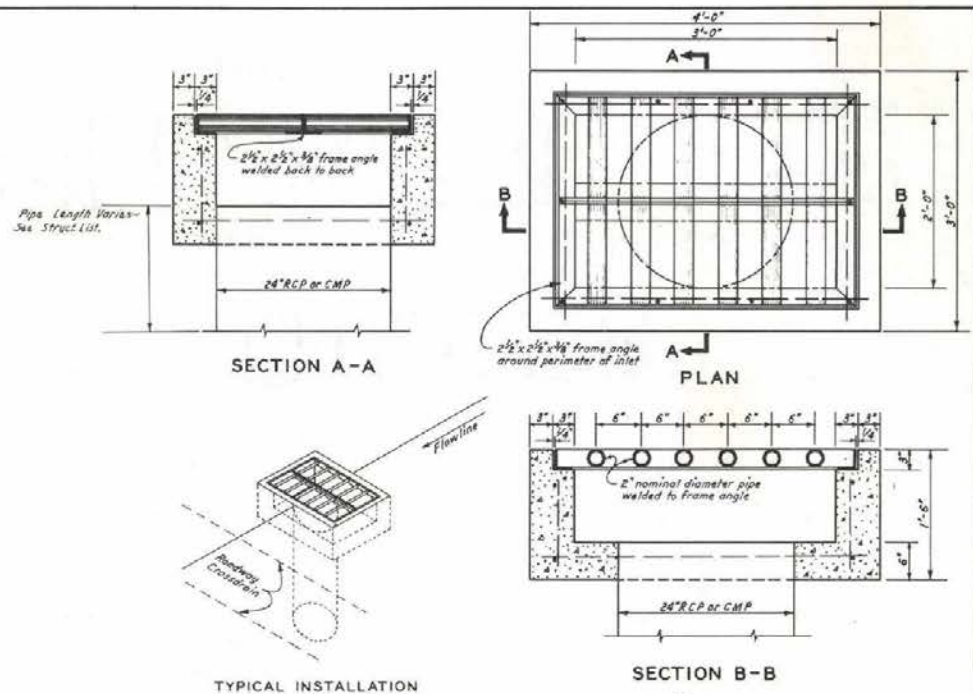

QUANTITIES*

Concrete	Reinf. Steel	Struct Steel
0.96 cu yd.	23 lbs.	170 lbs.

*For Information Only

- GENERAL NOTES
1. All concrete shall be Class A or AA.
 2. Reinforcing bars shall be #4 bars with maximum spacing of 18\" centers. Bars to be embedded a minimum of two inches and bar ends must clear concrete surfaces by one and one half inch.
 3. All exposed concrete edges shall be chamfered one inch.
 4. Structural steel weight includes the 2\" pipe and the 2 1/2 x 2 1/2 x 1/8 frame angles.





STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

PIPE RISER INLET
(TYPE 3)

R-4.1.2-(609)

ADOPTED: 8/69 REVISION 2

Chief Road Design Engr.

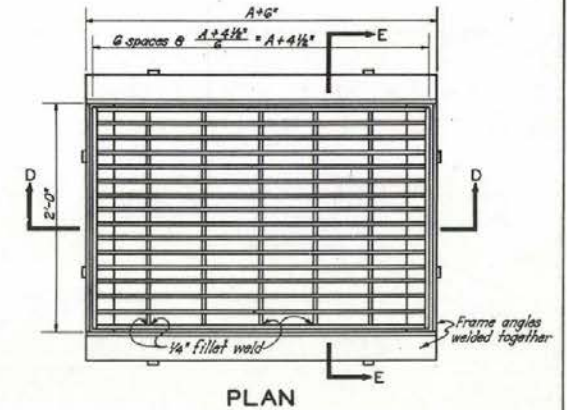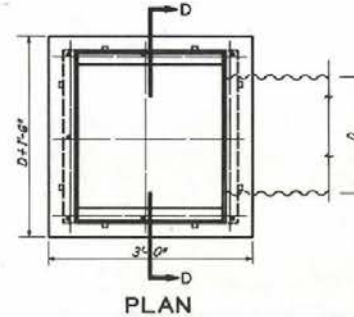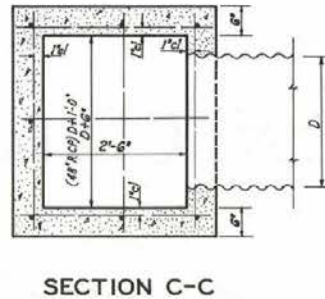
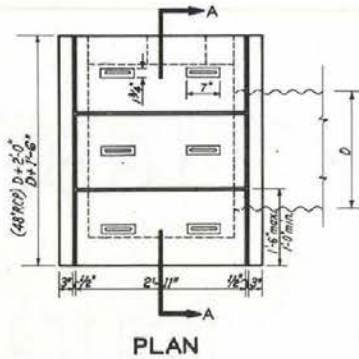


BILL OF MATERIALS

CMP Size	Concrete, cu. yd.		Reinforcing, lb.		RCP Size	Concrete, cu. yd.		Reinforcing, lb.	
	1 Opening	2 Openings	1 Opening	2 Openings		1 Opening	2 Openings	1 Opening	2 Openings
16"	0.57	0.53	57	54	16"	0.74	0.71	58	55
18"	0.76	0.73	59	57	18"	0.84	0.80	60	58
24"	0.95	0.91	70	67	24"	1.03	0.98	71	68
30"	1.14	1.11	82	79	30"	1.22	1.17	83	80
36"	1.33	1.31	88	86	36"	1.43	1.40	89	87
42"	1.57	1.53	96	94	42"	1.66	1.62	98	95
48"	1.80	1.76	100	117	48"	2.03	2.00	125	123

BILL OF MATERIALS


CMP size	Concrete cu. yd.	Reinf. lb.	A	RCP size	Concrete cu. yd.	Reinf. lb.	A	Main Bars	Frame Angles	Grate	Frame	Total
16"	0.57	57	2'-0"	16"	0.59	40	2'-0"	2 1/2"	3 1/2"	160	67	207
18"	0.77	59	2'-0"	18"	0.84	45	2'-0"	3 1/2"	3 1/2"	187	82	279
24"	0.95	70	3'-0"	24"	0.89	60	3'-0"	3 1/2"	4 1/2"	264	96	360
30"	1.14	82	3'-0"	30"	1.17	65	3'-0"	4 1/2"	4 1/2"	341	113	454
36"	1.33	88	4'-0"	36"	1.35	70	4'-0"	4 1/2"	4 1/2"	382	122	504

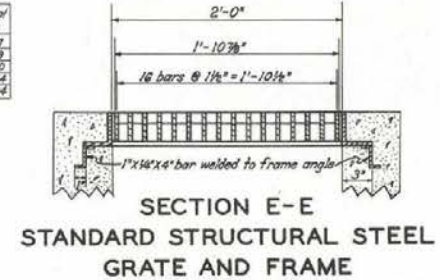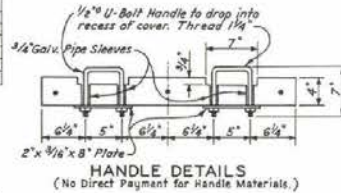


**SECTION E-E
STANDARD STRUCTURAL STEEL
GRATE AND FRAME**

GENERAL NOTES


- 1- All concrete shall be Class A or AA.
- 2- Reinforcing Steel shall be No. 4 bars with maximum space at 18" centers, wired tightly at all intersections, and embedded at least one inch clear of concrete surface.
- 3- Exposed edges of concrete shall be chamfered one inch.
- 4- Dimensions may be varied to fit local conditions if ordered by the Engineer.
- 5- Commercial prefabricated gratings approved by the Bridge Division may be used in lieu of the field-welded grating shown above.

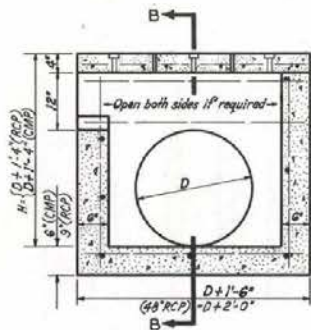

**SECTION A-A
TYPE 1 DROP INLET**

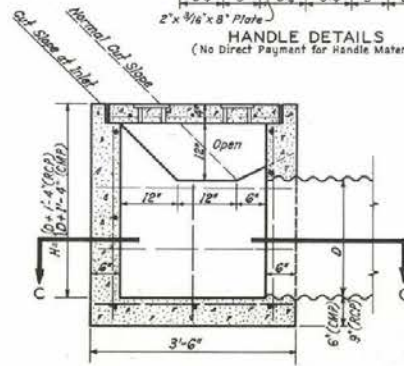

SECTION B-B



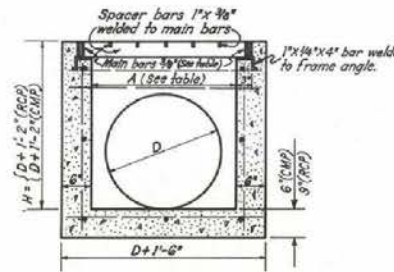


**SECTION D-D
TYPE 2 DROP INLET**

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

TYPE 1 & 2 DROP INLETS

R-4.2.1-(609)
ADOPTED: 8/59 REVISION 2

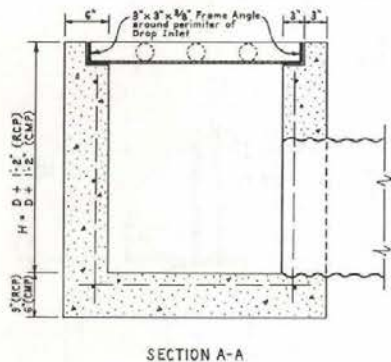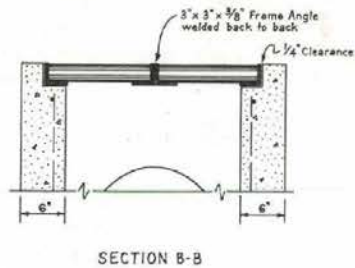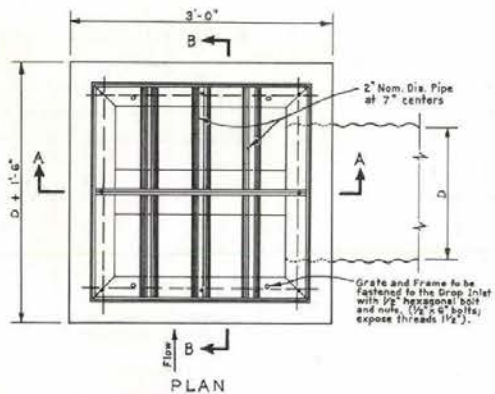

CMP Size	Concrete Cu. Yd.	Reinf. Lb.	Struct. Steel Lb.	RCP Size	Concrete Cu. Yd.	Reinf. Lb.	Struct. Steel Lb.
18"	0.62	39	120	18"	0.68	40	120
24"	0.77	44	132	24"	0.84	45	132
30"	0.93	59	145	30"	0.99	60	145
36"	1.11	64	156	36"	1.17	65	156
42"	1.29	69	170	42"	1.35	70	170

GENERAL NOTES


- All concrete shall be Class A or AA.
- Reinforcing bars shall be No. 4 bars with maximum spacing at 16" centers. Bars to be embedded a minimum of two inches and bar ends must clear concrete surfaces by one and one half inch.
- All exposed concrete edges shall be chamfered one inch.
- Structural steel weight includes the 2" pipe and the 3" x 3" x 3/8" frame angles.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


TYPE 2A DROP INLET


 CHIEF ROAD DESIGN ENGINEER


R-4.2.2-(609)
 ADOPTED: 11/70 REVISION
 1-1/75

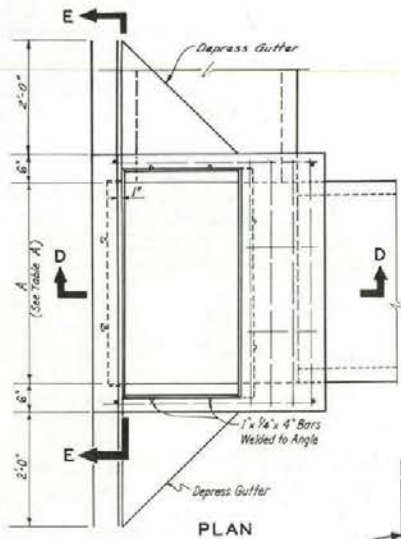


PLAN

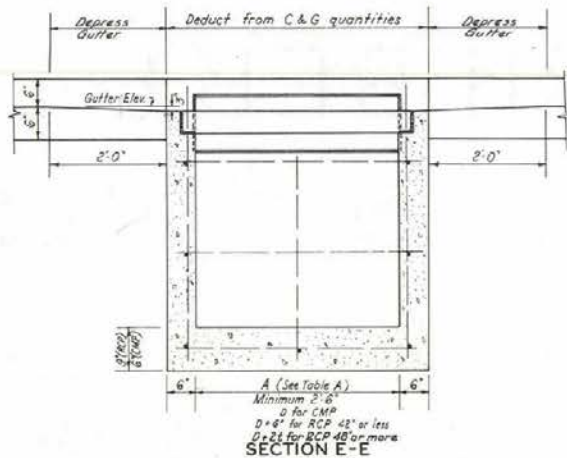


SECTION E-E

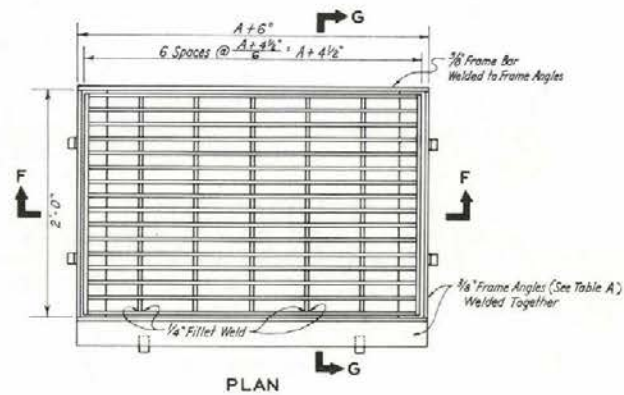

PLAN

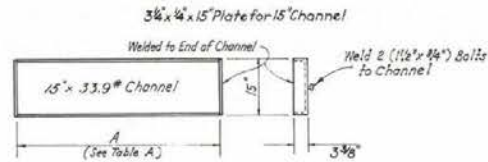


CHANNEL DETAIL



SECTION F-F

For 24" RCP

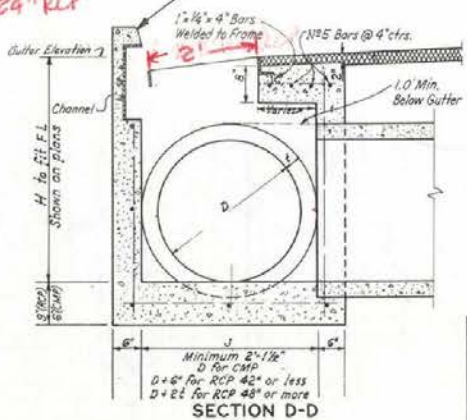


SECTION D-D

STRUCTURAL STEEL (TABLE A)


PIPE SIZE	A	MAIN BARS	FRAME ANGLES	FRAME BAR	GRATE LBS	FRAME LBS	CHANNEL & PLATES LBS	TOTAL LBS
CMP 30"	2'-6"	2" x 3/8"	3 1/2" x 3/8"	3 1/2" x 3/8"	199	67	107	373
RCP 30"	3'-0"	3" x 3/8"	4" x 3/8"	4" x 3/8"	265	79	123	467
CMP 36"	3'-0"	2" x 3/8"	4" x 3/8"	4" x 3/8"	326	96	141	563
RCP 36"	3'-6"	3" x 3/8"	5" x 3/8"	5" x 3/8"	397	103	150	650
CMP 42"	4'-0"	3" x 3/8"	5" x 3/8"	5" x 3/8"	473	119	175	767
RCP 42"	4'-6"	4" x 3/8"	6" x 3/8"	6" x 3/8"	575	137	202	914

TABLE B

MAXIMUM H	J or A	H
30" or less	21'-0"	
36"	18'-0"	
42"	12'-0"	
48"	9'-0"	
54"	7'-0"	
60"	7'-0"	(With 4 bars @ 12" centers)



SECTION 8' CONCRETE GUTTER

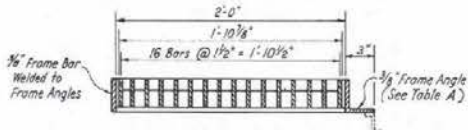

SECTION G-G

GRATE AND FRAME DETAIL

GENERAL NOTES

- All concrete shall be Class A or AA.
- All reinforcing steel shall be tightly wired and embedded 1" clear of concrete surface. Except as noted, all reinforcing steel shall be #4 bars with maximum space at 18" centers, for all values of H to the maximum as shown in table B. If H exceeds these maximums, drop inlet will require special design.
- Exposed edges of concrete shall be chamfered one inch.
- Where pipe intersects drop inlet on a 12° or larger skew increase J to $\frac{1}{\cos \text{skew}}$. Redesign for skews at A.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


TYPE 3 DROP INLET

R-4.31-(609)


ADOPTED: 8/69 REVISION: 2/99

Robert L. Mack
CHIEF ROAD DESIGN ENGR.


Woody Healy & Kelly's Brother

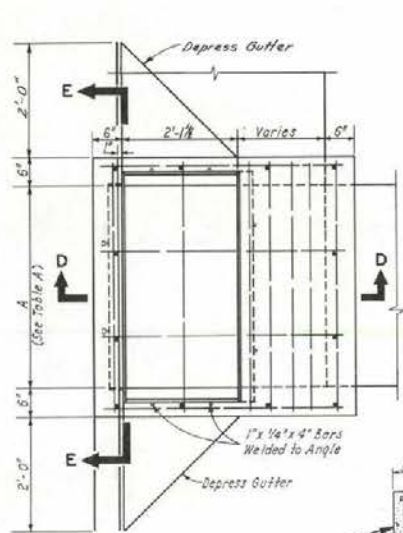


PLAN

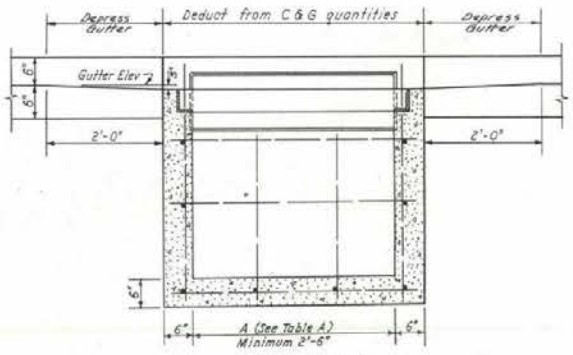


SECTION E-E

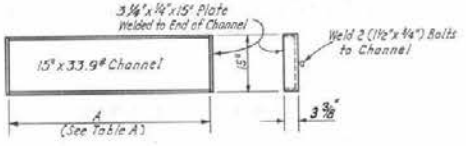


CHANNEL DETAIL

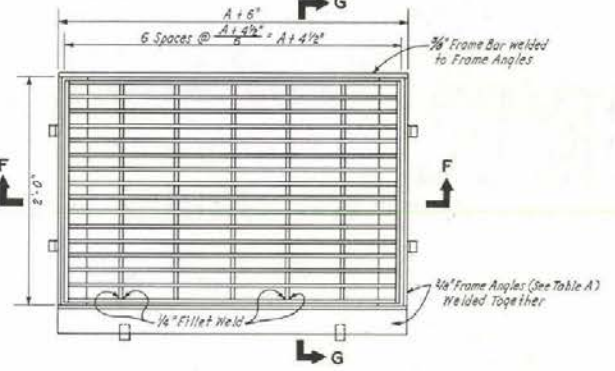


PLAN



SECTION F-F

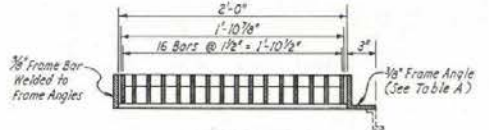

SECTION G-G
GRATE AND FRAME DETAIL

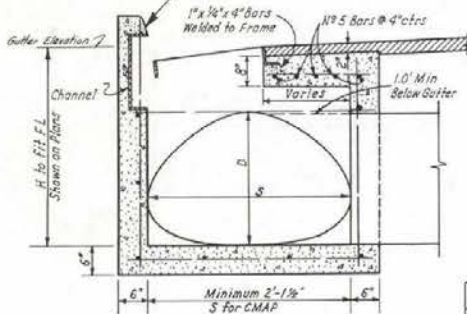


SECTION D-D

STRUCTURAL STEEL (TABLE A)

PIPE SIZE C MAP	A	MAIN BARS	FRAME ANGLES	FRAME BAR	GRATE LBS	FRAME LBS	CHANNEL & PLATES, LBS	TOTAL LBS
29"x18" or Less	2'-6"	3"x4"	3 1/2"x3 1/2"	3 1/2"x3 1/2"	199	67	107	373
36"x22"	3'-0"	3 1/2"x4"	4"x3 1/2"	4"x3 1/2"	265	79	123	467
43"x27"	3'-6"	4"x4"	4 1/2"x3 1/2"	4 1/2"x3 1/2"	346	96	141	583

TABLE B

MAXIMUM H	C MAP SIZE	H
29"x18" or Less	21'-0"	16'-0"
36"x22"	16'-0"	12'-0"
43"x27"	12'-0"	

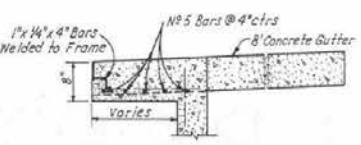

SECTION
8' CONCRETE GUTTER


GENERAL NOTES

1. All concrete shall be Class A or AA.
2. Exposed edges of concrete shall be chamfered one inch.
3. All reinforcing steel shall be tightly wired and embedded 1/2" clear of concrete surface. Except as noted, all reinforcing steel shall be N# 4 bars with maximum space of 18" centers.
4. If H exceeds maximum shown on Table B, drop inlet will require special design.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

TYPE 3A DROP INLET


R-4.4.1-(609)
ADOPTED: 6/89 REVISION: 2/99

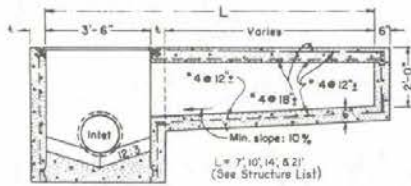

SECTION A-A




SECTION B-B

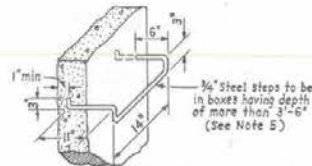


STEP DETAIL




CURB SUPPORT DETAILS

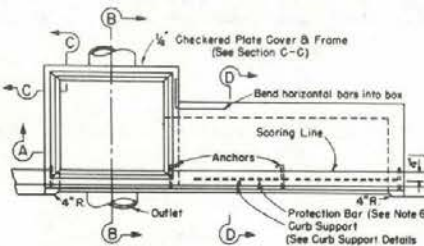


PLAN



SECTION D-D



ALTERNATIVE REINFORCED BOTTOM

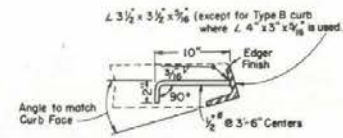


FACE ANGLE ANCHOR DETAIL


GENERAL NOTES

- "H" is the difference in elevation between the outlet pipe flow line and the normal gutter grade line undepressed at the curb face.
- For "t" wall thickness see Table.
- Height of curb opening will vary with the type of curb and the depth of the local depression.
- Reinforcing steel in walls shall be #4 bars @ 18" centers placed 1 1/2" clear to inside of box unless otherwise shown.
- Steps - None required where "H" is 3'-6" or less. Install one step 16" above floor when "H" is more than 3'-6" and less than 5'-0". Where "H" is more than 5'-0", steps shall be evenly spaced @ 12" intervals from 16" above floor to within 12" of the top of the box. Place steps in wall without pipe openings.
- When shown on the details, Place 0"6 protection bar horizontally across the entire length of the opening and bend back 4" into the inlet wall on each side.
- Curb openings longer than 7' shall have one curb support for each 7' increment or fraction thereof, evenly spaced.
- Pipe(s) can be placed in any wall.
- Curb section shall match adjacent curb.
- Except for inlets used as junction boxes, basin floors shall have a minimum slope of 1:2:3 from all directions toward outlet pipe and shall have a wood trowel finish.
- Galvanizing - See Standard Specifications or Special Provisions.
- Commercial prefabricated gratings approved by the Engineer may be used in lieu of those shown.


Length of Curb Opening	No of Anchors
3'-0" or Less	2
3'-6" or less	2
7'-0"	3
10'-0"	4
14'-0"	5
21'-0"	7




SECTION E-E

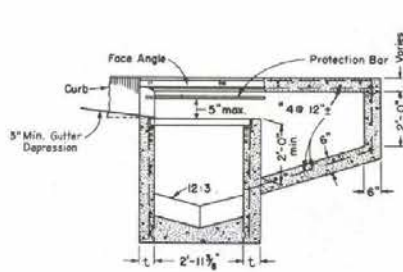


SECTION F-F

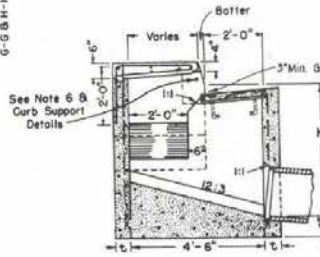


SECTION G-G




PLAN



FRAME




SECTION





LONGITUDINAL SECTION

FRAME AND GRATE DETAILS


Weight of frame and grate ~ 371 Lbs.




SECTION H-H



SECTION C-C

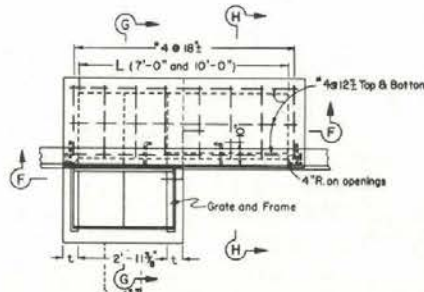


PLAN



TYPE 5 DROP INLET

TYPE 6 DROP INLET

CURB OPENING DETAILS

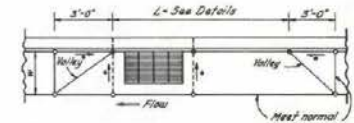

DROP INLET








- == Depressed elevation
- = Normal crown or gutter flowline elevation
- W = Normal gutter width

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

TYPE 4, 5 & 6
DROP INLETS

Robert A. Sheep
CHIEF ROAD DESIGN ENGINEER

R-4.5.1-(609)
ADDED: 5/71 REVISION
2 1/76

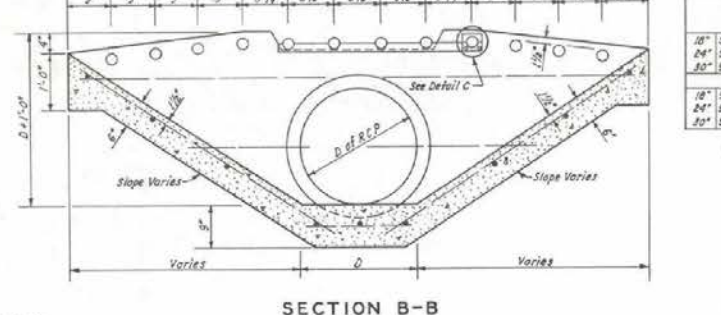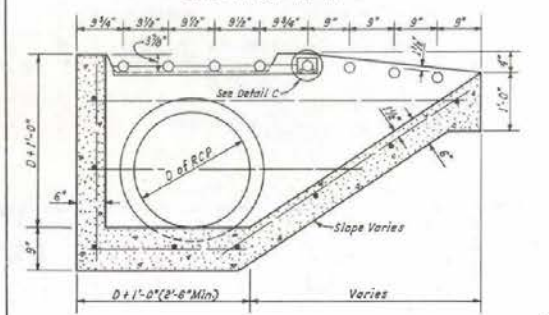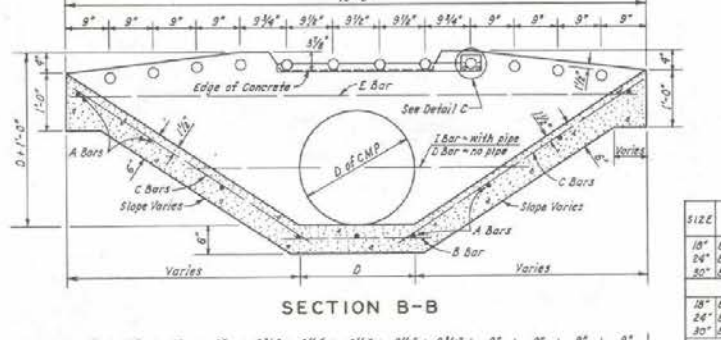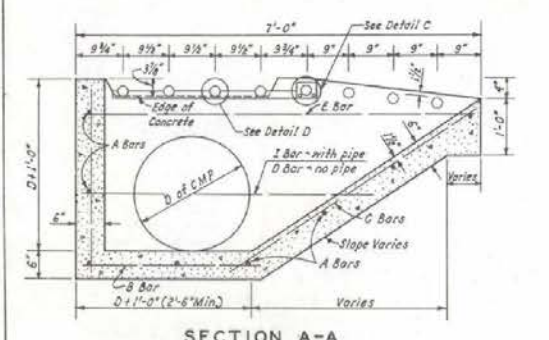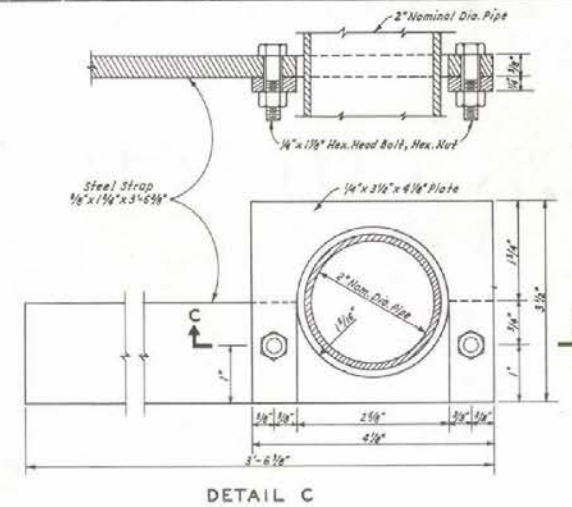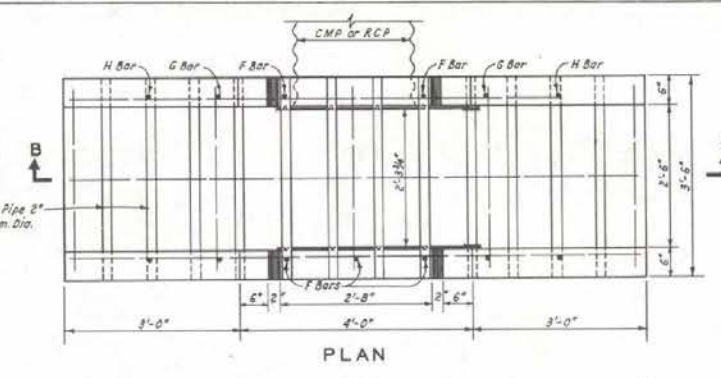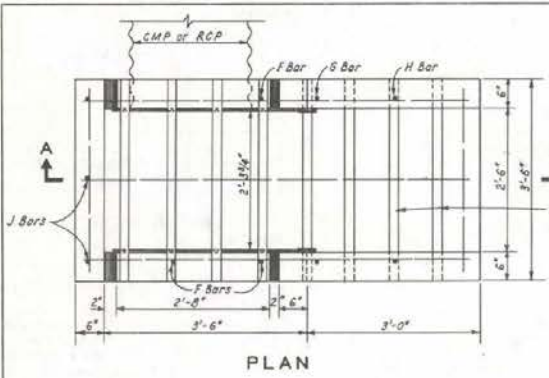

**TABLE OF QUANTITIES
TYPE 7 DROP INLET
CMP**

SIZE	A	B	C	D	E	F	G	H	I	J	CONC. CU. YD.	REINFC STEEL L.B.	STR. STEEL L.B.
18"	3 @ 3'-2"	3 @ 2'-3"	3 @ 4'-9"	1 @ 5'-0"	2 @ 5'-0"	3 @ 2'-6"	2 @ 1'-10"	2 @ 1'-2"	1 @ 2'-4"	3 @ 2'-8"	1.11	61	117
24"	3 @ 3'-2"	3 @ 2'-3"	3 @ 4'-5"	1 @ 5'-0"	2 @ 5'-0"	3 @ 2'-5"	2 @ 2'-0"	2 @ 1'-4"	1 @ 2'-3"	3 @ 3'-2"	1.21	63	117
30"	3 @ 3'-2"	3 @ 3'-0"	3 @ 4'-9"	1 @ 5'-4"	2 @ 6'-0"	3 @ 3'-3"	2 @ 2'-8"	2 @ 1'-3"	1 @ 1'-10"	3 @ 3'-2"	1.34	67	117
RCP													
18"	3 @ 3'-2"	3 @ 3'-4"	3 @ 5'-0"	1 @ 5'-0"	2 @ 5'-0"	3 @ 2'-6"	2 @ 1'-10"	1 @ 2'-1"	3 @ 2'-11"		1.18	62	117
24"	3 @ 3'-2"	3 @ 3'-4"	3 @ 5'-0"	1 @ 5'-0"	2 @ 5'-0"	3 @ 2'-5"	2 @ 2'-0"	1 @ 1'-4"	1 @ 2'-0"	3 @ 3'-2"	1.27	65	117
30"	3 @ 3'-2"	3 @ 3'-0"	3 @ 5'-0"	1 @ 5'-4"	2 @ 6'-0"	3 @ 3'-3"	2 @ 2'-8"	1 @ 1'-3"	1 @ 1'-11"		1.41	68	117

**TYPE 8 DROP INLET
CMP**



SIZE	A	B	C	D	E	F	G	H	I	J	CONC. CU. YD.	REINFC STEEL L.B.	STR. STEEL L.B.
18"	3 @ 3'-2"	3 @ 2'-0"	3 @ 4'-9"	1 @ 6'-6"	3 @ 3'-8"	3 @ 2'-3"	1 @ 1'-10"	4 @ 1'-2"	2 @ 2'-4"		1.33	78	168
24"	3 @ 3'-2"	3 @ 2'-0"	3 @ 4'-9"	1 @ 6'-10"	3 @ 3'-8"	3 @ 2'-3"	1 @ 2'-0"	4 @ 1'-4"	2 @ 2'-3"		1.65	82	168
30"	3 @ 3'-2"	3 @ 3'-0"	3 @ 4'-9"	1 @ 7'-0"	3 @ 3'-8"	3 @ 3'-3"	1 @ 2'-8"	4 @ 1'-9"	2 @ 1'-10"		1.89	87	168
RCP													
18"	3 @ 3'-2"	3 @ 2'-0"	3 @ 5'-0"	1 @ 6'-6"	3 @ 3'-8"	3 @ 2'-3"	1 @ 2'-10"	4 @ 1'-2"	2 @ 2'-4"		1.35	80	168
24"	3 @ 3'-2"	3 @ 2'-0"	3 @ 5'-0"	1 @ 6'-10"	3 @ 3'-8"	3 @ 3'-3"	1 @ 2'-0"	4 @ 1'-4"	2 @ 2'-3"		1.68	84	168
30"	3 @ 3'-2"	3 @ 3'-0"	3 @ 5'-0"	1 @ 7'-0"	3 @ 3'-8"	3 @ 3'-3"	1 @ 2'-8"	4 @ 1'-9"	2 @ 1'-8"		1.82	89	168

GENERAL NOTES

- All concrete shall be Class A or AA.
- Reinforcing steel shall be NY# bars with maximum spacing of 18" centers, wired slightly at all intersections and embedded at least one and one half inch clear of concrete surface.
- Dimensions may be varied by the Engineer to fit local conditions.
- No deductions in concrete shall be made for the 2" crossbars.
- All exposed edges of concrete shall be chamfered one inch.
- Steel strap and pipe for crossbars are included in the structural steel grate quantities.

**SECTION A-A
TYPE 7 DROP INLET**

**SECTION B-B
TYPE 8 DROP INLET**

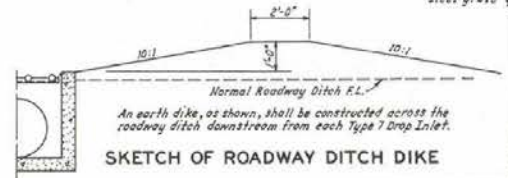


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**TYPE 7 & 8
DROP INLETS**


Robert L. Shoop
CHIEF ROAD DESIGN ENGR.

R-4.6.1 - (609)
ADOPTED: 8/69


R 38

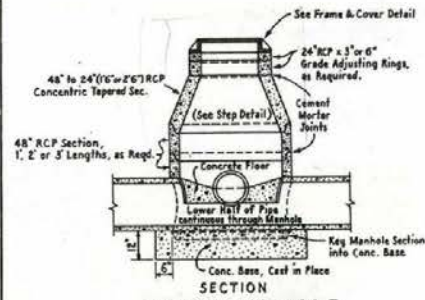


SECTION
TYPE I MANHOLE

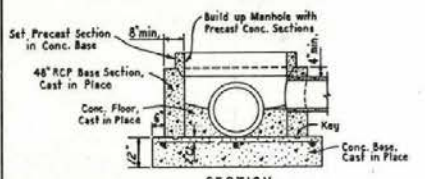


SECTION
ALTERNATE BASE CONST.




PLAN

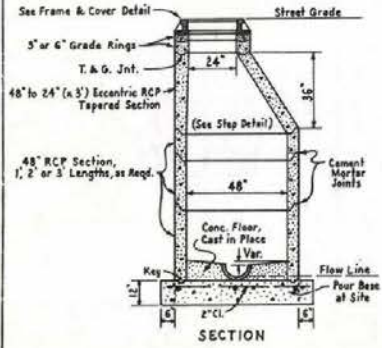


SECTION
TYPE 2 MANHOLE

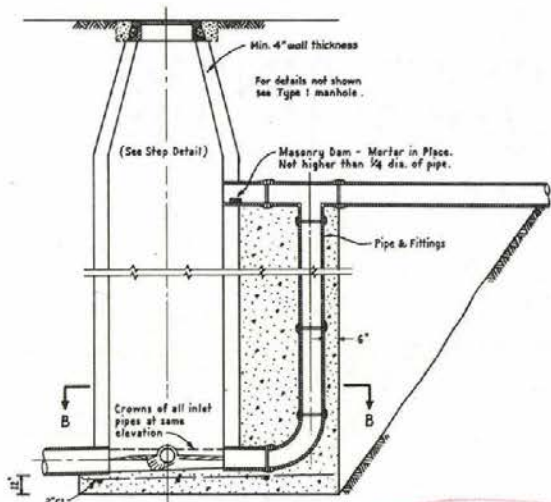

SECTION A-A

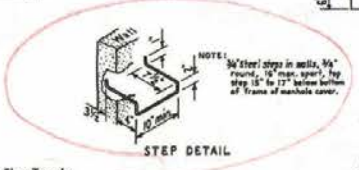


STEP DETAIL

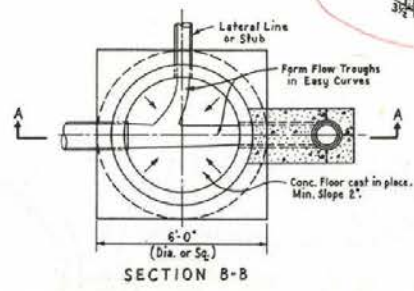


SECTION B-B

TYPE 3 MANHOLE

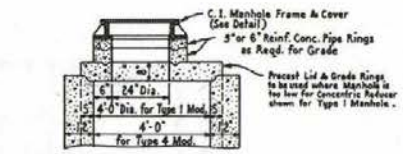


TYPE 1 OR 4 MODIFIED MANHOLE

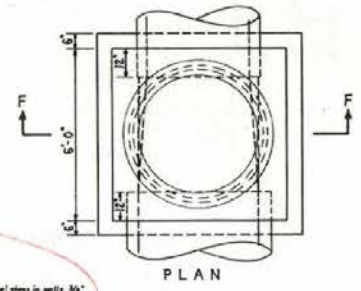


PLAN

Approx. weight: frame 142 lb., cover 122 # min.
Material: Cast Iron.

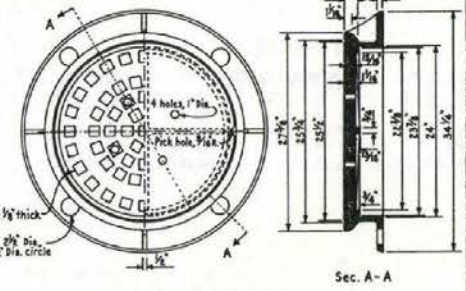


TYPICAL TRAFFIC-STRENGTH
MANHOLE FRAME & COVER

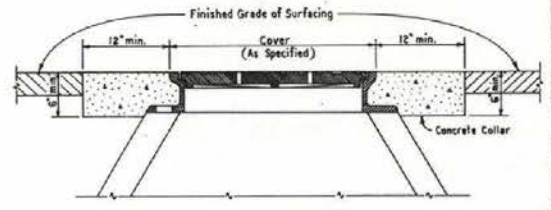

TYPICAL METHOD OF ADJUSTING MANHOLES AND WATER VALVES
(Adjusted collars may be poured square or round.)

NOTE: COMMERCIAL PREFABRICATED ADJUSTMENT RINGS FOR MANHOLES MAY BE USED WHEN APPROVED BY THE ENGINEER.

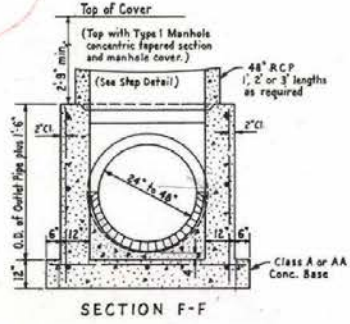

SECTION F-F

TYPE 4 MANHOLE


- GENERAL NOTES
1. ALLOW A DROP OF .01 FT. IN A THROUGH MANHOLE & ALLOW A DROP OF .02 FT. IN THE PRESENCE OF ONE LATERAL OR BEND.
 2. ALL REINFORCING STEEL TO BE NO. 4 BARS AT 18" MAXIMUM SPACING UNLESS OTHERWISE NOTED.
 3. ALL CONCRETE SHALL BE CLASS A OR AA.

STATE OF NEVADA
DEPT. OF HIGHWAYS


TYPE 1, 2, 3 & 4
MANHOLES

Robert L. Simpson
CHIEF ASSESSOR DESIGN ENGINEER


R-471- (609)
ADOPTED: 8/69 REVISION
8-1775

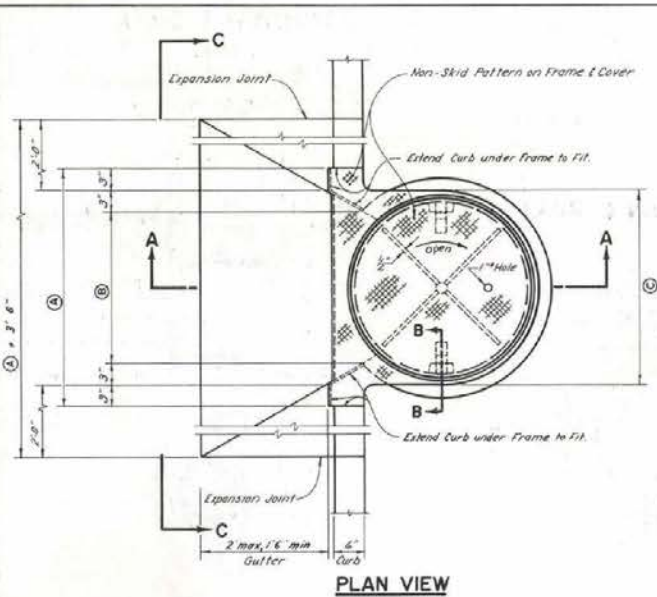


PLAN VIEW

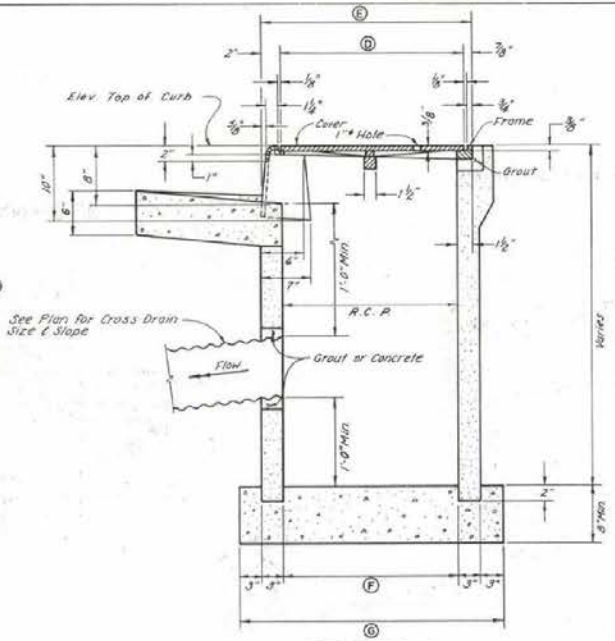

SECTION A-A

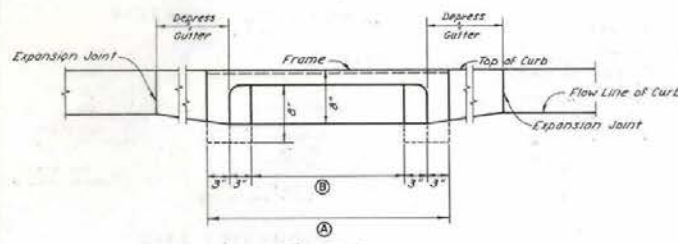

VIEW C-C



**SECTION B-B
WEDGE-LOCK HOLD DOWN**

DROP INLET	A	B	C	D	E	F	G
TYPE 10	2'-9"	1'-9"	2'-3"	25 1/4"	28 7/8"	24"	36"
TYPE 9	2'-3"	1'-3"	1'-9"	19 1/4"	22 7/8"	18"	30"

CASTINGS *	
	FRAME COVER
TYPE 10	90 Lbs. 70 Lbs.
TYPE 9	66 Lbs. 36 Lbs.

* For Info. Only



GENERAL NOTES

1. All Concrete Shall be A or AA.
2. Forming of the Base Will not be Required.




STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**DROP INLET
TYPE 9 & 10**








Robert W. Hays R-4.8.1 (609)
CHIEF ROAD DESIGN ENGR. ADOPTED 11/71 REVISION

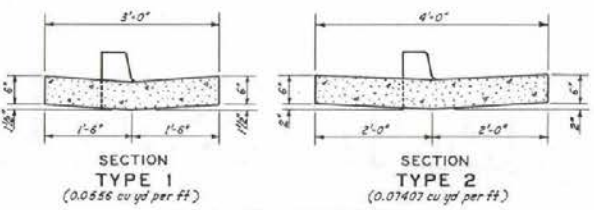



VALLEY GUTTER

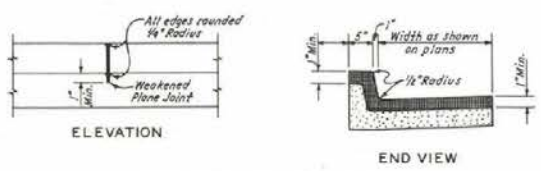

WEAKENED PLANE JOINT
For use in concrete curb and gutter

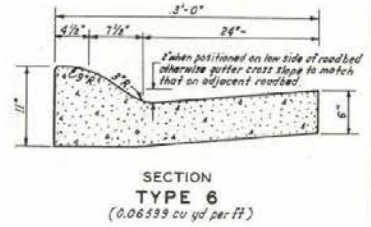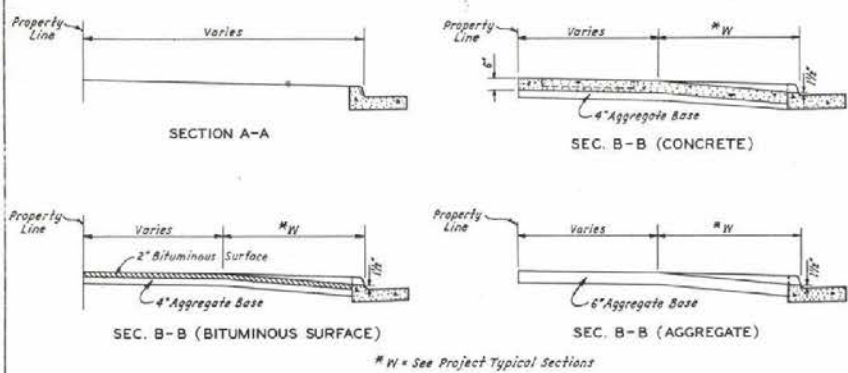

CURB AND GUTTER

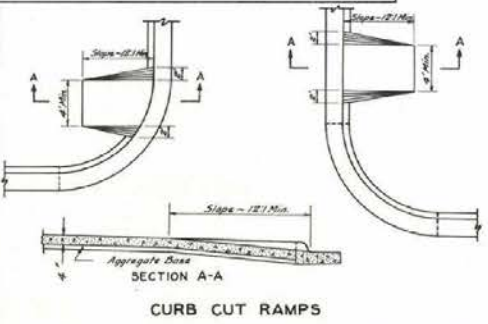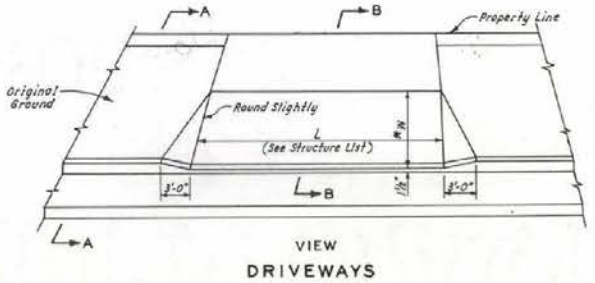

- GENERAL NOTES**
1. Curb cuts can be varied to fit the needs of a particular location
 2. Curb cut ramps should be located closely adjacent to or within marked crosswalks to insure their use as part of the established pedestrian control of the intersection. Specific location should be adapted to site conditions.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**CURB AND GUTTER
AND DRIVEWAYS**

R-5.11-(613)

ADOPTED: 5/63 REVISION: 1/77


Robert L. Shaffer
CHIEF ROAD DESIGN ENGR.

R 40

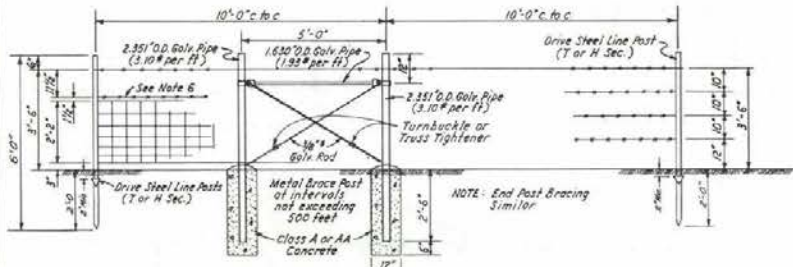


INTERMEDIATE BRACED POST


TYPE DA FENCE

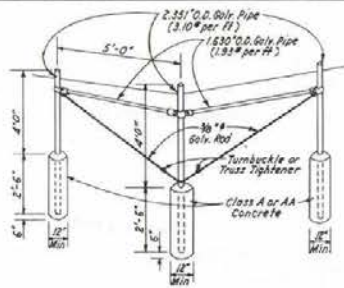


CORNER BRACE-TYPE DA FENCE



BRACE CLAMP




STRETCHER BAR CLAMP



TRUSS TIGHTENER


GENERAL NOTES

1. Fence posts and material shall conform to the requirements of Standard Specifications and Amendments.
2. Standard fencing shall consist of galvanized barbed wire, galvanized woven wire (farm fences), or a combination of both on wood or metal posts or combination of posts.
3. Barbed wire shall be spaced as follows:
Type 3A, 3B, 3C
4 wires; bottom wire 12" above ground, others spacing 10"
4. Standard fencing will be designated by type, design of fabric and/or number of barbed wires, that:
Type 04-700-23 designates metal posts, 26" woven (farm) wire and 2 barbed wires;
Type 08-706-23 designates wooden posts, 26" woven (farm) wire and 2 barbed wires;
Type 06-705-23 designates combination of wood and metal posts, 26" woven (farm) wire, and 2 barbed wires.
5. Use same size gates and gate posts as shown on Sheet S-4.1.3.
6. The first line of barbed wire above the wire mesh shall be tied to the top wire of the wire mesh with 12 gage galvanized steel wire or 9 gage aluminum hog rings. One tie to be made midway between 10' post spacing and two ties to be equally spaced for 16'-6" post spacing.

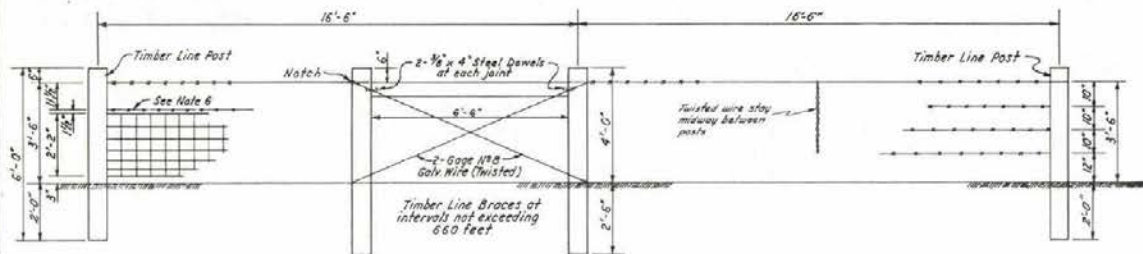


INTERMEDIATE BRACED POST

TYPE DB FENCE




WOVEN WIRE (FARM FENCE) FABRIC

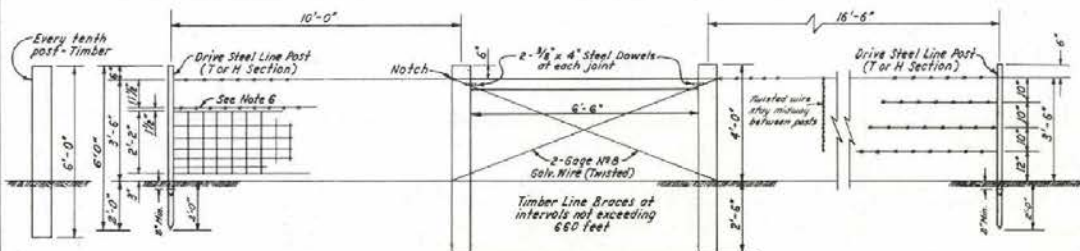


INTERMEDIATE BRACED POST

TYPE DC FENCE

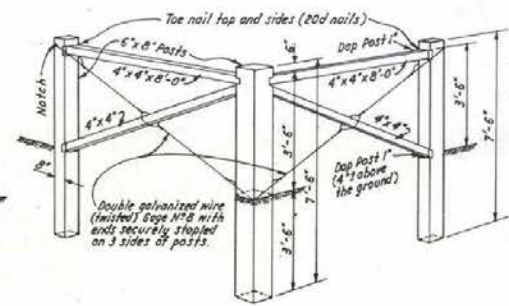

TIMBER CORNER BRACE

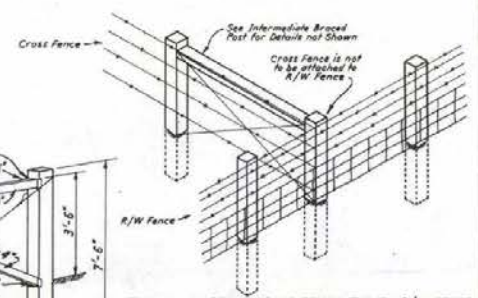


TYPICAL EXISTING CROSS FENCE TIE TO R/W FENCE

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

FENCE DETAILS

R-6.1.2- (616)
ADOPTED: 8/88
REVISION: 4/05

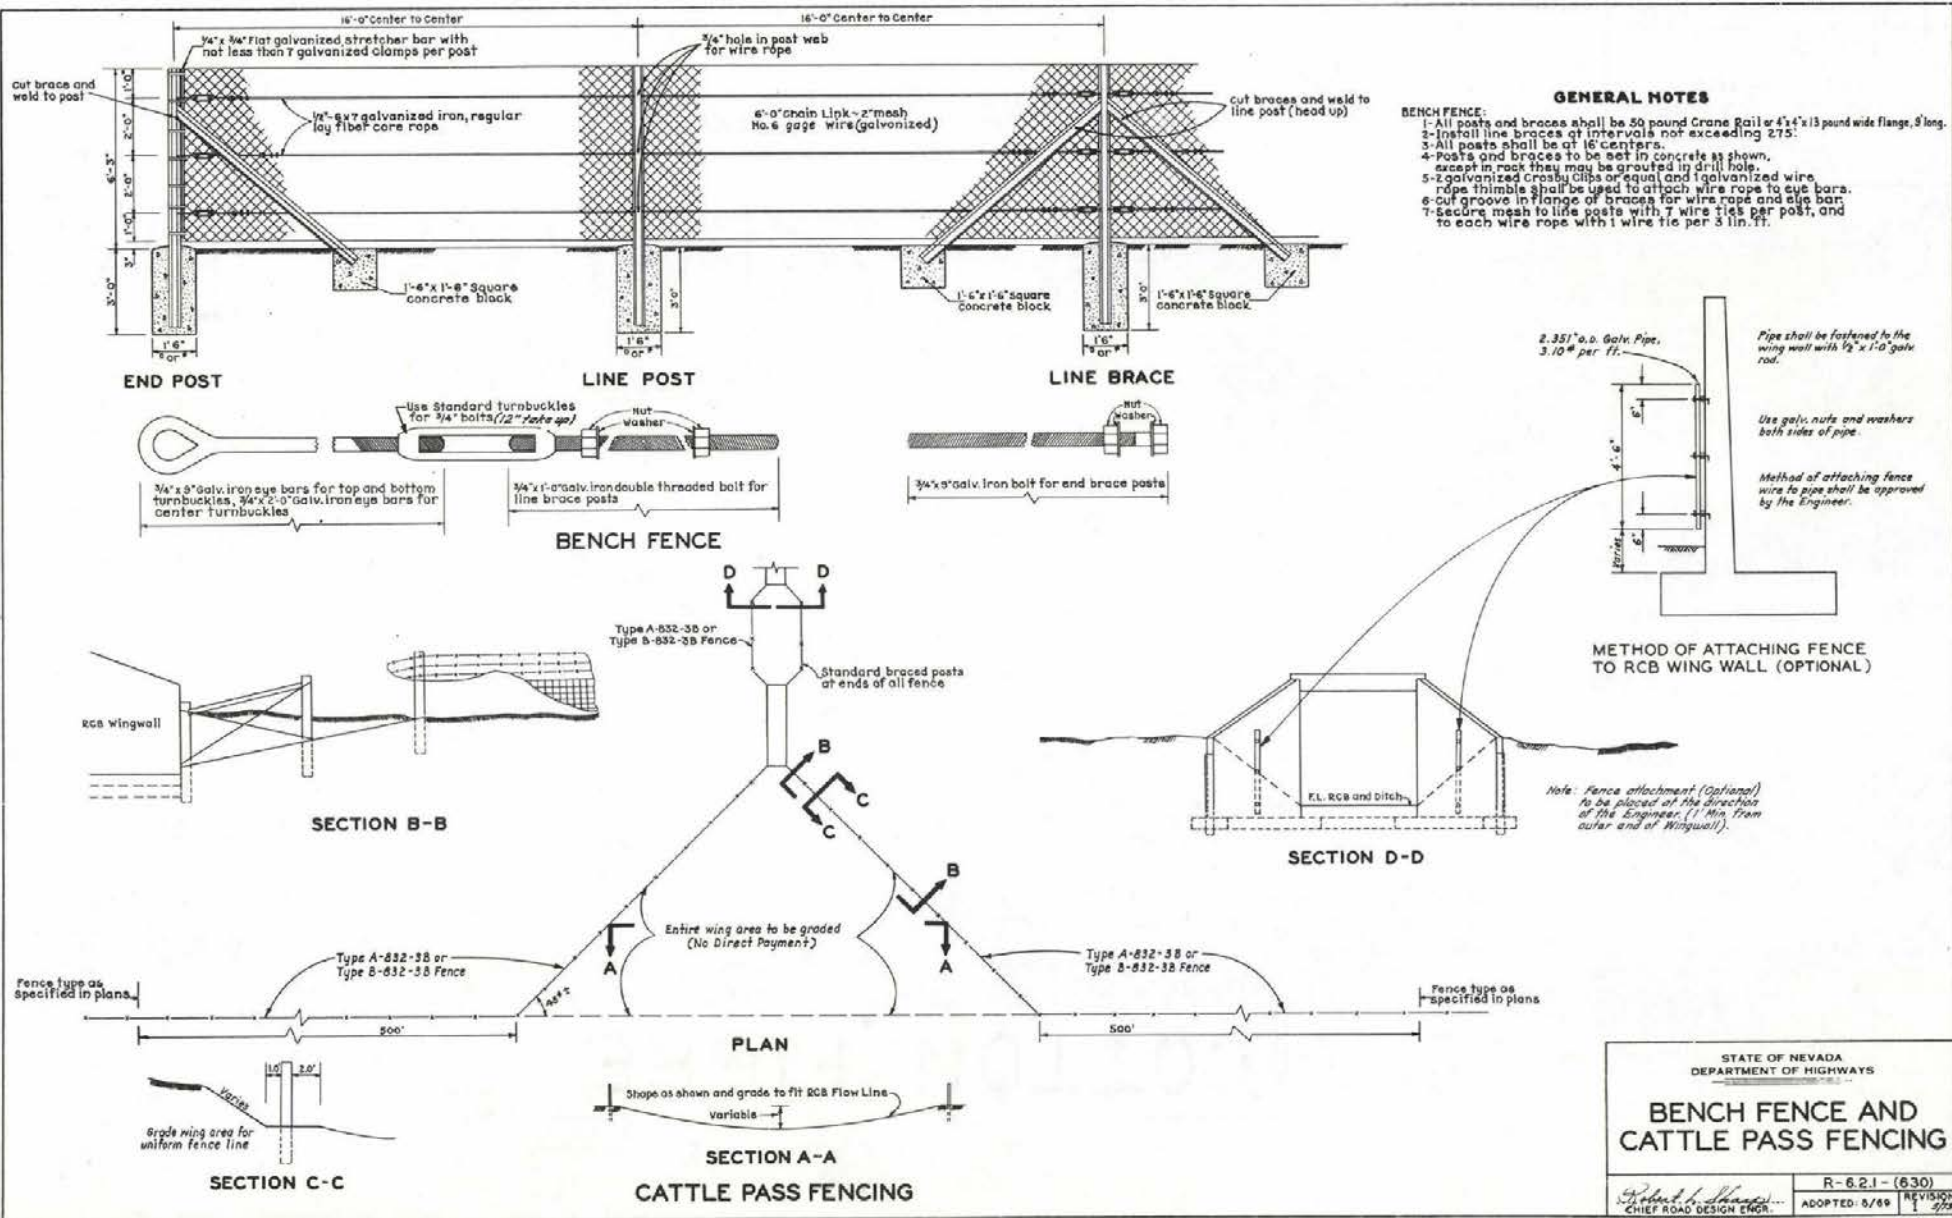

GENERAL NOTES

- BENCH FENCE:**
- 1- All posts and braces shall be 50 pound Crane Rail or 4' x 13 pound wide flange, 9' long.
 - 2- Install line braces at intervals not exceeding 275'.
 - 3- All posts shall be at 16' centers.
 - 4- Posts and braces to be set in concrete as shown, except in rock they may be grouted in drill hole.
 - 5- 2 galvanized Crosby Clips or equal and 1 galvanized wire rope thimble shall be used to attach wire rope to eye bars.
 - 6- cut groove in flange of braces for wire rope and eye bar.
 - 7- Secure mesh to line posts with 7 wire ties per post, and to each wire rope with 1 wire tie per 3 lin. ft.

R-44

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**BENCH FENCE AND
CATTLE PASS FENCING**

R-6.2.1 - (630)

ADOPTED: 5/69

REVISION

1/73

BILL OF MATERIALS

DOUGLAS FIR				
ITEM	NO REQ'D	SIZE	LENGTH	FT B M
Wheel Guards	2	6' x 6"	7'-3"	43.5
Wing Slope	4	2' x 6"	8'-0"	32.0
Wing Slope	2	2' x 6"	6'-4 1/2"	12.8
Wing Braces	2	2' x 6"	3'-4"	6.7
Wing Braces	4	2' x 6"	5'-3"	21.0
Wing Braces	2	2' x 6"	7'-3"	14.5
Wing Braces	2	2' x 6"	2'-7"	4.2
Wing Braces	2	2' x 6"	4'-0"	8.0
Wing Braces	2	2' x 6"	5'-0"	10.0
Wing Post	2	4' x 6"	As Required	
Nailing strip	2	2' x 2"	2'-0"	1.3

HARDWARE				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
Bolts	6	3/4"	12"	15
Washers	6	3/4"		6
Nails	50	40d		3
Nails	72	20d		24
TOTAL				26.4

STRUCTURAL STEEL				
12' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
I Beams	13	54X7.7	15'-0"	1301
I Beams	6	57X15.3	7'-3"	666
Spacers	72	2 1/2 x 5/16"	0'-6 3/16"	109
Anchor Bolts	12	3/4"	0'-9"	12
End Plates	2	7' x 1/4"	15'-0"	135
TOTAL				2243

14' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
I Beams	13	54X7.7	15'-0"	1302
I Beams	7	57X15.3	7'-3"	776
Spacers	84	2 1/2 x 5/16"	0'-6 3/16"	127
Anchor Bolts	14	3/4"	0'-9"	14
End Plates	2	7' x 1/4"	15'-0"	178
TOTAL				2597

16' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
I Beams	13	54X7.7	17'-0"	1702
I Beams	8	57X15.3	7'-3"	887
Spacers	84	2 1/2 x 5/16"	0'-6 3/16"	127
Anchor Bolts	14	3/4"	0'-9"	14
End Plates	2	7' x 1/4"	17'-0"	211
TOTAL				2941

20' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
I Beams	13	54X7.7	21'-0"	2102
I Beams	9	57X15.3	7'-3"	958
Spacers	108	2 1/2 x 5/16"	0'-6 3/16"	165
Anchor Bolts	16	3/4"	0'-9"	16
End Plates	2	7' x 1/4"	21'-0"	250
TOTAL				3531

REINFORCING 12' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
Horizontal Bars	12	No. 4	12'-6"	100
Horizontal Bars	12	No. 4	7'-0"	56
Horizontal Bars	16	No. 4	16'-9"	201
Vertical Bars	20	No. 4	2'-9"	37
U-Bars	26	No. 6	12'-1"	471
TOTAL				865


14' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
Horizontal Bars	12	No. 4	14'-6"	116
Horizontal Bars	13	No. 4	7'-0"	61
Horizontal Bars	16	No. 4	16'-9"	225
Vertical Bars	22	No. 4	2'-9"	40
U-Bars	29	No. 6	12'-1"	526
TOTAL				968

16' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
Horizontal Bars	12	No. 4	16'-6"	132
Horizontal Bars	15	No. 4	7'-0"	70
Horizontal Bars	18	No. 4	20'-9"	249
Vertical Bars	26	No. 4	2'-9"	48
U-Bars	32	No. 6	12'-1"	580
TOTAL				1079


20' ROADBED				
ITEM	NO REQ'D	SIZE	LENGTH	WT LBS
Horizontal Bars	12	No. 4	20'-6"	164
Horizontal Bars	17	No. 4	7'-0"	78
Horizontal Bars	18	No. 4	24'-9"	257
Vertical Bars	30	No. 4	2'-9"	55
U-Bars	39	No. 6	12'-1"	707
TOTAL				1802

CONCRETE				
ROADBED	CU. YD.			
12' Roadbed	5.00			
14' Roadbed	5.59			
16' Roadbed	6.17			
20' Roadbed	7.35			


*No. 4 Bars welded to 7" I Beams

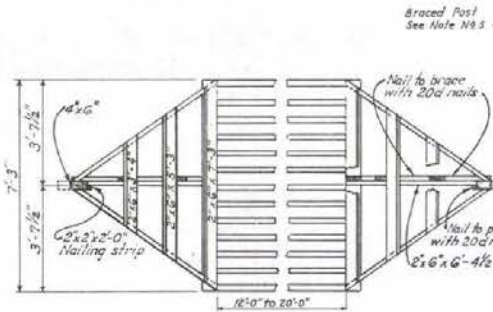


PLAN OF WINGS

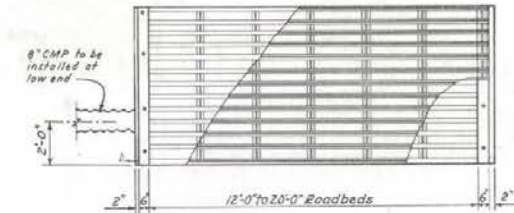


PLAN

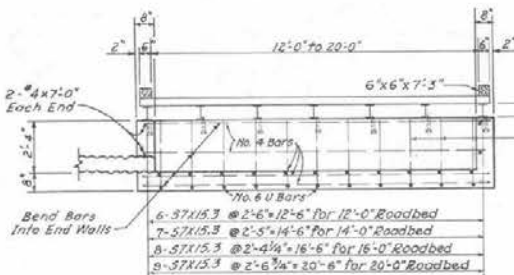


SECTION

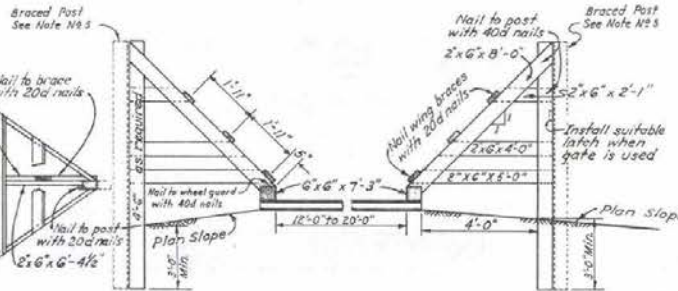

ELEVATION OF WINGS

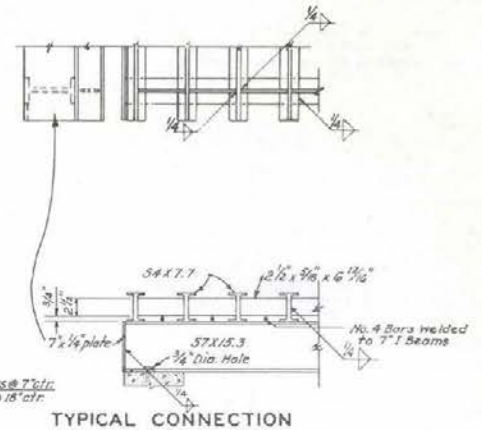

TYPICAL CONNECTION

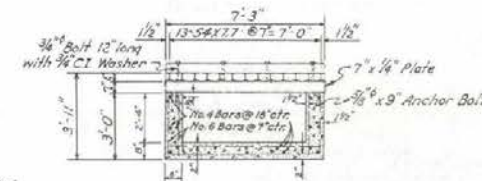

SECTION ON CENTER LINE

GENERAL NOTES

- All concrete to be Class A or AA.
- Standard Metal or Timber gates shall be constructed when shown on plans or ordered by the engineer.
- All connections to be welded.
- All timber shall be given two coats of approved outside white paint.
- When a gate is not specified, install the required type of Intermediate Braced Post adjacent to the Wing Post. Fence wires to be tied to Braced Post only.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STEEL CATTLE GUARD 12' TO 20' ROADBED

Robert J. Shoop
CHIEF ROAD DESIGN ENGR.

R-711- (617)
ADOPTED 8/89 REVISION 2/92

54 x 7.7
7" I Beam

BILL OF MATERIALS

DOUGLAS FIR				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
Wing Guards	2	6" x 6"	7'-3"	43.5
Wing Slope	4	2" x 6"	8'-0"	36.0
Wing Slope	2	2" x 6"	6'-4 1/2"	12.0
Wing Braces	2	2" x 6"	3'-4"	6.7
Wing Braces	4	2" x 6"	5'-3"	21.0
Wing Braces	2	2" x 6"	7'-3"	14.5
Wing Braces	2	2" x 6"	2'-1"	4.2
Wing Braces	2	2" x 6"	4'-0"	8.0
Wing Braces	2	2" x 6"	5'-0"	10.0
Wing Post	2	4" x 6"	AS REQUIRED	
Nailing Strip	2	2" x 2"	2'-0"	1.5
HARDWARE				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
Bolts	6	3/4"	12"	15
Washers	6	3/4"		6
Nails	50	40d		3
Nails	72	20d		2 1/4
TOTAL				26 1/4

STRUCTURAL STEEL

26' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
I Beams	26	54 x 7.7	13'-5 3/4"	2699
I Beams	72	57 x 15.3	7'-3"	1337
Spacers	144	2 1/2" x 1 1/2"	0'-6 3/8"	21.7
Anchor Bolts	24	3/4" x 9"	0'-9"	2.3
End Plates	4	7" x 14"	13'-6"	320
TOTAL				4590

32' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
I Beams	26	54 x 7.7	16'-5 3/4"	3299
I Beams	14	57 x 15.3	7'-3"	1553
Spacers	168	2 1/2" x 1 1/2"	0'-6 3/8"	25.4
Anchor Bolts	28	3/4" x 9"	0'-9"	2.7
End Plates	4	7" x 14"	16'-6"	392
TOTAL				5525

40' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
I Beams	26	54 x 7.7	20'-5 3/4"	4100
I Beams	18	57 x 15.3	7'-3"	1997
Spacers	216	2 1/2" x 1 1/2"	0'-6 3/8"	32.6
Anchor Bolts	36	3/4" x 9"	0'-9"	3.5
End Plates	4	7" x 14"	20'-6"	487
TOTAL				6945



REINFORCING 26' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
Horizontal Bars	24	No. 4	15'-3"	212
Horizontal Bars	22	No. 4	7'-0"	103
Horizontal Bars	18	No. 4	30'-9"	370
Vertical Bars	40	No. 4	2'-9"	74
U-Bars	30	No. 6	12'-1"	907
TOTAL				1666

32' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
Horizontal Bars	24	No. 4	15'-3"	260
Horizontal Bars	26	No. 4	7'-0"	122
Horizontal Bars	18	No. 4	36'-9"	442
Vertical Bars	48	No. 4	2'-9"	88
U-Bars	60	No. 6	12'-1"	1088
TOTAL				2000

40' ROADBED				
ITEM	NO REQD.	SIZE	LENGTH	WT LBS.
Horizontal Bars	24	No. 4	20'-3"	325
Horizontal Bars	31	No. 4	7'-0"	145
Horizontal Bars	18	No. 4	44'-9"	339
Vertical Bars	58	No. 4	2'-9"	107
U-Bars	74	No. 6	12'-1"	1344
TOTAL				2459


CONCRETE

26' Roadbed	9.36 Cu. Yd.
32' Roadbed	11.23 Cu. Yd.
40' Roadbed	13.74 Cu. Yd.

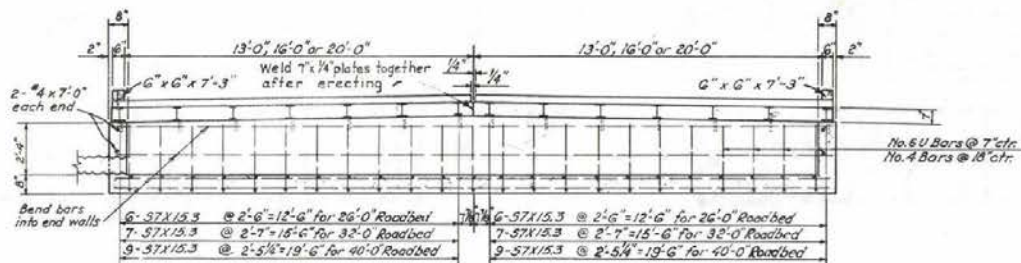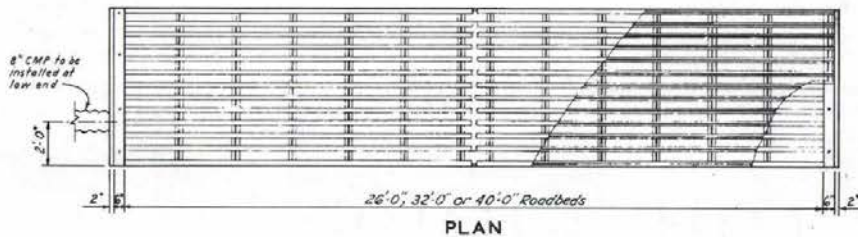


SECTION

NOTE: Slope top of footing to fit crown of roadway.

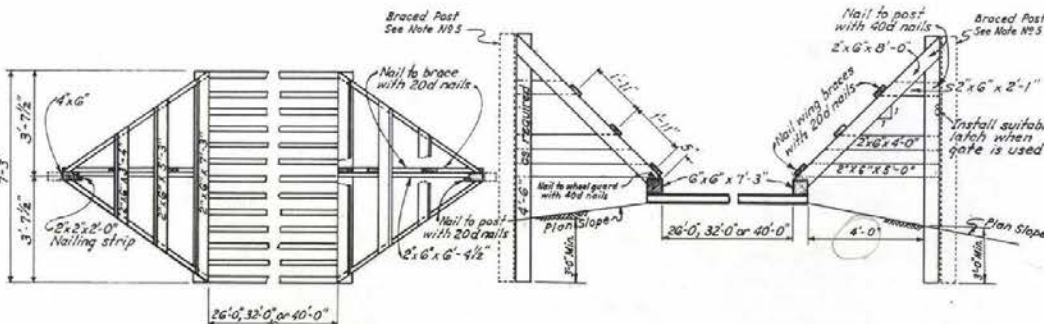


PLAN OF WINGS

ELEVATION OF WINGS

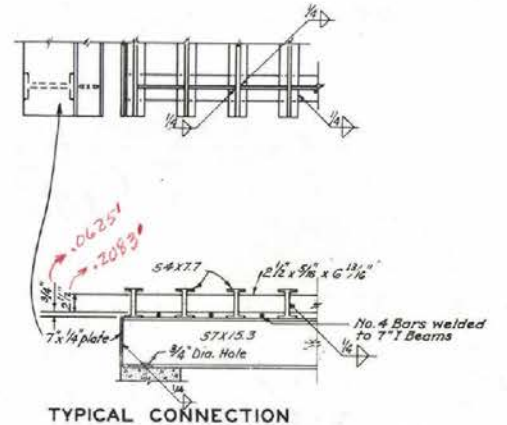

TYPICAL CONNECTION

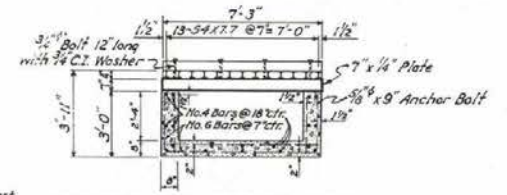

SECTION ON CENTER LINE

GENERAL NOTES

- All concrete to be Class A or AA.
- Standard Metal or Timber gates shall be constructed when shown on plans or ordered by the engineer.
- All connections to be welded.
- All timber shall be given two coats of approved outside white paint.
- When a gate is not specified: Install the required type of Intermediate Braced Post adjacent to the Wing Post. Fence wires to be tied to Braced Post only.






STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STEEL CATTLE GUARD 26 TO 40' ROADBED

Robert J. Sharp
CHIEF ROAD DESIGN ENGR.

R-7.1.2-(617)
ADOPTED 5/85 REVISION 2/2000

* No. 4 Bars welded to 7" I Beams

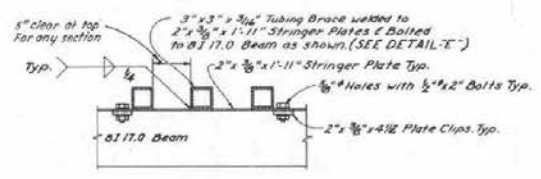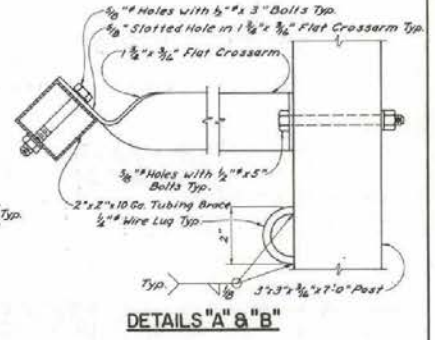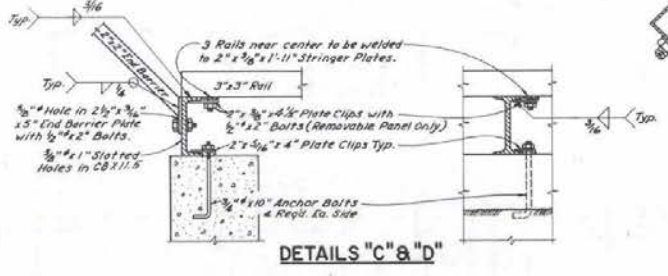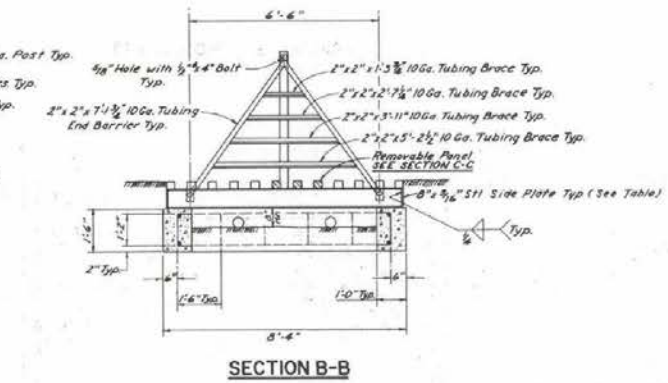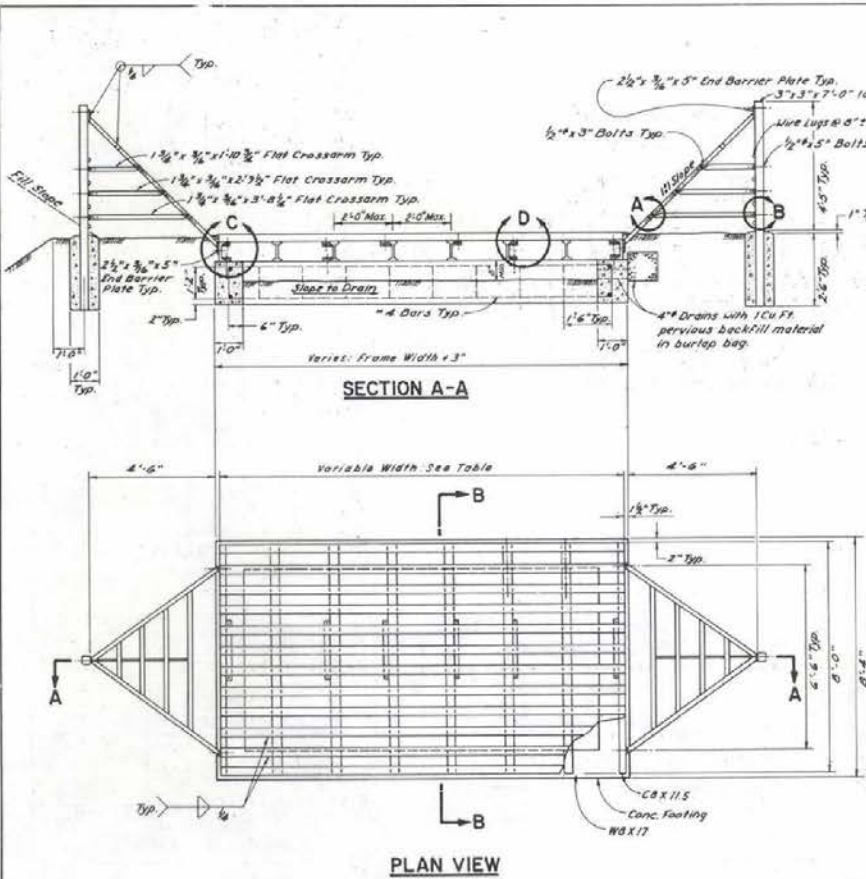

- GENERAL NOTES
1. ALL CONCRETE SHALL BE CLASS A OR AA.
 2. ALTERNATIVE DESIGN MAY BE SUBMITTED BY THE CONTRACTOR FOR APPROVAL BY THE ENGINEER.
 3. LIVE LOADING: H20.
 4. CATTLE GUARD SLOPE IS TO CONFORM TO THE ROADWAY CROSS SLOPE AND GRADE.
 5. SEE SPECIAL PROVISIONS FOR PROTECTIVE FINISH.
 6. "FRAME WIDTH" COMBINATIONS MAY BE VARIED TO OBTAIN THE SPECIFIED WIDTH OF CATTLE GUARDS.
 7. USE SELF-LOCKING NUTS ON REMOVABLE PANEL.

BILL OF MATERIALS										
FRAME SIZE		LONGITUDINAL STRINGERS			STRUCTURAL STEEL					
LENGTH	WIDTH	NO. REQ'D.	SIZE	SPACING	WT. LBS.	ITEM	NO. REQ'D.	SIZE	LENGTH	WT. LBS.
8'0"	14'0"	5	WBX17	EQUAL	816	BOLTS	13	3/4"x3/16"	14'0"	1099
						SIDE PLATES	2	8"x3/16"	14'0"	143
8'0"	12'0"	5	WBX17	EQUAL	680	BOLTS	13	3/4"x3/16"	14'0"	1070
						SIDE PLATES	2	8"x3/16"	12'0"	122
8'0"	10'0"	4	WBX17	EQUAL	544	BOLTS	13	3/4"x3/16"	10'0"	838
						SIDE PLATES	2	8"x3/16"	10'0"	108
8'0"	8'0"	3	WBX17	EQUAL	408	BOLTS	13	3/4"x3/16"	8'0"	713
						SIDE PLATES	2	8"x3/16"	8'0"	82


MATERIAL LIST FOR ALL SIZES									
ITEM	NO. REQ'D.	SIZE	LENGTH	WT. LBS.					
CHANNELS	2	C&G 11.5	8'0"	186					
STRINGER PLATES	2	2"x3/8"x1-11"	11'0"	30					
ANCHOR BOLT CLIPS	14	2"x3/8"x4"	4"	10					

CONCRETE				REINFORCING STEEL			
LENGTH	CU. YDS.	WT. LBS.		LENGTH	WT. LBS.		
14'0"	8.89	88		14'0"	2.06	74	
12'0"	7.68	76		12'0"	1.86	67	
8'0"	5.12	51		8'0"	1.22	45	

MATERIAL LIST FOR WINGS					
ITEM	REQ'D.	SIZE	LENGTH	WT. LBS.	
FLAT CROSSARMS	2	1 3/4"x3/16"	1' 10 3/16"	4	
CROSSARMS	2	1 3/4"x3/16"	9' 9 1/2"	5	
BRACES	2	1 3/4"x3/16"	3' 0 1/4"	8	
BRACES	2	2"x2"x10ga	1' 3 3/16"	11	
BRACES	2	2"x2"x10ga	2' 1 1/2"	23	
BRACES	2	2"x2"x10ga	3' 11"	38	
BRACES	2	2"x2"x10ga	5' 2 1/2"	51	
END BARRIER PLATES	4	2' x 2" x 10ga	7' 1 3/16"	123	
WEIGHT POST	2	3"x3"x3/16"	3' 0"	36	

NOTE: MATERIAL LIST IS FOR INFORMATION ONLY.

SECTION C-C SHOWING REMOVABLE PANEL



Note: A welded or rolled unit of equivalent design loading capacity, may be submitted to the engineer for approval in place of 3' x 3' x 3/16" tubing.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STEEL CATTLE GUARD (TYPE B)

Robert L. Hooper
CHIEF ROAD DESIGN ENGR.

R-7.13-(617)
ADOPTED 3-71

REVISION
2

BILL OF MATERIALS

TIMBER				
ITEM	NO REQ'D	SIZE	LENGTH	WT. LBS.
Wheel Guards	2	6"x6"	7'-3"	43.5
Wing Slope	4	2"x6"	8'-0"	32.0
Wing Slope	2	2"x6"	6'-4 1/2"	12.8
Wing Braces	2	2"x6"	5'-6"	6.7
Wing Braces	4	2"x6"	5'-3"	21.0
Wing Braces	2	2"x6"	7'-3"	14.5
Wing Braces	2	2"x6"	2'-7"	4.2
Wing Braces	2	2"x6"	4'-0"	8.0
Wing Braces	2	2"x6"	5'-0"	10.0
Wing Post	2	4"x6"	As Required	
Nailing Strip	2	2"x2"	2'-0"	1.3
HARDWARE				
ITEM	NO REQ'D	SIZE	LENGTH	WT. LBS.
Bolts	8	3/4"	12"	15
Washers	8	3/4"		6
Nails	50	40d		3
Nails	12	40d		2 1/2
Total				26 1/4

STRUCTURAL STEEL (1'-10"-0" COMPONENT)				
ITEM	NO REQ'D	SIZE	LENGTH	WT. LBS.
Beams	5	S7X15.3	1'x8"	554.6
Structural Tubing	15	4"x2"x1/4"	8'-11 1/2"	1139.3
Spacer Plate	60	2 1/2"x4 1/2"	0'-5"	61.0
Anchor Bolts	10	3/4"	0'-9"	3.0
End Plates	2	7"x19"	9'-12 1/2"	118.5
Pipe Sleeves	8	2"	0'-5"	14.6
Connection Plates	As Req'd	3"x4"x1/4"		
Connection Bolts	As Req'd	1"	15"	


REINFORCING STEEL (1'-10"-0" COMPONENT)				
ITEM	NO REQ'D	SIZE	LENGTH	WT. LBS.
Horizontal Bars	12	#4	3'-6"	76
Horizontal Bars	18	#4	3'-9"	117
Horizontal Bars	18	#4	7'-0"	94
Vertical Bars	44	#4	1'-3"	37
Lifting Logs	4	#4	2'-9"	7
U Bars	18	#6	3'-6"	259
Total				580

CONCRETE
1'-10"-0" Component 1.94 cu. yd.


* #4 Bars welded to I Beams.




PLAN

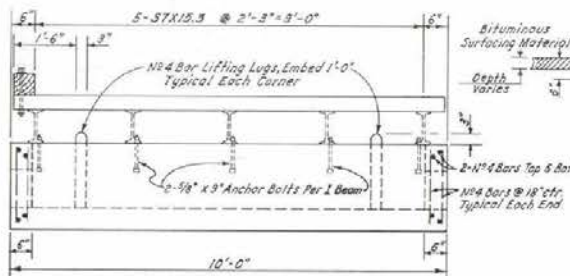


ELEVATION

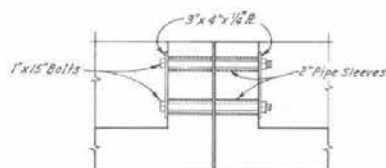


CONNECTION DETAIL

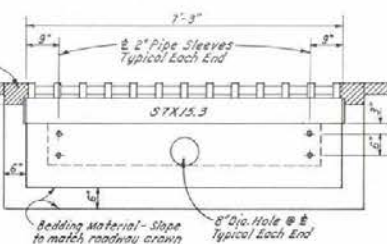


END VIEW

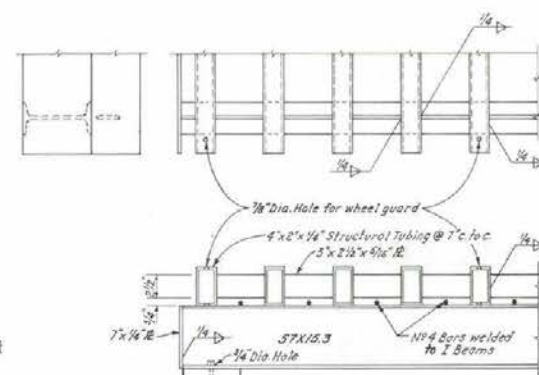


TYPICAL CONNECTION

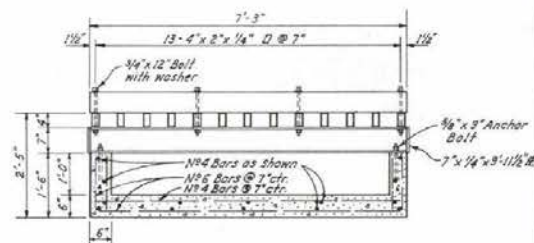

SECTION

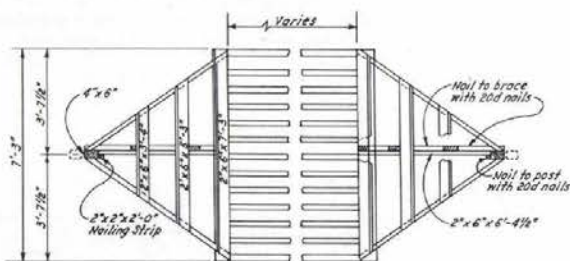

PLAN

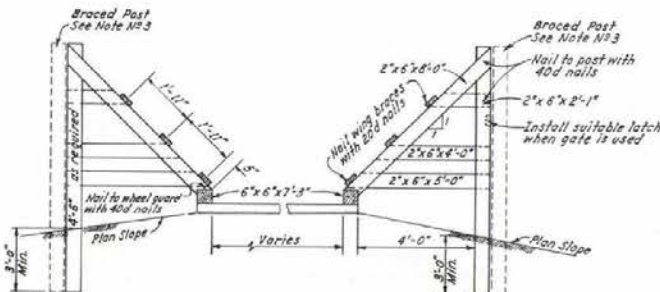

ELEVATION

TIMBER WINGS


- GENERAL NOTES**
1. All concrete to be Class DA.
 2. All connections to be welded.
 3. When a gate is not specified: Install the required type of Intermediate Braced Post adjacent to the Wing Post. Fence wires to be tied to Braced Post only.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**STEEL CATTLE GUARD
(TYPE C)**

Robert L. Sharp
CHIEF ROAD DESIGN ENGR.


R-7.1.4-(617)
ADOPTED: 10/70 REVISION: 2/25

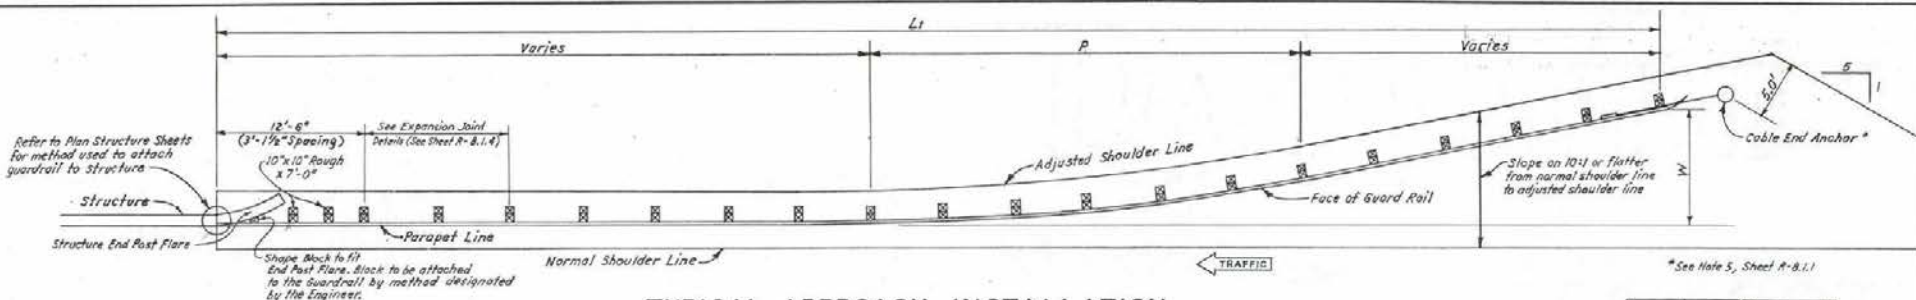


TYPICAL APPROACH INSTALLATION

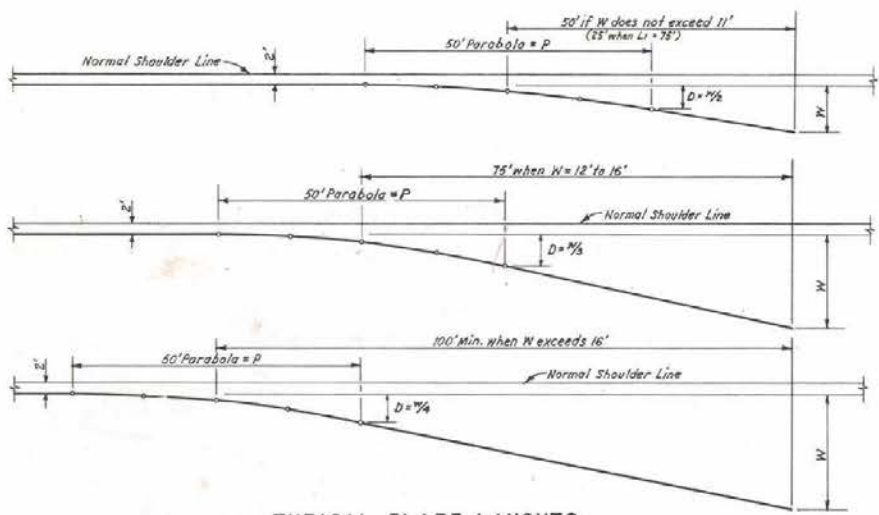


TYPICAL FLARE LAYOUTS

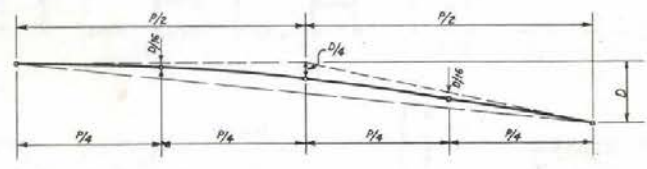


PARABOLIC LAYOUT

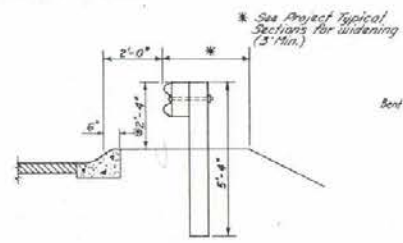



CURB INSTALLATION

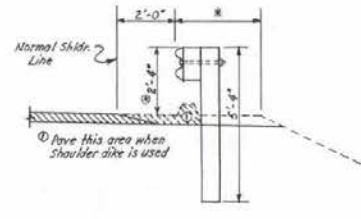

EMBANKMENT INSTALLATION

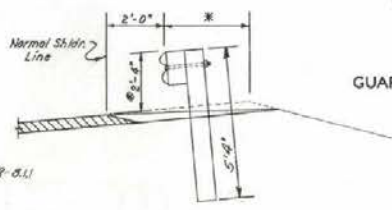


SUPERELEVATED INSTALLATION

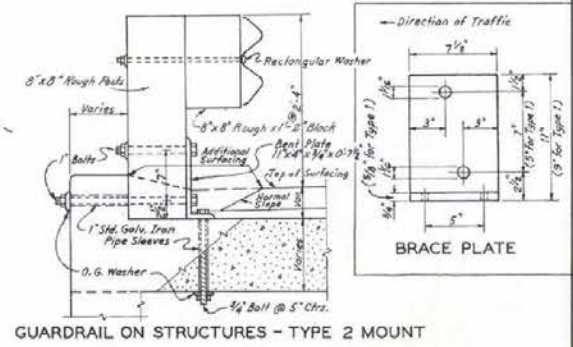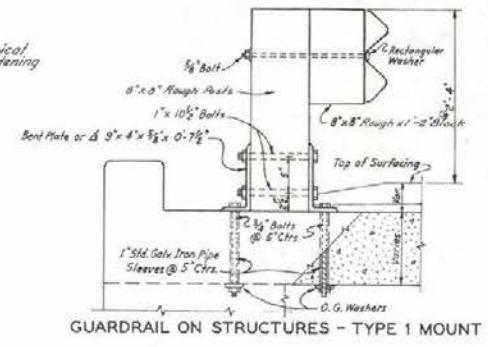


See Sheet R-8.1.1 for General Notes.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

GUARDRAIL
INSTALLATION



 R-8.1.2 - (618)
 CHIEF ROAD DESIGN ENGR. ADOPTED: 8/89 REVISION: 5 - 1/76

See note number 6 on sheet R-8.1.1

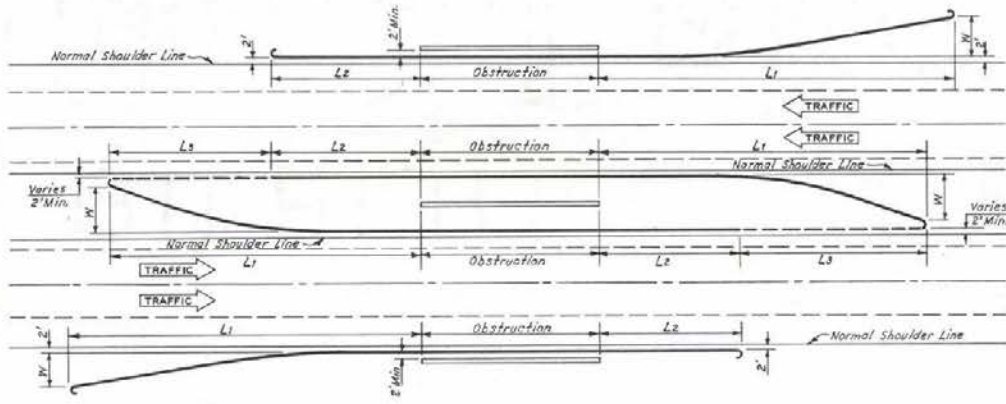


4 LANE DIVIDED HIGHWAY

DIMENSION	MINIMUM
W	4'
L1	75' or 10W (Use larger value)
L2	50' (Use 6' min. with end anchor)
L3	L1 minus L2 (Install when guardrail is adjacent to obstruction and/or terminal ends are within 30' of travel lane)

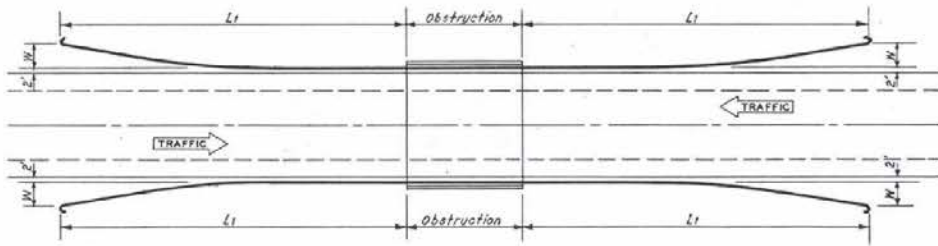


2 LANE HIGHWAY

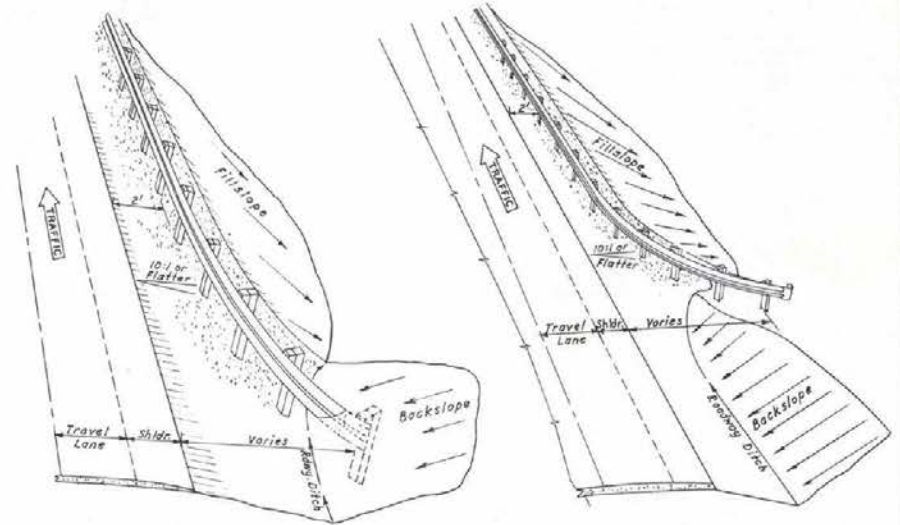


APPROACH END BURIED IN BACKSLOPE*

* See Note 5, Sheet R-8.1.1

APPROACH END POSITIONED BEHIND BACKSLOPE

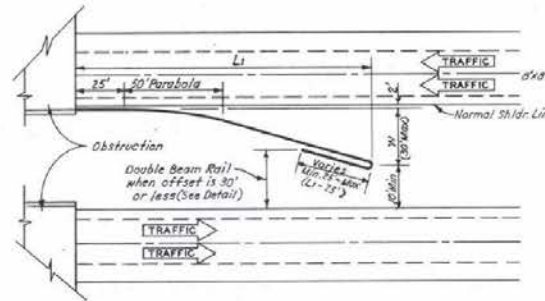

DUAL BRIDGE WITH OPEN MEDIAN
(Median Slopes = 10:1 or flatter)

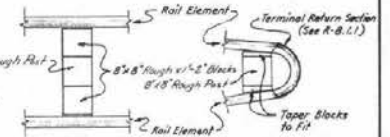


DOUBLE BEAM RAIL DETAIL

See Sheet R-8.1.1 for General Notes.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


GUARDRAIL
INSTALLATION


 R-8.1.3 (618)
 ADOPTED 8/69 REVISION 4 7/79

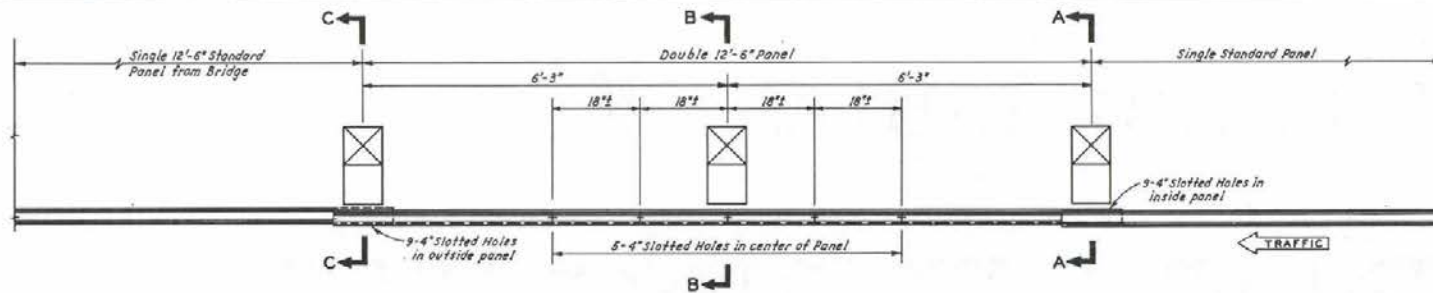


NOTE: All bolts through slotted holes should be torqued to 240 inch pounds or 20 foot pounds, or "finger tight" plus 1/2 turn.


PLAN

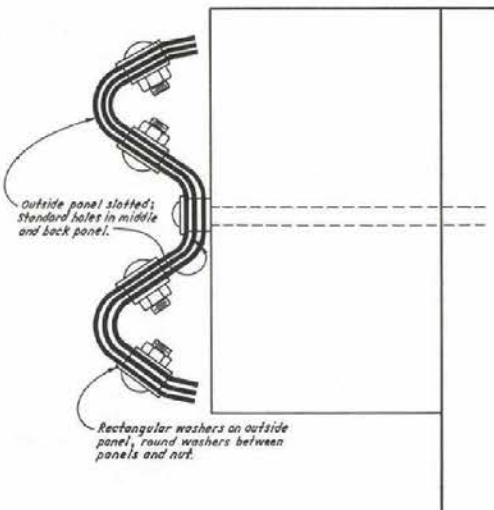

SECTION C-C

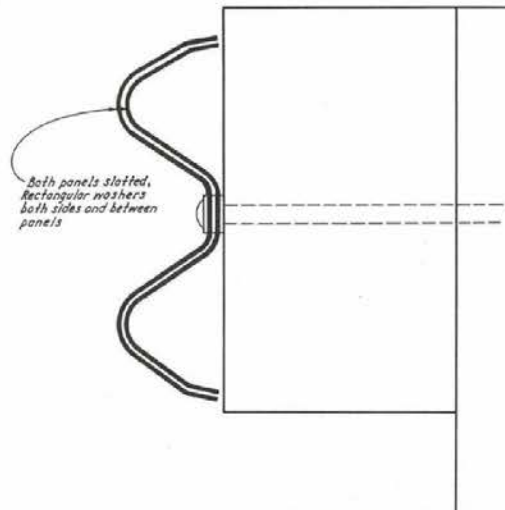

SECTION B-B

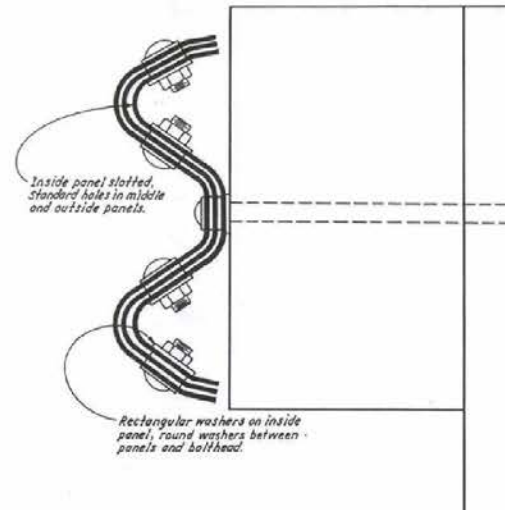

SECTION A-A




GENERAL NOTES

1. Use expansion joint only when guardrail is rigidly attached to a structure and the length of guardrail run is 150' or greater.
2. In the case of continuous guardrail between structures, allow one expansion joint located at midpoint for lengths 300' or less and two expansion joints for lengths in excess of 300'.
3. See Sheet R-6.1.1 for additional General Notes.
4. See sheet R-6.1.2 (Typical Approach Installation Detail) for placement of Expansion Joint.




STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

GUARDRAIL EXPANSION
JOINT DETAILS

R-6.1.4 - (618)
ADOPTED: 6/69 REVISION: 3-1/76
CHIEF ROAD DESIGN ENGR.

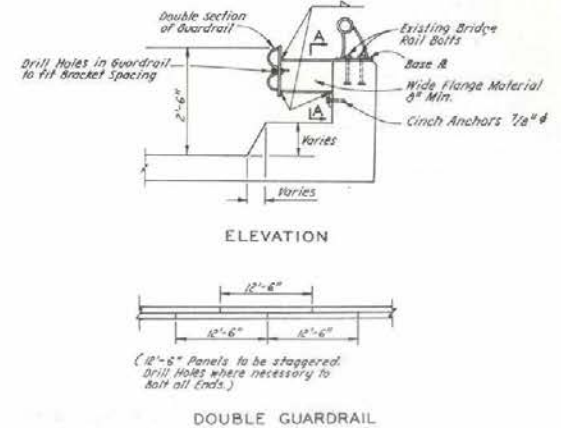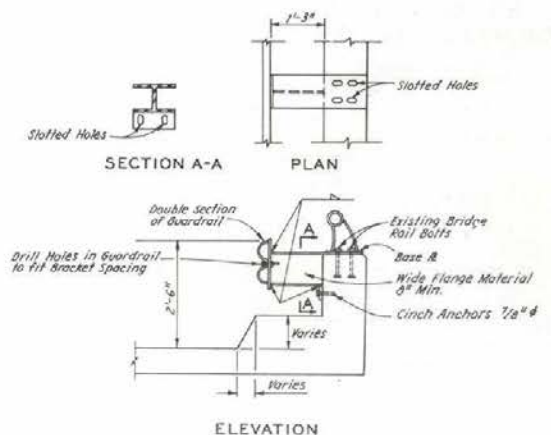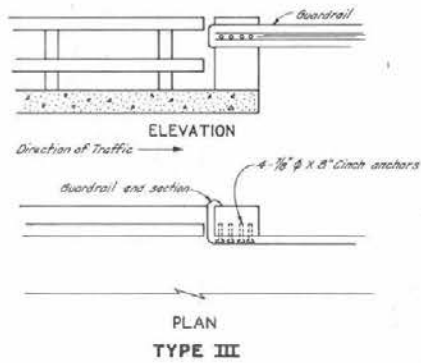


1. WHEN BRIDGE SAIL IS REPLACED WITH GUARDRAIL, THE EXISTING PIPE RAIL SHALL BE REPLACED ON TOP OF THE ASSEMBLY. IF THE ANCHOR BOLTS ARE NOT LONG ENOUGH, THE RAIL FOOT MAY BE WELDED TO THE BRACKETS.
2. USE GALVANIZED SHIMS FOR ADJUSTING VERTICAL AND HORIZONTAL ALIGNMENT OF BRACKETS.

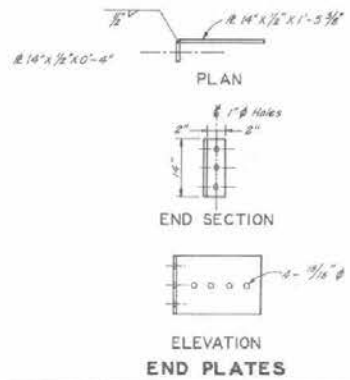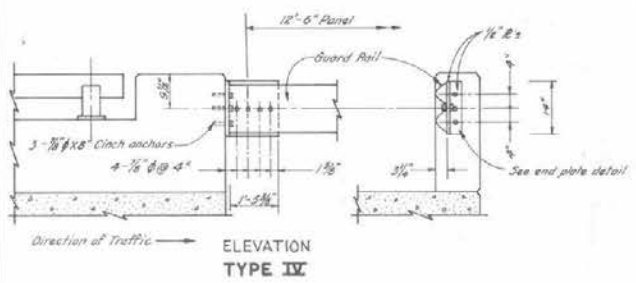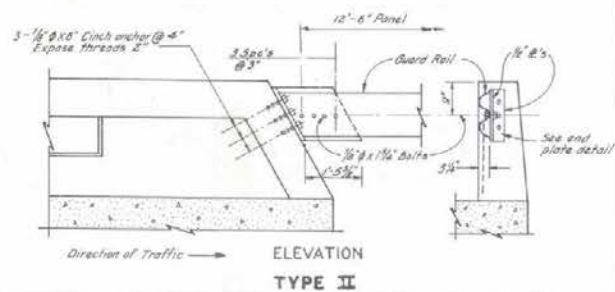


- GENERAL NOTES
1. TYPE I ATTACHMENTS SHALL BE USED ON STRUCTURES WITH PARAPET CURBS ONLY.
 2. TYPE II, III AND IV ATTACHMENTS SHALL BE USED ON STRUCTURES WITHOUT PARAPET CURBS.
 3. FOR STRUCTURES WITHOUT CURBS AND WITH A CURVED END POST, A SPECIAL GUARDRAIL ATTACHMENT SHOULD BE DETAILED BY THE BRIDGE DIVISION.
 4. SEE STANDARD GUARDRAIL SHEET 8-8.1.2 FOR POST SPACING AND STANDARD SHEET 8-8.1.4 FOR EXPANSION JOINT DETAILS.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**METHODS FOR ATTACHING
GUARDRAIL TO EXISTING
BRIDGE STRUCTURES**


 CHIEF ROAD DESIGN ENGINEER	R-8.1.5 (618) ADOPTED 12/72 REVISION 1/73
---	---

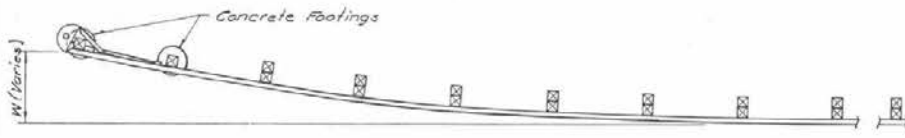



PLAN

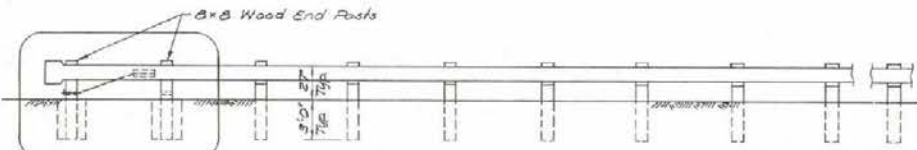


ELEVATION

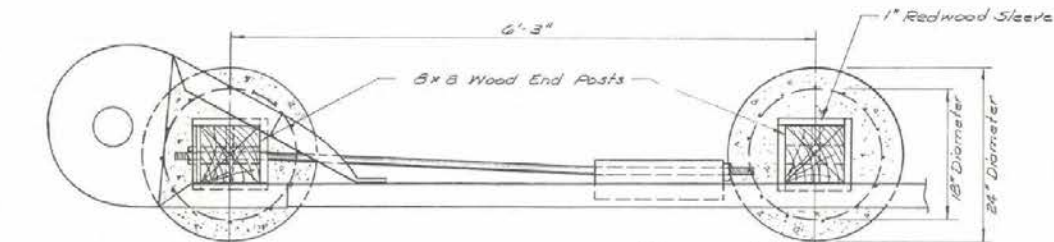


DETAIL "A"

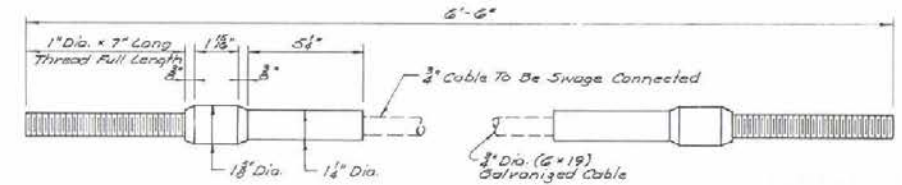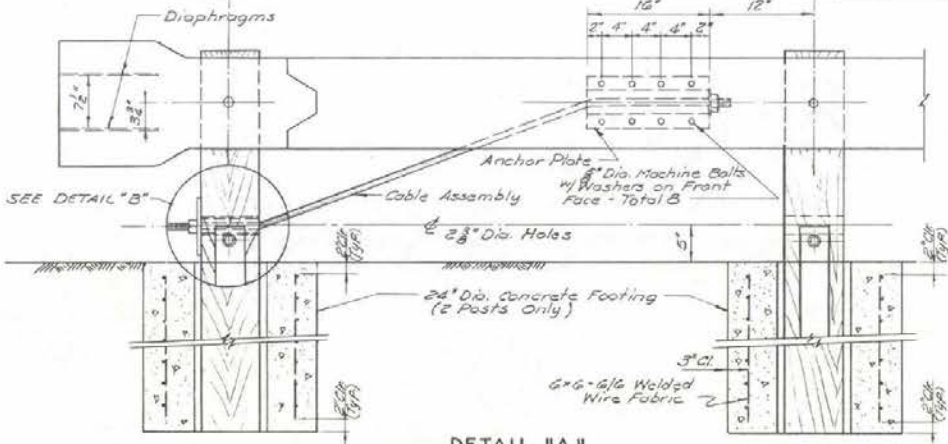


CABLE ASSEMBLY

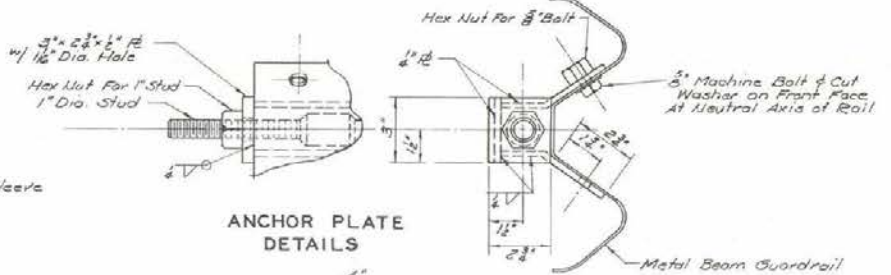

ANCHOR PLATE DETAILS

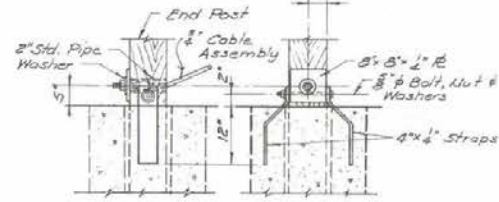

DETAIL "B"

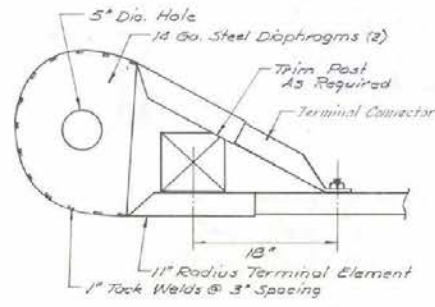

DIAPHRAGM DETAILS


- GENERAL NOTES —
1. POST SPACING SHALL BE 6' - 3" EXCEPT AS OTHERWISE NOTED.
 2. FOR DETAILS NOT SHOWN REFER TO STANDARD GUARD RAIL SHEETS.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

BREAKAWAY CABLE
TERMINAL


Robert B. Shaver
CHIEF ROAD DESIGN ENGR

R-8.16 (618)
ADOPTED 7/73 REVISION

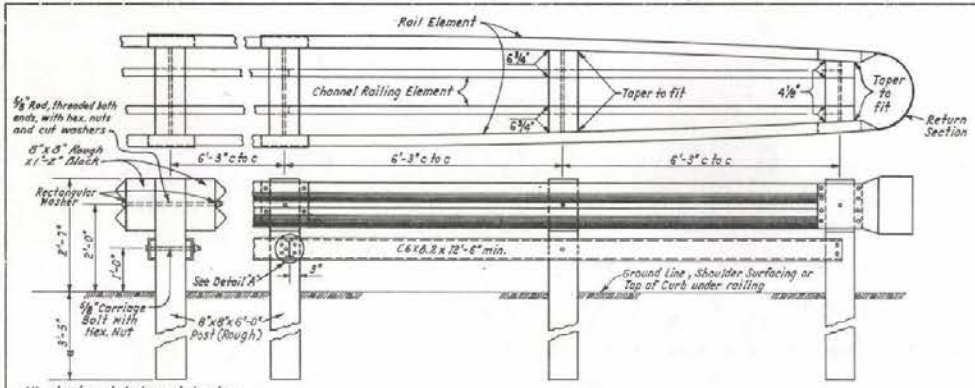


TIMBER POST MEDIAN BARRIER RAIL


All nuts shown to be hex and placed on outside except rail splice bolts.

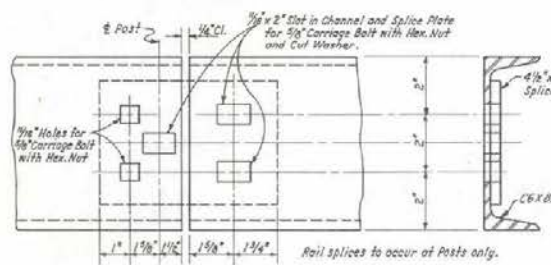


DETAIL 'A' - CHANNEL RAIL SPLICE

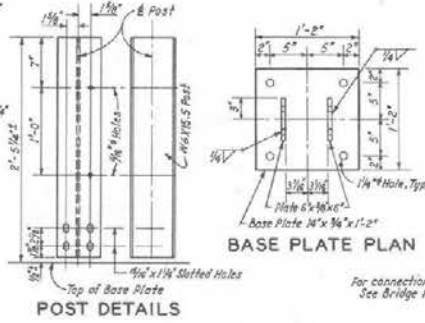


METAL POST MEDIAN BARRIER RAIL

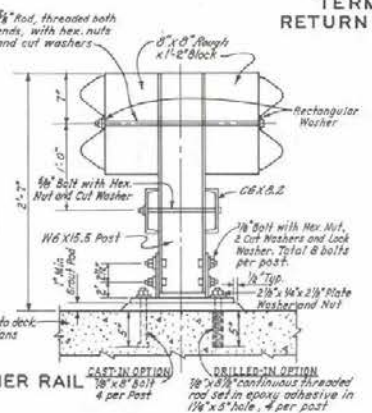


TERMINAL RETURN SECTION

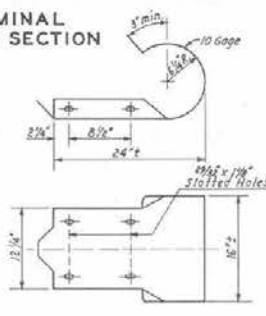

TERMINAL SECTION

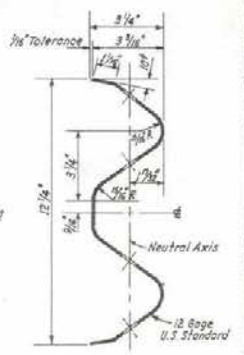


SECTION THRU RAIL ELEMENT

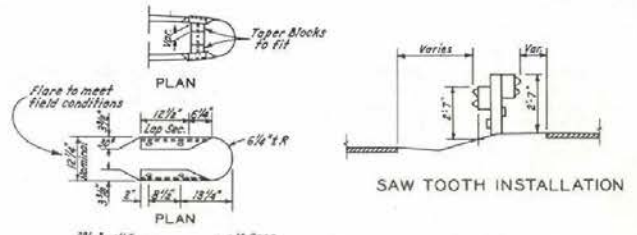


SAW TOOTH INSTALLATION

R 55

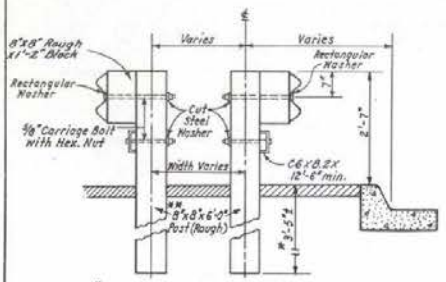


SINGLE METAL BEAM BARRIER RAIL


* Depth varies where bridge piers are located on continuous footings.
 ** On bridge deck use W6X15.5 Post (See Double Rail Detail For applicable details).

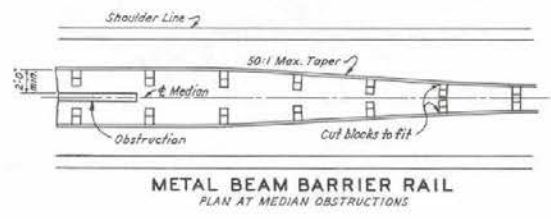

METAL BEAM BARRIER RAIL
 PLAN AT MEDIAN OBSTRUCTIONS

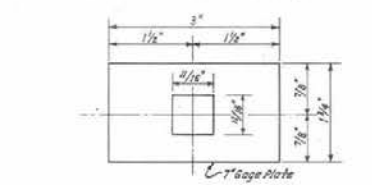

RECTANGULAR POST BOLT WASHER

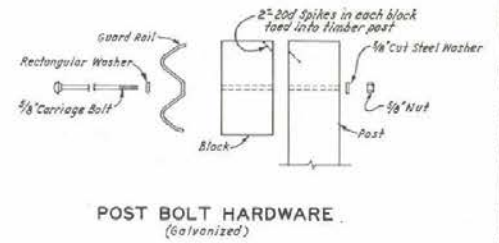

POST BOLT HARDWARE
 (Galvanized)


NOTE: See Sheet R-8.1.1 for "General Notes" and "Reflector Plate Details", Sheet R-8.1.2, "Typical Approach Installation" for method of attachment to structures, and Sheet R-8.1.4 for "Expansion Joint" details.

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

METAL BEAM BARRIER RAIL

Paul L. Hoop
 CHIEF ROAD DESIGN ENGINEER


R-8.2.1-(618)
 ADOPTED: 6/69 REVISION: 4/75

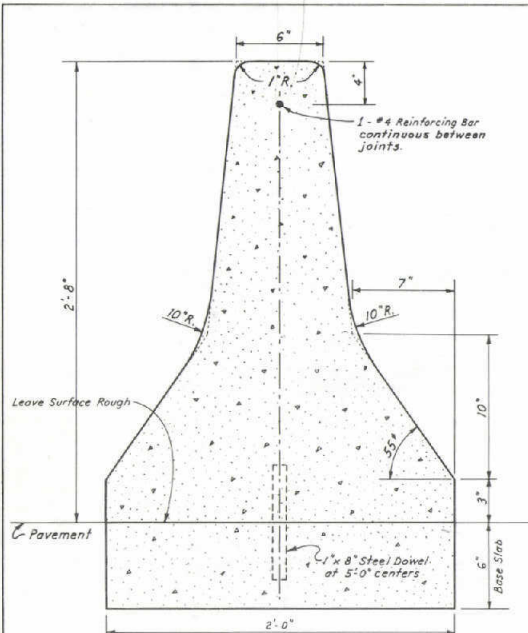

(SECTION)
TYPE A

Concrete (Information Only)
0.1032 Cu. Yd. Per Lin. Ft. without Base Slab
0.1402 Cu. Yd. Per Lin. Ft. with Base Slab

① Dimension used when barrier is placed against rock or solid object such as a retaining wall.

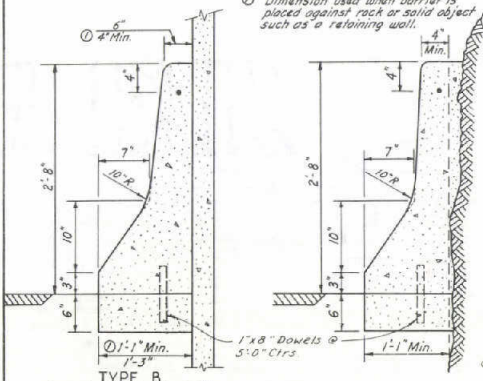


TYPE B


Concrete (Information Only)

4" Min. { 0.0590 cu. yd. per lin. ft. without Base Slab
0.0881 cu. yd. per lin. ft. with Base Slab
6" Min. { 0.0765 cu. yd. per lin. ft. without Base Slab
0.1090 cu. yd. per lin. ft. with Base Slab


TYPE C

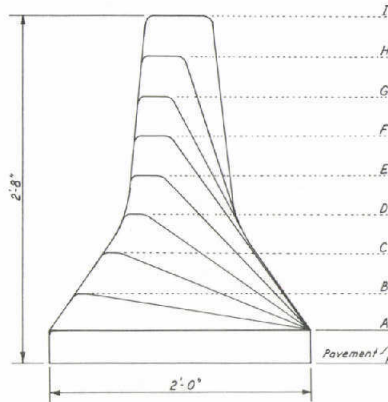

APPROACHING TRAFFIC DETAIL

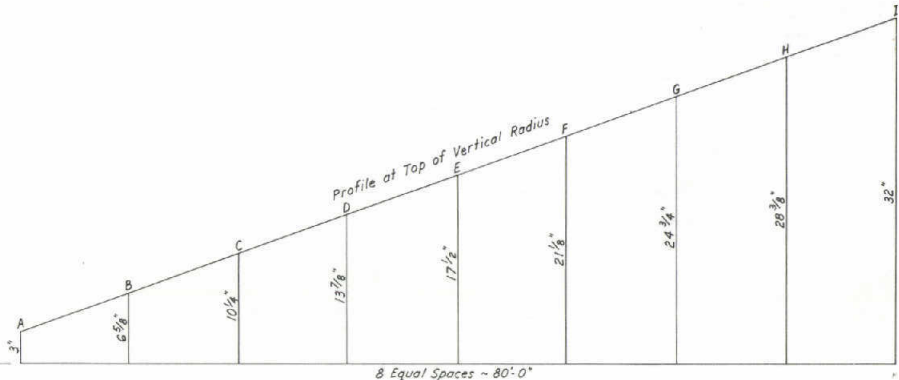


TRANSITION OF APPROACH END OF BARRIER

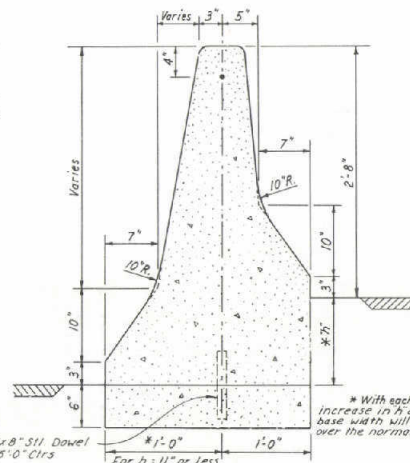


TYPE D

* With each 6" increment increase in H elevation, the base width will increase 2" over the normal 1'-0" Dim.




UNDERPASS

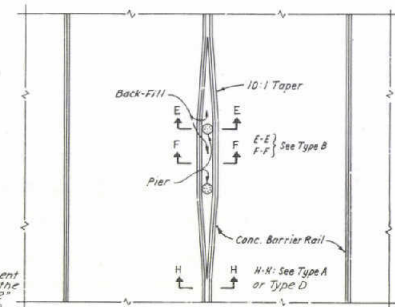


VIEW G-G

TREATMENT AT UNDERPASS PIERS



SEC. E-E



SEC. F-F

GENERAL NOTES

1. CONCRETE BASE SHALL BE CLASS A OR AA.
2. 6" BASE SLAB SHALL BE DELETED WHEN BARRIER RAIL IS PLACED ON A CONCRETE SURFACE. THE 1" x 8" DOWELS (AS SHOWN) WILL BE REQUIRED WHEN PLACED ON A CONCRETE SURFACE. THE SURFACE OF CONCRETE SHALL BE CLEAN PRIOR TO PLACEMENT OF BARRIER RAIL.
3. TRANSVERSE JOINTS WITH 1" PREMOULDED EXPANSION JOINT FILLER OR 1" OPEN TRANSVERSE JOINTS SHALL BE PLACED AT STRUCTURES. JOINTS IN BARRIER RAIL OVER A STRUCTURE SHALL BE AT THE SAME LOCATION AND OF THE SAME DIMENSION AS THOSE IN THE STRUCTURE.
4. AT THE CONTRACTOR'S OPTION, THE BASE SLAB AND BARRIER MAY BE POURED MONOLITHIC, IN WHICH CASE THE DOWELS SHALL BE DELETED.
5. ALL EXPOSED SURFACES SHALL HAVE A "FINE SURFACE FINISH"
6. SEE SHEET R-8.4.1 FOR CONCRETE BARRIER RAIL GLARE SCREEN DETAILS.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CONCRETE BARRIER RAIL

Robert L. Sharp
CHIEF ROAD DESIGN ENGR.

R-8.3.1 (502)

ADOPTED: 11/70 REVISION
6 1-75

R 56A








TABLE B
SPACE DIMENSIONS

No.	A	B	C	D
1	6"	3 3/4"	3 3/4"	6"
2	6 5/8"	3 3/4"	3 3/4"	6 5/8"
3	4 1/4"	1 7/8"	1 3/4"	3 5/8"

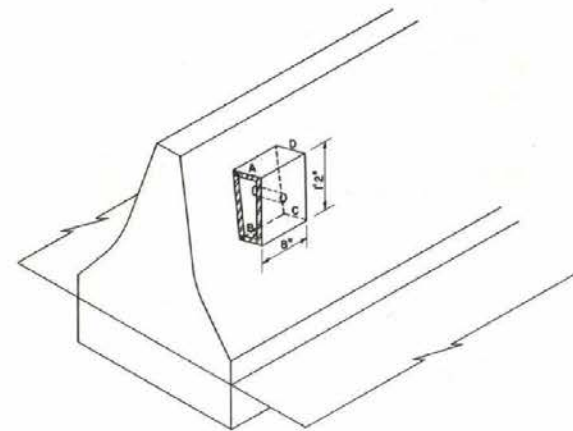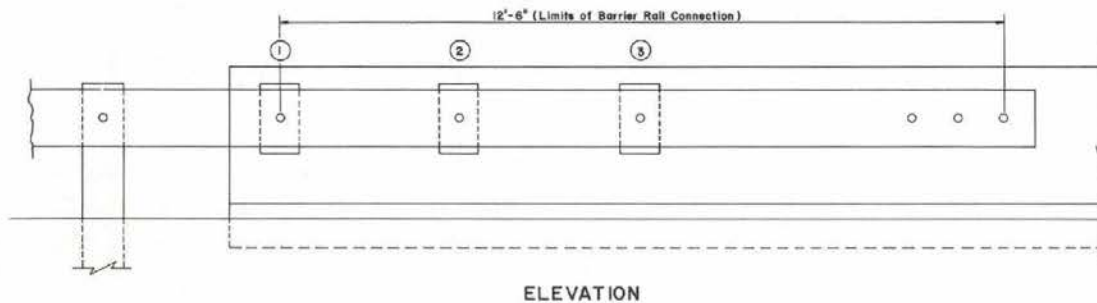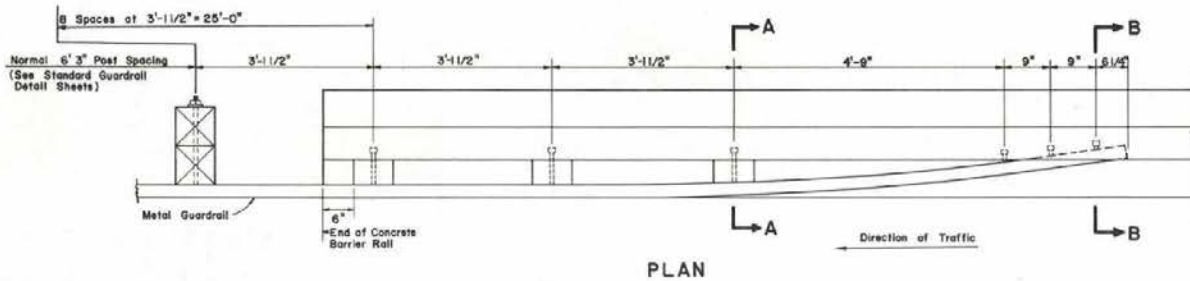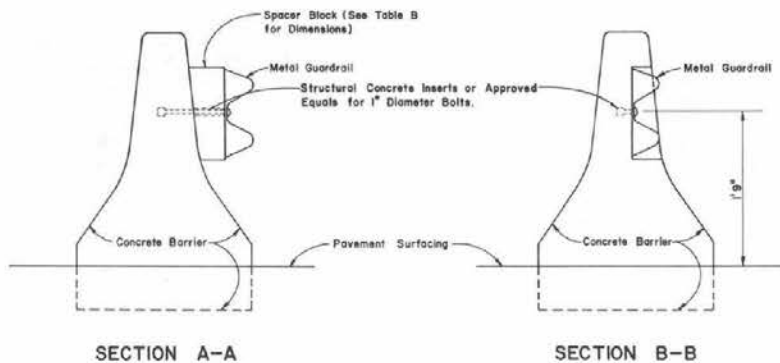





- GENERAL NOTES:
- FOR CONCRETE BARRIER RAIL DETAILS, SEE STANDARD SHEET NUMBER R-8.3.1.
 - FOR GUARDRAIL DETAILS, POST SPACING AND INSTALLATION PROCEDURES, SEE STANDARD SHEET NUMBERS R-8.1.1 THRU R-8.1.4.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**BARRIER RAIL
CONNECTION**

Robert L. ...
CHIEF ROAD DESIGN ENGINEER

R-8.3.2 (502)
ADOPTED 9/75 REVISION

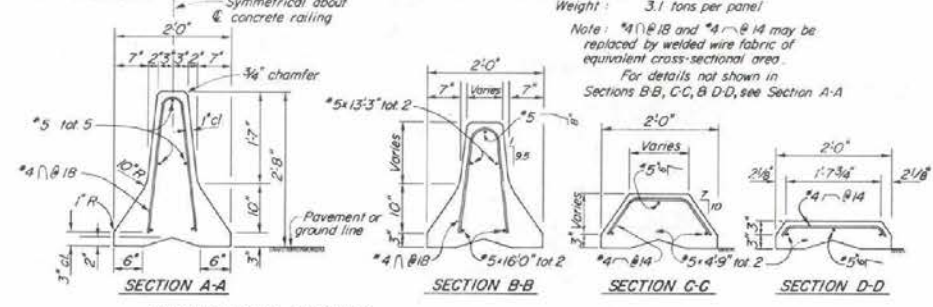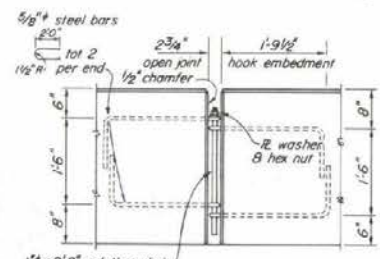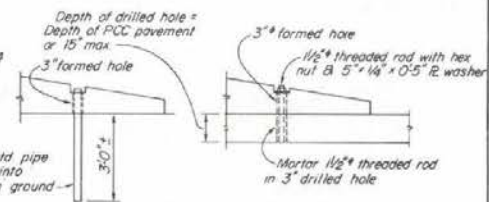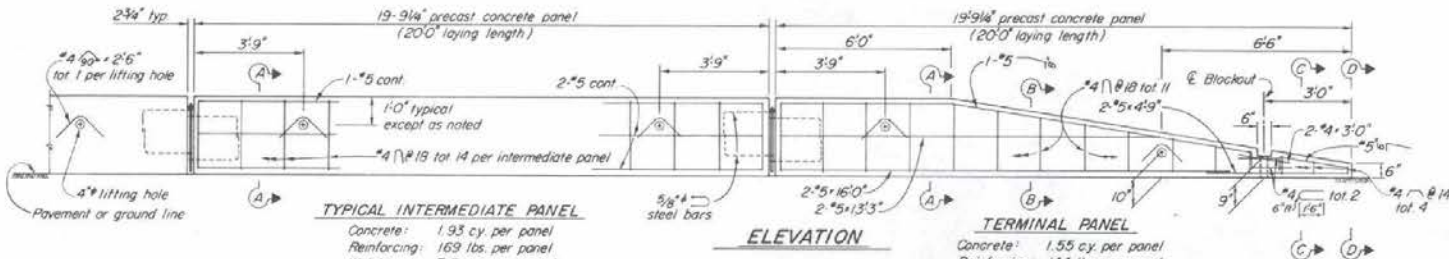

GENERAL NOTES:






- All bolts to have cut washer unless otherwise stated.
- Alternative details for lifting the precast concrete panels of the Temporary Railing may be submitted by the Contractor for the Engineer's approval.

R 568

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS


**PORTABLE PRECAST
 CONCRETE
 BARRIER RAIL**

R-8.3.3. (502)
 ADOPTED 1/76 REVISION

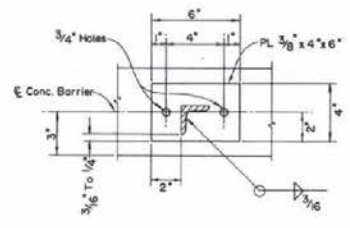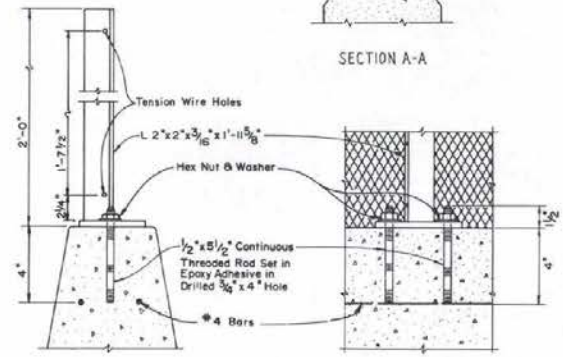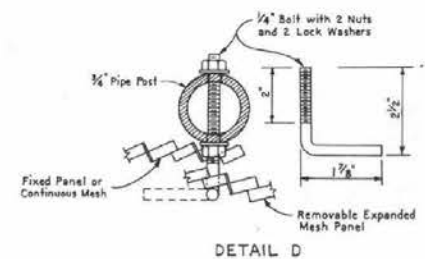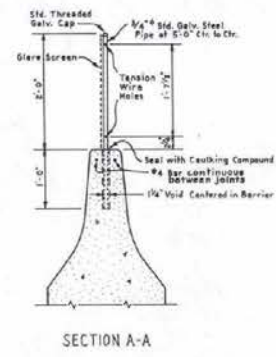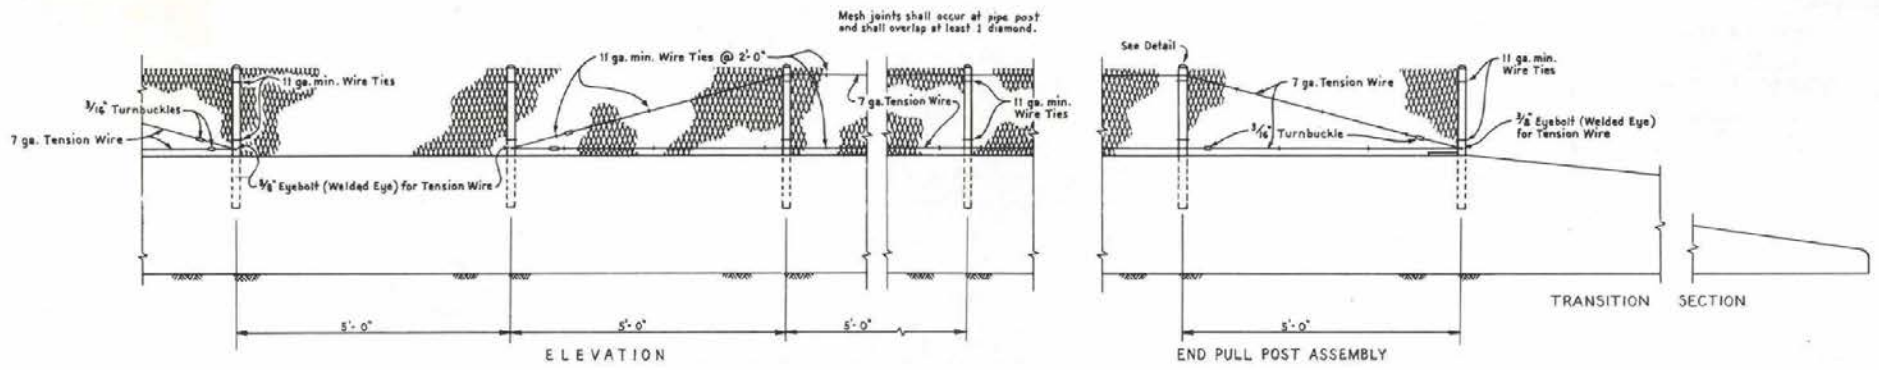


STATE OF NEVADA DEPARTMENT OF HIGHWAYS	
HEADLIGHT GLARE SCREEN (TYPE B)	
R-8.4.1 (632)	REVISION
ADOPTED: 6/70	/ 1/72

Robert L. Shroy
CHIEF ROAD DESIGN ENGR.

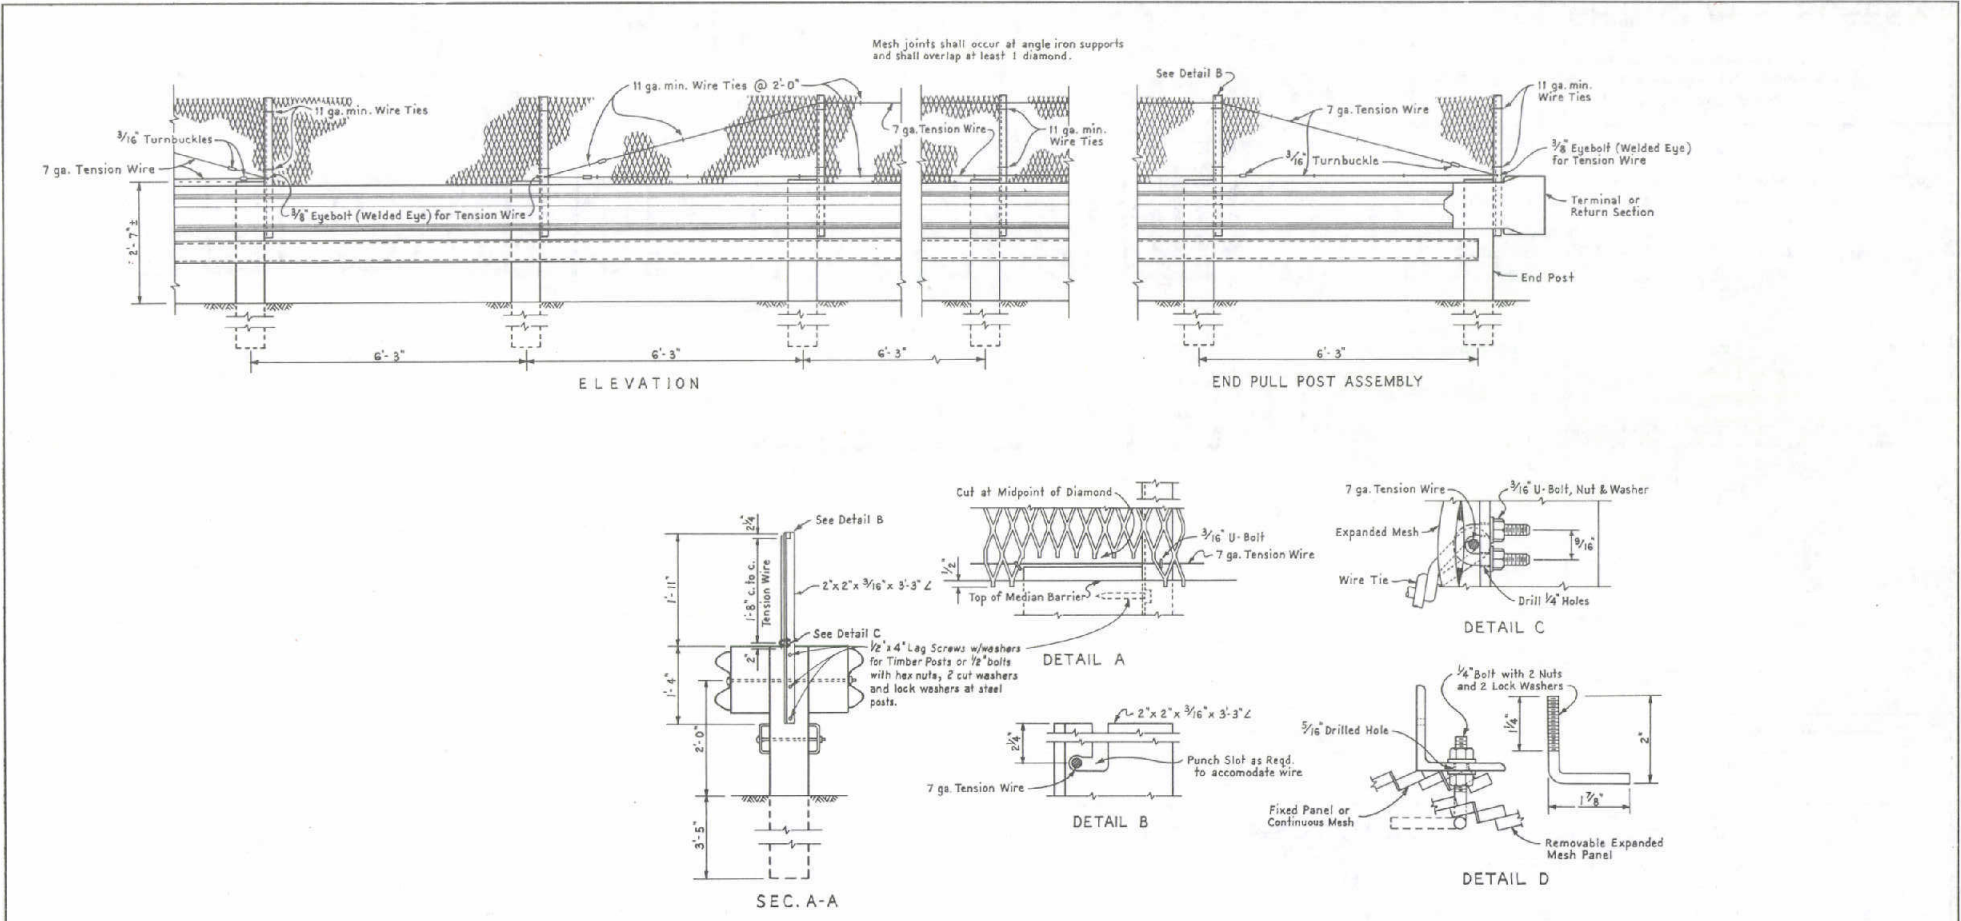

STATE OF NEVADA DEPARTMENT OF HIGHWAYS	
HEADLIGHT GLARE SCREEN (TYPE A)	
<i>Robert L. Hooper</i> CHIEF ROAD DESIGN ENGR.	R-B.4.2 (632) ADOPTED 1/69
REVISION	1/76

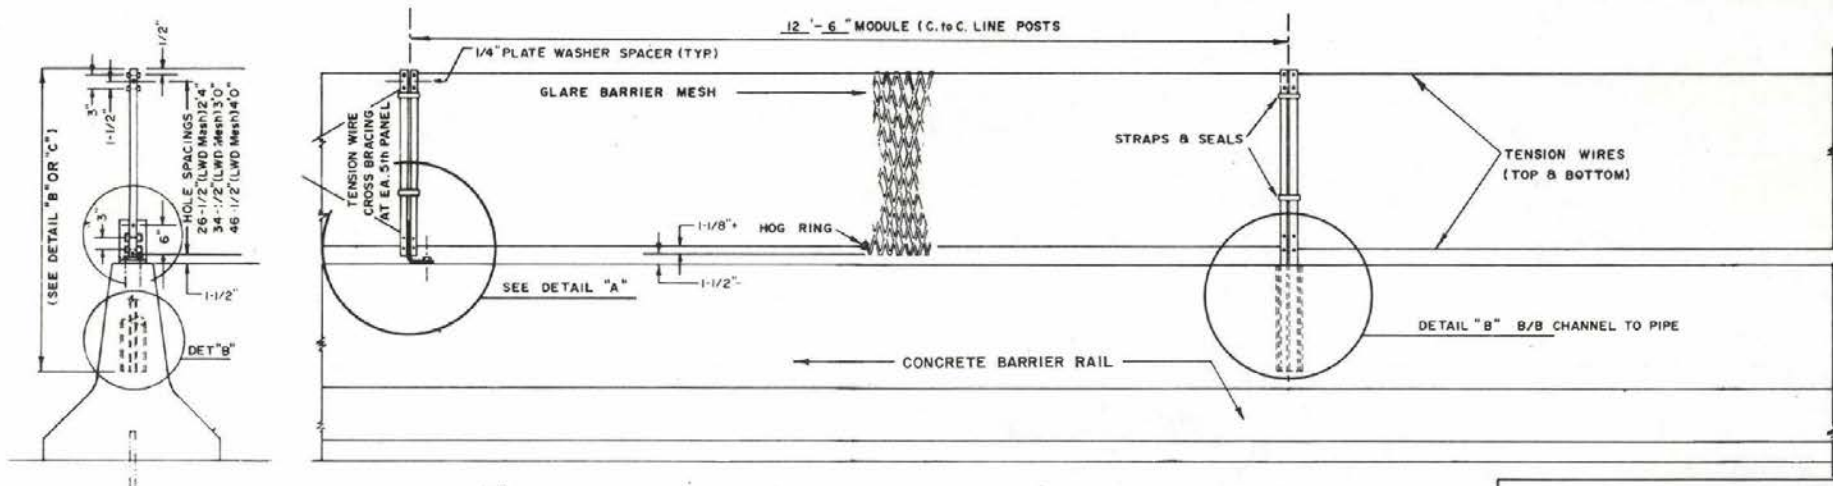


SECTION THRU BARRIER

$\frac{1}{2}$ ϕ x 2" HEX HEAD CAP SCREWS $\frac{1}{4}$ HEX NUT, $\frac{3}{16}$ ϕ HOLE DRILLED THROUGH STEM
 FERRULE FOR TENSION TAKE-UP
 WIND WIRE APPROX. THREE (3) TURNS AROUND FERRULE (TYP.)
 $\frac{9}{16}$ " I.D. X $1\frac{3}{16}$ " LONG X 14 GA. $\frac{1}{4}$ $\frac{3}{16}$ " NOTCH IN ENDS
 CRIMP 12" to 18" O.C.
 TENSION WIRE
 STEEL STRAP
 LINE POST TWO PC. B/B CHANNELS, $1\frac{7}{16}$ x $1\frac{1}{8}$ x 11 GA.
 $\frac{1}{2}$ ϕ x 1" HEX HEAD BOLT $\frac{1}{4}$ HEX NUT
 EXPANSION TYPE BOLT
 $\frac{1}{4}$ " SUPPT. BRACKET SEE DETAIL "C"
 HOG RINGS SPACED APPROX. 2' APART

-DETAIL "A"-

-DETAIL "B"-

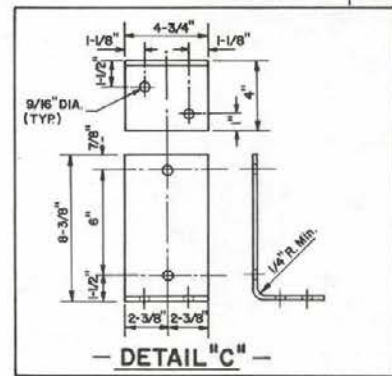


GENERAL NOTES

1. SEE SHEET R-8.3.1 & R-8.4.1 FOR CONCRETE BARRIER RAIL DETAILS.
2. METHOD OF ATTACHING GLARE SCREEN TO CONCRETE BARRIER RAIL IS OPTIONAL (EITHER DETAIL "A" OR DETAIL "B").

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**HEADLIGHT GLARE SCREEN
(TYPE C)**


Robert J. Davis
 CHIEF ROAD DESIGN ENGINEER
 R-8.4.3. (632)
 ADOPTED 10/75 REVISION

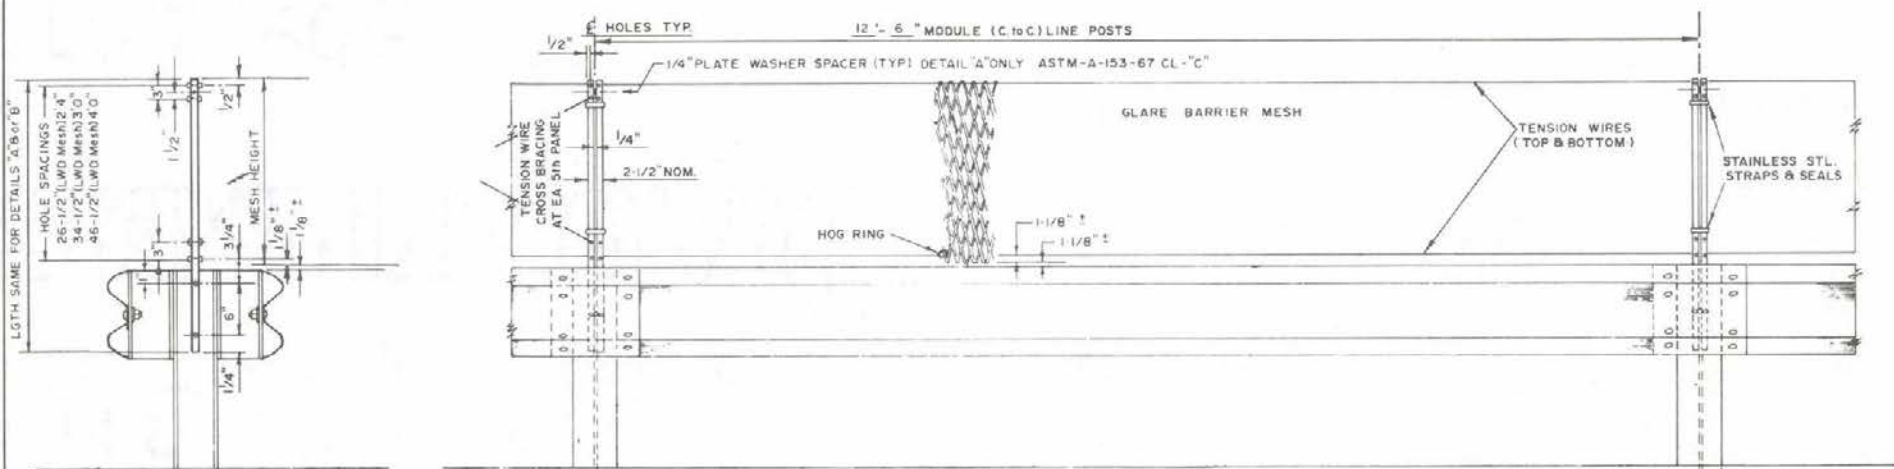

- SECTION THRU BARRIER -

DETAIL "A" (BELOW) ILLUSTRATES STEEL POST. DETAIL "B" SHOWS THE GLARE BARRIER SUPPORTED BY 8"x8" WOOD POSTS.



FERRULE FOR TENSION TAKE-UP
 WIND WIRE APPROX. THREE (3) TURNS AROUND FERRULE (TYP.)
 9/16" I.D. X 1 3/16" LONG X 14 GA.
 W/ 3/16" NOTCH IN ENDS.

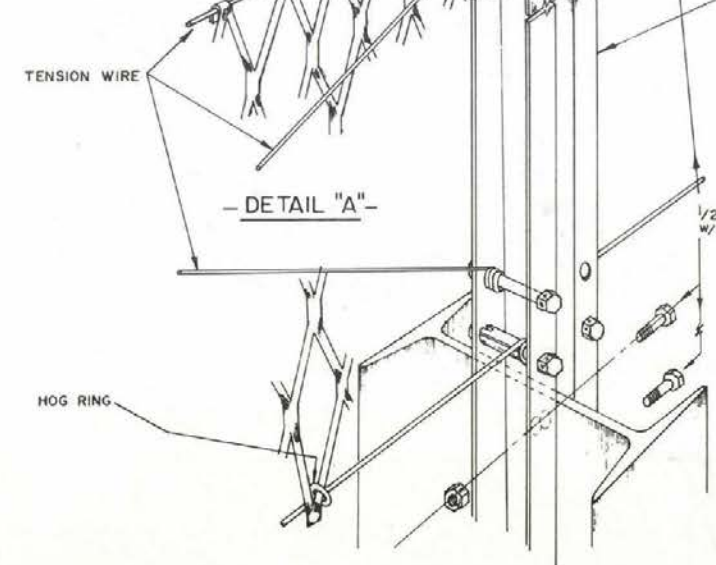

1/2" φ x 2" HEX HEAD CAP SCREWS 3/4" HEX NUT, 3/16" φ HOLE DRILLED THROUGH STEM.

LINE POST TWO PC. B/B-CHANNELS, 1 7/16" X 1 1/8" 11 GA.


1/2" φ X 1" HEX HEAD BOLT W/HEX NUT (3-REQUIRED)

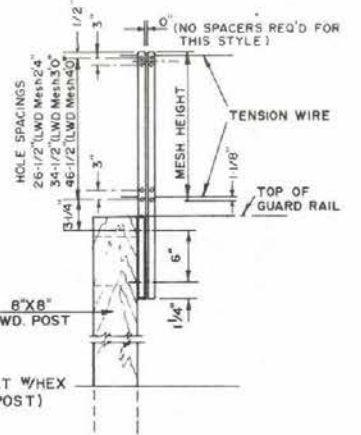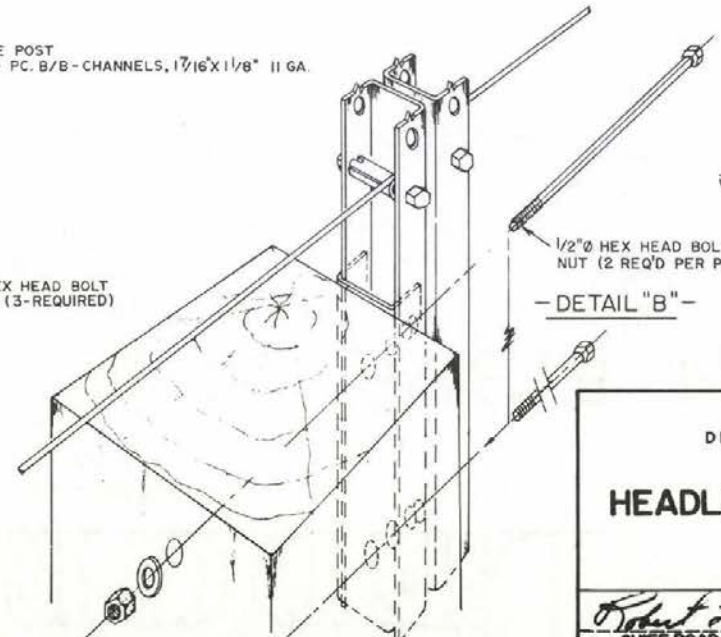


STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

HEADLIGHT GLARE SCREEN (TYPE D)


Robert L. Sharp CHIEF ROAD DESIGN ENGINEER	R-8.4.4. (632) ADOPTED 8/10/75 REVISION
---	--

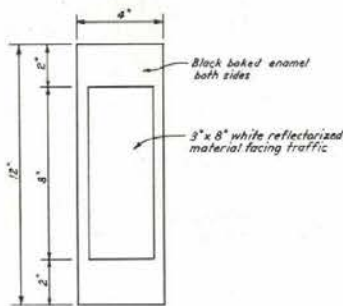


TYPE 1
(Roadway)

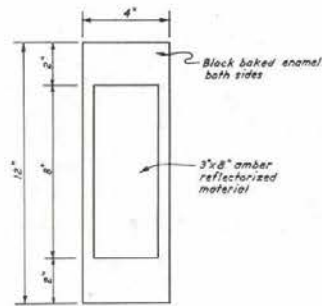

REFLECTORS
TYPE 2
(Ramps or Approaches)

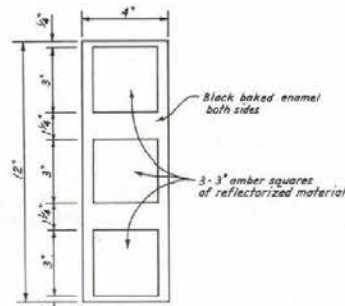

TYPE 3
(Islands, Curbs, Shoulder Dikes)

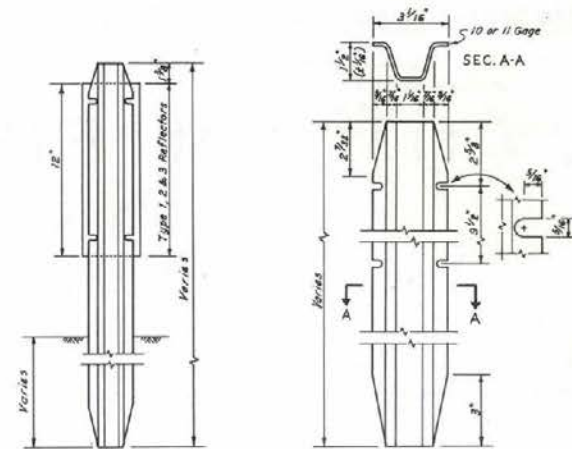

POST DETAILS

Multi-Lane Divided Highway:

(Freeway Standards)
Unless otherwise noted on plans, guide posts on divided highways shall be set as follows:

a) On tangents, guide posts shall be installed along the sides of the through roadways at approximately 800 foot spacing along the median side and 400 foot spacing on the outside shoulder. The posts on the median side shall be placed opposite those on the outer shoulder.

b) See Table 1 for spacing on curves.

Two Lane and Four Lane Undivided Highways:

(Secondary and Primary)
a) Guide posts shall be installed on both sides of the roadway at 400 foot intervals on tangents and on curves having a radius greater than 10,000 feet.

b) See Table 1 for spacing on curves.

Multi-Lane Divided Highway:

(Freeway Standards)
a) At interchanges, guide posts with amber reflectors shall be installed at a maximum spacing of 100' along the ramp acceleration or deceleration lanes and in accordance with Table 1 on turning ramps. They shall always be installed on the outside of the curve for turning ramps and may be used on both sides when needed for clear indication of alignment.

b) In rural areas where median crossovers are provided for official or emergency use, a single guide post with amber reflectors shall be placed on the left side of the through roadway on the far side of the crossover for each roadway.

All Approaches:

Where approaches are permitted, one guide post with amber reflectors shall be installed at the beginning and end limits of Type 1 and Type 2 approaches.

GENERAL:

a) At traffic islands, curbs, shoulder dikes, etc., a single guide post with triple amber reflectors shall be installed.

b) In urban or suburban areas where a raised and curbed median is provided, each project should be investigated to determine whether or not guide posts will be needed in the median.

MAXIMUM SPACING FOR HIGHWAY DELINEATORS
ON HORIZONTAL CURVES

Distance in Feet Rounded to the Nearest 5 Feet			
RADIUS OF CURVE (IN FEET)	SPACING OF CURVE (IN FEET)	SPACING IN ADVANCE & BEYOND CURVE (IN FEET)	
50	20	40	65
150	30	60	90
200	35	70	110
250	40	80	125
300	45	90	145
400	55	110	170
500	65	125	190
600	70	140	210
700	75	150	230
800	80	165	245
900	85	175	260
1,000	90	185	275
1,200	100	200	300
1,400	110	220	300
1,600	120	240	300
1,800	125	250	300
2,000	130	260	300
2,500	150	300	300
3,000	165	300	300
5,000	210	300	300
10,000	300	300	300

Spacing for specific radii not shown may be interpolated from table or computed from the formula $S = \sqrt{R^2 + C^2}$. The minimum spacing should be 20 feet. The spacing on curves should not exceed 300 feet. The spacing of the first delineator approaching a curve is 2 S, the second S, and the third S but not to exceed 300 feet. If a spacing less than 300 feet is used approaching the curve, the distance shown above should be adjusted accordingly.

Placement of Guide Posts on Curves

Multi-Lane Divided Highway:


(Freeway Standards)
a) On curves, they shall be installed along both sides of the through roadways at 400 foot spacing on the outside shoulder and 800 foot spacing on the median shoulder for curves having a radius of more than 10,000 feet. For curves of 10,000 feet radius or less, they shall be spaced as shown in Table 1. The posts on the median side shall be placed directly opposite those along the outer shoulder. The spacing on the median side shall be adjusted where approaching or leaving a curve to accomplish the alternated spacing to be used on all tangents.

Two Lane and Four Lane Undivided Highway:

(Secondary and Primary)
a) On curves having a radius of 10,000 feet or less, guide posts shall be installed on the outside of the curve at the spacing shown in Table 1 and on the inside of the curve at double the spacing shown in the table.

b) Post spacing on recreational roadways may be varied to accommodate design considerations.

Note: Guide posts shall be installed at the beginning and end of each curve and the spacing adjusted, through the length of the curve, into equal spacing nearest to that specified in Table 1.

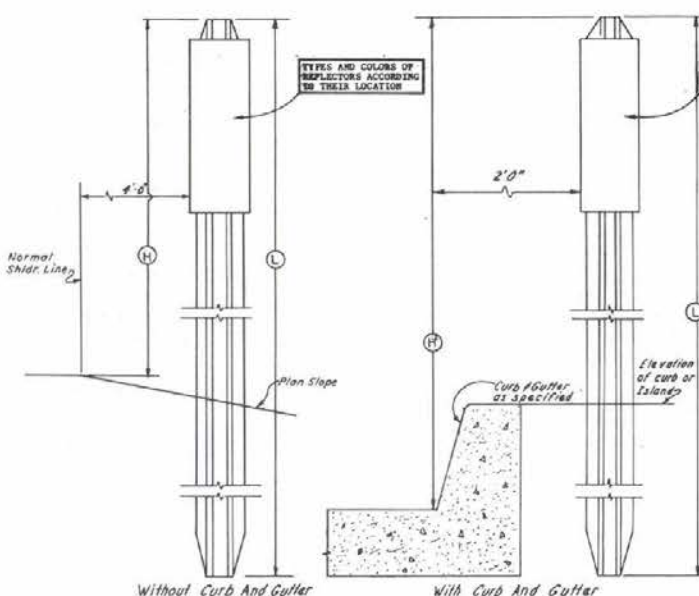

TYPICAL INSTALLATION

TYPES AND COLORS OF REFLECTORS ACCORDING TO THEIR LOCATION

TYPES AND COLORS OF REFLECTORS ACCORDING TO THEIR LOCATION

L = 5'6" WHEN R = 3'6"
L = 5'0" MIN WHEN R = 3'0"
R = 3'0" STANDARD HEIGHT FOR ALL ROADWAYS
H = 3'0" ABOVE GUTTER ELEVATION IN CURB & GUTTER SECTIONS

General Notes:

1. Where guardrail is to be installed, guide posts shall be white and reflector plates shall be installed (see Sheet R-8.1.1).


TABLE 1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

GUIDE POSTS

Robert L. ...
CHIEF ROAD DESIGN ENGINEER


R-9.1.1-(619)
ADDED: 8/68 REVISION
8-67/72

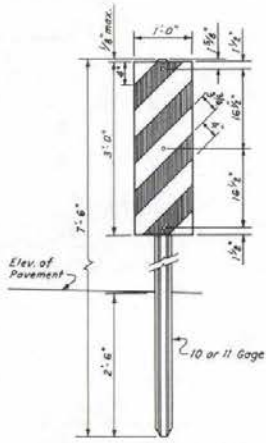

TYPE 3
Bridges, Piers, Abutments


Front: Facing traffic, alternating black and reflectorized white stripes sloping down at an angle of 45°. Lower edge of obstruction on which traffic will pass.

Back: Solid white.




Object markers shall be installed to delineate bridge ends, underpass abutments and all other obstructions closely adjacent to the edges of the roadway. They may be omitted on the approach end of the guardrail when a flare is used.


For post details see Sheet R-3.1.1

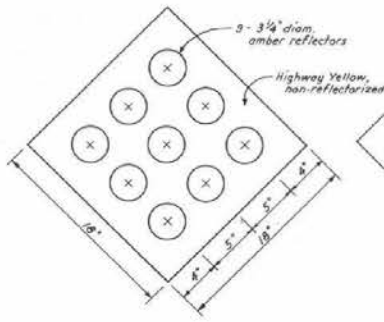

TYPE 1
Median Obstructions

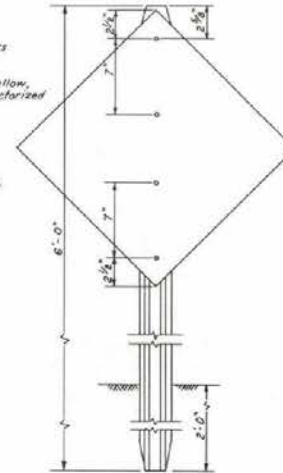


Type 3 Reflector Plate Mounted Horizontally. See Sheet R-3.1.1 For Plate and Post Details.

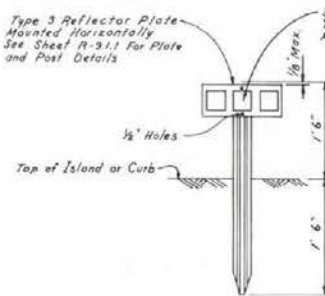

TYPE 2
Curbs or Inlets

OBJECT MARKERS


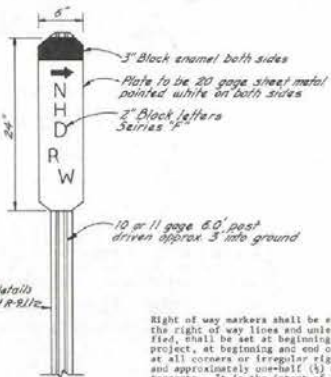


For post details see Sheet R-3.1.2


Right of way markers shall be erected to define the right of way lines and unless otherwise specified, shall be set at beginning and end of each project, at beginning and end of each curve, and at all corners or irregular right of way lines, and approximately one-half (1/2) mile apart on long tangents. It is the intent of these requirements that right of way markers are spaced so as to be clearly visible and erected so that the right of way line may be easily established.

Right of way markers shall be omitted where right of way line is fenced.

RIGHT OF WAY MARKERS

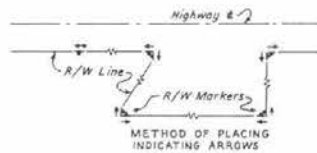


R/W INDICATING ARROWS




* In solid rock, drill 1 1/2" x 4" hole and grout disc as shown.

These monuments shall be set to assist in re-establishment of the meridian for future use and shall be set at the beginning and end of each project, at the beginning and end of each curve, and approximately one-half (1/2) mile apart on long tangents.


REFERENCE MONUMENT AND MARKER POST



CAST COVER DETAIL




WELDED COVER DETAIL
SURVEY MONUMENTS



STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**OBJECT MARKERS,
RIGHT OF WAY MARKERS,
SURVEY MONUMENTS AND
REFERENCE MONUMENTS**

R-9.21-(619 THRU 621)
ADOPTED: 1/60
REVISION 1/11/72

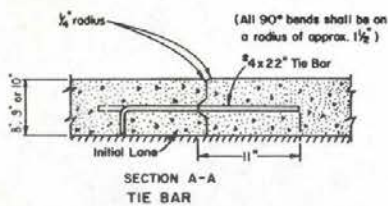


TRANSVERSE CONTACT JOINT WITH KEYWAY AND TIE BARS


NOTE - Transverse Contact Joints with Keyway and Tie Bars shall be used at all construction joints, and elsewhere if ordered by the Engineer. Tie Bars to be placed in the middle 1/3 of the slab thickness.





DETAIL OF METAL OR WOODEN INSERT TO BE PLACED ON FORM

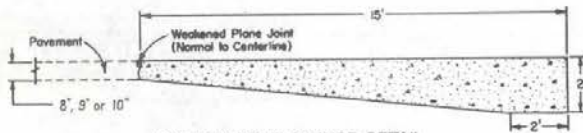

NOTE - Pavement end anchors shall be constructed as the terminal panels of all pavement not abutting existing pavements or structures, and elsewhere if ordered by the Engineer.

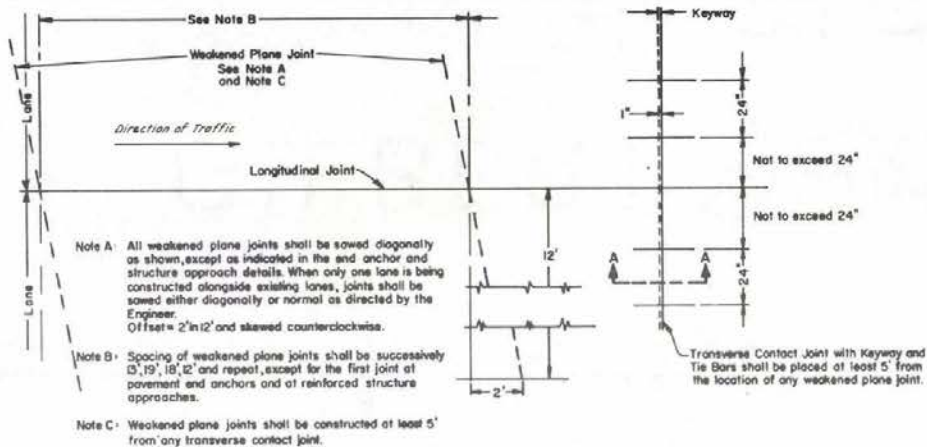

PLAN



TIE BAR DETAIL

GENERAL NOTES
1. Refer to Plan Structure Sheets for "Approach Slab Details"

STATE OF NEVADA DEPARTMENT OF HIGHWAYS	
CONCRETE PAVEMENT	
 CHIEF ROAD DESIGN ENGR.	R-10.1.1-(409) ADOPTED: 8/69 REVISION: 5

STANDARD RCB GENERAL NOTES, REVISED 1979

DESIGN SPECIFICATIONS: ASHBO "STANDARD SPECIFICATIONS FOR HIGHWAY BRIDGES," TENTH EDITION, DATED 1969. FOR CULVERTS ON PILES OR ROCK FOUNDATIONS SPECIAL DESIGN MAY BE REQUIRED.

CONSTRUCTION SPECIFICATIONS: STANDARD SPECIFICATIONS, STATE OF NEVADA DEPARTMENT OF HIGHWAYS, CURRENT EDITION, AND SPECIAL PROVISIONS ACCOMPANYING PLANS.

LOADING: LIVE LOAD: HS 20-44 OR INTERSTATE ALTERNATE LOADING.
DEAD LOAD: EARTH LOAD BASED ON 120 LBS. PER SQ. FT. AND HORIZONTAL HYDRAULIC FLOW PRESSURE OF 26 LBS. PER SQ. FT., CONCRETE 150 LBS. PER CU. FT.



ULTIMATE STRESSES: $F_c = 20,000$ P.S.I., $n = 10$, $F_s = 1200$ P.S.I.

HEADWALLS: ALL RCB CULVERTS SHALL HAVE TYPE I HEADWALLS UNLESS OTHERWISE NOTED ON THE PLANS.


DEVELOPMENT: SHOW ON PLANS AS SPAN X HEIGHT X LENGTH.

ADDITIONAL LENGTH: LENGTH OF CULVERT SHALL BE INCREASED AS FOLLOWS: ADD 2'-0" TO EACH END AS SHOWN ON PLAN WHEN COVER AT SHOULDER IS 2" TO 5". ADD AN ADDITIONAL 1'-0" TO EACH END FOR EACH SUCCEEDING 5'-0" OF COVER OR PORTION THEREOF.

REINFORCEMENT CLEARANCE: REINFORCEMENT EMBEDMENT IS 2 1/2" CLEAR ON BOTTOM OF BOTTOM BARS AND 1 1/2" CLEAR ON REMAINDER OF STRUCTURE AND ITS APPURTENANCES EXCEPT AS NOTED.

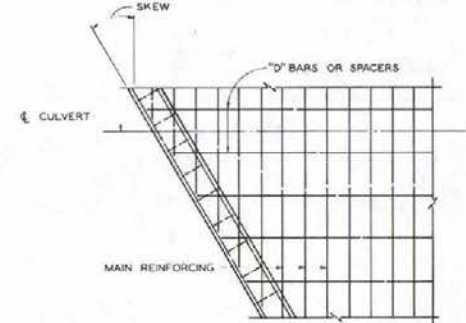
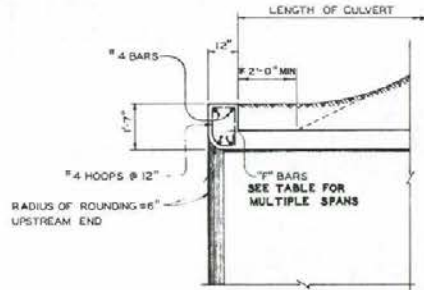


PARAPET DETAILS FOR SINGLE SPAN CULVERTS

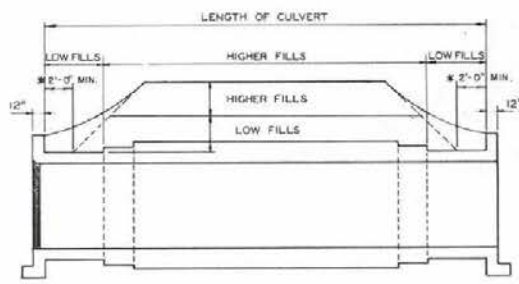


COPING REINFORCING QUANTITIES INCLUDED IN THE HEADWALL QUANTITIES

LOW FILLS=LOWEST TABLE VALUE FOR GIVEN SPAN
HIGHER FILLS=SLAB INCREASE AS SHOWN IN TABLE

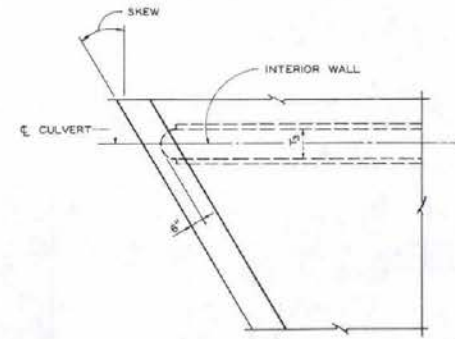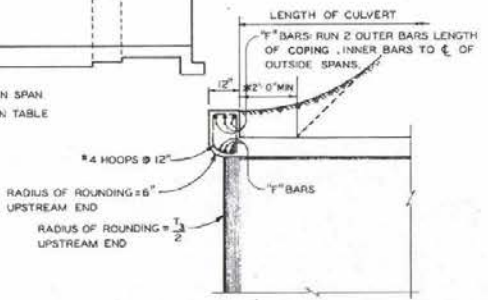

PARAPET DETAILS FOR MULTIPLE SPAN CULVERTS

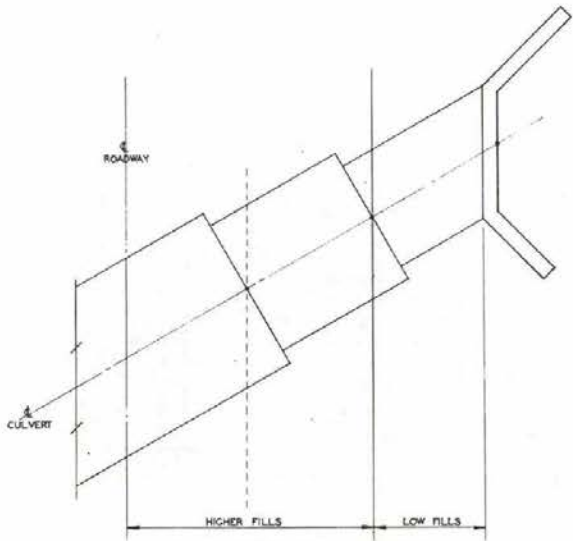

PLAN VIEW ON A SKEW

SKEWED PARAPETS		SPAN	3	4	5	6	8	10	12
0°-15°	BAR NO.	4	4	5	6	6	7	8	
	NUMBER OF BARS	2	2	2	2	3	3	3	
16°-30°	BAR NO.	4	4	5	6	7	8	8	
	NUMBER OF BARS	2	3	3	3	3	3	3	
31°-45°	BAR NO.	4	4	5	6	7	8	8	
	NUMBER OF BARS	3	3	3	3	3	3	3	
0°-45°	#4 HOOPS	12" CTRS.							


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**RCB CULVERTS,
GENERAL NOTES**

Hugh C. Brown
CHIEF BRIDGE ENGR.


B-20.1.1-(502)
ADOPTED 11/78 REVISION 1-8/79

SPAN	7'						8'					
	3'	4'	5'	6'	7'	8'	3'	4'	5'	6'	7'	8'
MAX. FILL OVER TOP	2' 16"	2' 6"	2' 16"	2' 6"	2' 16"	2' 6"	2' 16"	2' 6"	2' 16"	2' 6"	2' 16"	2' 6"
TOP SLAB	T1	T2	T3	T4	T5	T6	T7	T8	T9	T10	T11	T12
BOTTOM SLAB	B1	B2	B3	B4	B5	B6	B7	B8	B9	B10	B11	B12
SIDEWALLS	S1	S2	S3	S4	S5	S6	S7	S8	S9	S10	S11	S12
"A" SIZE	BAR NO.											
	SPACING											
"B" SIZE	BAR NO.											
	SPACING											
"C" SIZE	BAR NO.											
	SPACING											
"C1" SIZE	BAR NO.											
	SPACING											
"D" DIST.	TOP SLAB-TOT. NO.											
	BOT. SLAB-TOT. NO.											
"E" BARS	SPACING											
	TOTAL NO.											
CONC. CY PER LIN. FT.	53	53	59	57	63	62	67	62	66	66	72	70
REINF. LBS. PER LIN. FT.	116	109	123	123	138	134	143	136	142	142	154	149

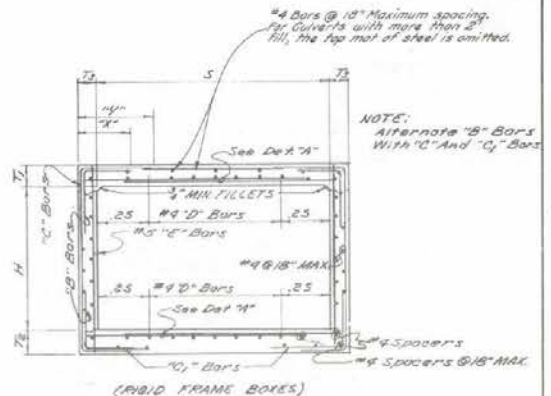

TYPICAL SECTION 7' THRU 12' SPANS

SPAN	10'												12'																																						
	3'	4'	5'	6'	7'	8'	3'	4'	5'	6'	7'	8'	3'	4'	5'	6'	7'	8'																																	
MAX. FILL OVER TOP	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"	2' 9"																													
TOP SLAB	T1	T2	T3	T4	T5	T6	T7	T8	T9	T10	T11	T12	T13	T14	T15	T16	T17	T18	T19	T20	T21	T22																													
BOTTOM SLAB	B1	B2	B3	B4	B5	B6	B7	B8	B9	B10	B11	B12	B13	B14	B15	B16	B17	B18	B19	B20	B21	B22																													
SIDEWALLS	S1	S2	S3	S4	S5	S6	S7	S8	S9	S10	S11	S12	S13	S14	S15	S16	S17	S18	S19	S20	S21	S22																													
"A" SIZE	BAR NO.																																																		
	SPACING																																																		
"B" SIZE	BAR NO.																																																		
	SPACING																																																		
"C" SIZE	BAR NO.																																																		
	SPACING																																																		
"C1" SIZE	BAR NO.																																																		
	SPACING																																																		
"D" DIST.	TOP SLAB-TOT. NO.																																																		
	BOT. SLAB-TOT. NO.																																																		
"E" BARS	SPACING																																																		
	TOTAL NO.																																																		
CONC. CY PER LIN. FT.	75	75	93	100	109	106	107	100	112	97	119	101	101	105	135	110	110	121	123	133	137	170	95	95	130	99	99	131	104	104	143	108	108	150	113	113	157	123	123	164	135	135	172	204	146	146	183	210			
REINF. LBS. PER LIN. FT.	122	137	125	122	143	127	141	146	128	154	127	144	125	136	162	128	136	170	129	123	191	178	167	201	205	190	270	213	203	287	218	203	293	224	218	304	233	218	311	236	233	317	307	246	321	324	397	268	303	341	415



Note: For boxes of height less than that shown in table, use next greater table height slabs, wall dimensions and reinforcing steel, and make necessary changes in bar lengths, number of spacers and quantities. For general notes see sheet B-ZD.1.1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


SINGLE
RCB CULVERTS
7' TO 12' SPANS

Hugh L. Brimmer
CHIEF BRIDGE ENGR.

B-201.3-(502)
ADOPTED: 11/70
REVISION: 3/77

SPAN	5'				6'				8'				10'			
	3'	4'	5'	6'	3'	4'	5'	6'	3'	4'	5'	6'	3'	4'	5'	6'
HEIGHT	3'															
MAX. FILL OVER TOP	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6
TOP SLAB	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	
BOTTOM SLAB	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
SIDEWALLS	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
"A"	SIZE BAR NO. 4															
SPACING	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
LENGTH	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
"B"	SIZE BAR NO. 4															
SPACING	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
LENGTH "B"	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
"C"	SIZE BAR NO. 4															
SPACING	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
LENGTH	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
"D" DIST BARS	TOP SLAB TOT NO. 4															
BOTTOM SLAB TOT NO.	4															
"E" BARS	SIZE BAR NO. 4															
SPACING	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
SPACERS NUMBER	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	
CONCRETE, CY PER LIN. FT.	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	0.63	
REINFORCING, LBS PER LIN. FT.	103	103	103	103	103	103	103	103	103	103	103	103	103	103	103	

SPAN	8'				10'				12'			
	3'	4'	5'	6'	3'	4'	5'	6'	3'	4'	5'	6'
HEIGHT	3'											
MAX. FILL OVER TOP	6	6	6	6	6	6	6	6	6	6	6	6
TOP SLAB	1	1	1	1	1	1	1	1	1	1	1	1
BOTTOM SLAB	2	2	2	2	2	2	2	2	2	2	2	2
SIDEWALLS	3	3	3	3	3	3	3	3	3	3	3	3
"A"	SIZE BAR NO. 4											
SPACING	10	10	10	10	10	10	10	10	10	10	10	10
LENGTH	10	10	10	10	10	10	10	10	10	10	10	10
"B"	SIZE BAR NO. 4											
SPACING	10	10	10	10	10	10	10	10	10	10	10	10
LENGTH "B"	10	10	10	10	10	10	10	10	10	10	10	10
"C"	SIZE BAR NO. 4											
SPACING	10	10	10	10	10	10	10	10	10	10	10	10
LENGTH	10	10	10	10	10	10	10	10	10	10	10	10
"D" DIST BARS	TOP SLAB TOT NO. 4											
BOTTOM SLAB TOT NO.	4											
"E" BARS	SIZE BAR NO. 4											
SPACING	10	10	10	10	10	10	10	10	10	10	10	10
SPACERS NUMBER	36	36	36	36	36	36	36	36	36	36	36	36
CONCRETE, CY PER LIN. FT.	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05
REINFORCING, LBS PER LIN. FT.	193	193	193	193	193	193	193	193	193	193	193	193

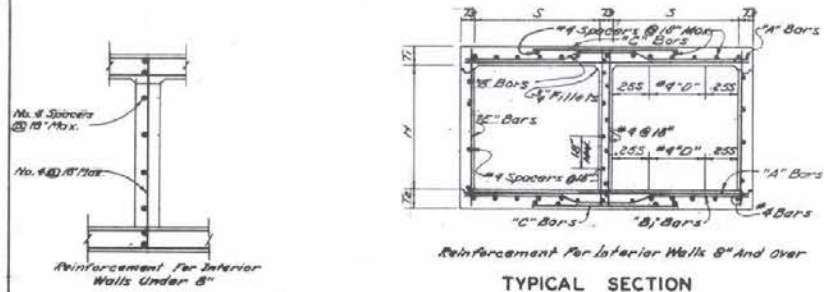

NOTE: For Boxes of Height Less Than That Shown In Table, Use Next Greater Table Height Slabs, Wall Dimensions And Reinforcing Stagger And Make Necessary Changes In Bar Lengths, Number Of Spacers And Quantities.

NOTE: "B" And "C" Bars To Be Spaced Alternately With "A" And "D" Bars. Extended "C" Bars Are NOT Included In Boxes Shown.

NOTE: For General Notes See Sheet B-20.1.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**DOUBLE
RCB CULVERTS**

High E. Brinson
CHIEF BRIDGE ENGR.


B-20.14-(502)
ADOPTED 11/78

SPAN HEIGHT	CUBIC YARDS OF CONCRETE AND POUNDS OF REINFORCING FOR TWO TYPE II HEADWALLS												SPAN HEIGHT					
	SINGLE BOX				DOUBLE BOX				TRIPLE BOX									
	0 SKEW		15 SKEW		30 SKEW		45 SKEW		0 SKEW		15 SKEW			30 SKEW		45 SKEW		
	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.		CONC.	REINF.	CONC.	REINF.	
3	9.4	271	9.4	288	10.2	947	11.5	1073	11.4	11.6	1013	12.4	1085	14.3	1243			
4	12.8	1141	12.8	1163	13.5	1237	15.6	1399	14.8	1261	15.0	1287	15.9	1376	18.6	1528	16.8	1367
5	16.4	1476	16.6	1507	17.5	1613	19.8	2044	18.6	1795	18.6	1831	19.9	1952	22.8	2214	20.6	1901
6	20.8	1886	21.0	1903	22.5	2194	25.4	2619	24.2	2394	24.2	2430	25.9	2640	30.4	2978	28.2	2578
7	25.8	2398	26.1	2416	27.6	2808	31.1	3160	29.8	2866	29.8	2902	31.6	3349	36.4	3749	34.2	3298
8	31.4	2998	31.8	3016	33.6	3516	38.6	4016	37.4	3516	37.4	3552	39.4	4164	46.4	4664	44.2	4016
9	37.4	3698	37.8	3716	39.6	4216	45.6	4716	44.4	4016	44.4	4052	46.4	4816	56.4	5316	54.4	4664
10	43.8	4498	44.2	4516	46.2	5016	53.6	5516	52.4	4664	52.4	4700	54.4	5616	66.4	6116	64.4	5016
11	50.8	5298	51.2	5316	53.2	5816	61.6	6316	60.4	5316	60.4	5352	62.4	6416	76.4	6916	74.4	5816
12	58.4	6098	58.8	6116	60.8	6616	70.4	7116	69.2	6116	69.2	6152	71.2	7216	86.4	7716	84.4	6616


H- FEET	T- INCHES	TB- INCHES	G BARS	F BARS		
SIZE NO	SPACE IN	SIZE NO	SPACE IN	SPACE IN		
3	8	5	9 1/2	4	12	
4	8	5	9 1/2	4	12	
5	9	6	9 1/2	4	11	
6	10	7	10	4	6 1/2	
7	12	7	8 1/2	5	7 1/2	
8	12	13	7	6 1/2	8	
9	12	14	7	6	7 1/2	
10	12	16	8	6 1/2	8	10
12	12	20	9	7	8 1/2	

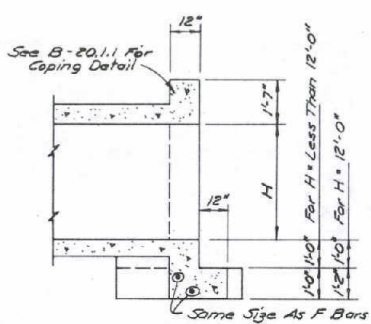

SECTION A - A

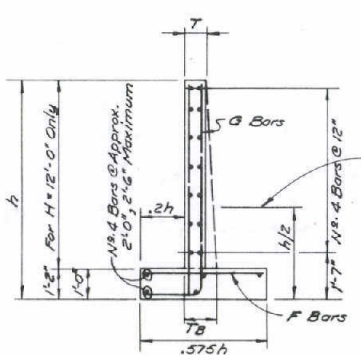

SECTION B - B

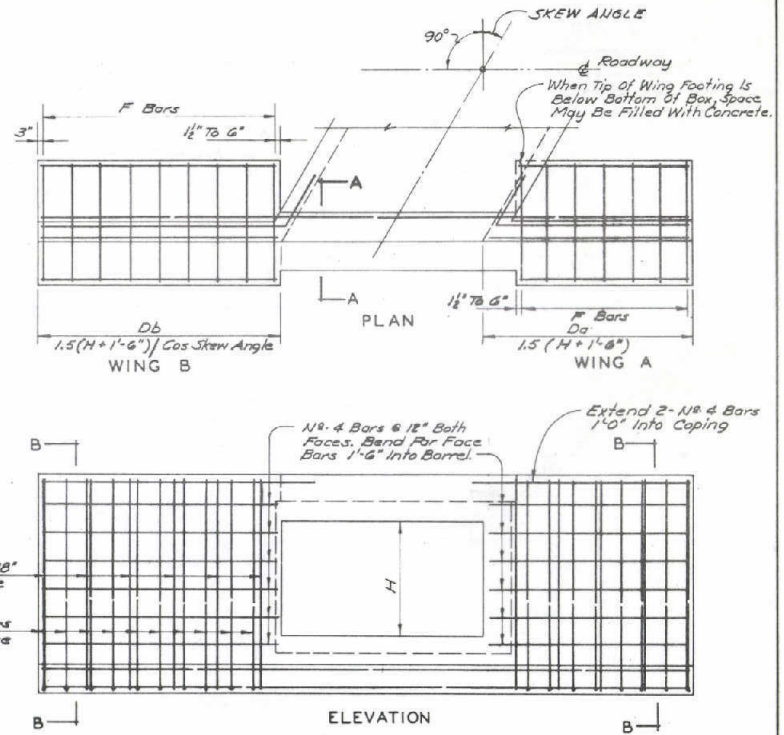

NOTE: For General Notes See Sheet B-20.1.1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**RCB CULVERTS
TYPE II HEADWALLS**

H. Allen
CHIEF BRIDGE ENGR.

B-20.1.6 - (502)
ADOPTED 11/70 REVISION





		CUBIC YARDS OF CONCRETE AND POUNDS OF REINFORCING FOR TWO TYPE I HEADWALLS																							
SPAN	HEIGHT	SINGLE BOX				DOUBLE BOX				TRIPLE BOX															
		0° SKEW	15° SKEW	30° SKEW	45° SKEW	0° SKEW	15° SKEW	30° SKEW	45° SKEW	0° SKEW	15° SKEW	30° SKEW	45° SKEW	0° SKEW	15° SKEW	30° SKEW	45° SKEW								
		CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.	CONC.	REINF.								
3	3	5.6	393	6.9	476	7.2	563	8.9	739	7.7	506	8.5	597	9.5	700	11.8	910								
	4	7.6	609	8.0	644	9.4	774	11.6	946	9.7	726	10.1	767	12.0	912	14.6	1119	11.8	892	12.3	856	14.4	1045	17.6	1280
	5	9.6	765	10.2	782	11.8	942	15.0	1238	11.7	825	12.4	908	14.3	1005	18.0	1414	13.9	944	14.4	1030	16.8	1220	21.0	1578
4	3	6.0	418	6.5	504	7.6	595	9.4	779	8.3	600	9.2	699	10.3	817	12.7	1068								
	4	7.9	637	8.3	673	10.0	807	12.1	985	10.3	821	10.8	869	12.7	1032	15.5	1270	12.6	1004	13.2	1058	15.4	1243	18.8	1525
	5	9.9	730	10.6	809	12.2	974	15.4	1278	12.3	917	13.0	1009	15.0	1203	18.6	1564	14.7	1103	15.5	1199	17.7	1413	22.1	1823
5	3	12.9	983	12.6	1166	15.5	1505	20.4	2158	14.8	1173	15.0	1310	18.3	1740	23.7	2449	17.2	1361	17.5	1502	21.0	1951	27.1	2768
	4	15.3	1400	16.0	1601	19.8	2155	26.5	3104																
	5	6.3	442	7.1	532	8.0	626	9.9	820																
6	3	8.3	645	8.7	708	10.4	839	12.6	1025																
	4	10.3	756	10.9	837	12.6	1006	15.9	1319																
	5	12.8	1011	12.9	1137	15.9	1544	20.8	2209																
7	3	15.6	1432	16.3	1637	20.8	2199	27.0	3161																
	4	6.7	467	7.5	559	8.4	658	10.4	861	7.8	517	10.7	1064	11.8	1109	14.5	1268								
	5	8.6	693	9.1	731	10.8	872	13.1	1065	11.8	1045	12.3	1078	14.3	1238	17.3	1475	14.9	1220	15.5	1365	17.8	1558	21.4	1858
8	3	10.6	782	11.3	864	13.0	1038	16.4	1360	13.8	1177	14.5	1216	16.6	1495	20.6	1773	17.0	1414	17.8	1501	20.2	1728	25.0	2159
	4	13.1	1039	13.3	1169	16.3	1583	21.3	2261	14.4	1401	16.6	1525	19.9	1958	25.6	2676	19.6	1677	19.9	1814	23.6	2276	29.9	3065
	5	16.0	1468	16.7	1673	20.6	2242	27.5	3219	19.2	1824	21.0	2133	24.3	2620	31.8	3637	22.5	2107	24.4	2428	28.0	2946	36.1	4029
9	3	17.9	1904	20.2	2234	24.2	2778	33.1	3938	21.2	2267	23.6	2552	27.9	3051	39.5	4359	24.5	2552	27.0	2882	31.7	3381	43.9	4753
	4	7.3	515	8.8	612	9.2	721	11.4	942	11.2	1111	12.8	1227	13.6	1383	16.8	1734								
	5	9.3	749	9.8	789	11.6	936	14.1	1144	13.2	1348	13.8	1396	16.1	1608	19.4	1939								
10	3	11.3	833	12.0	920	13.8	1101	17.4	1441	15.2	1434	16.1	1531	18.4	1770	23.0	2239	19.2	1876	20.1	1985	22.9	2274	28.5	2857
	4	13.8	1093	14.0	1233	17.1	1661	22.3	2365	17.8	1697	18.1	1775	21.7	2187	28.0	3165	21.8	2141	22.2	2219	26.3	2666	33.6	3786
	5	16.6	1528	17.4	1745	21.4	2329	28.4	3334	20.7	2135	21.6	2359	24.1	3006	34.1	4137	24.7	2582	25.8	2821	30.7	3519	39.8	4761
11	3	18.6	1978	20.9	2314	25.0	2870	34.1	4054	22.7	2587	25.2	2935	29.7	3544	39.9	4860	24.8	3037	24.4	3309	34.4	4057	45.4	5486
	4	23.2	2117	25.4	2482	31.1	3204	41.4	4597																
	5	29.5	3353	31.6	3598	38.6	4397	51.7	5892	33.7	3967	36.0	4217	43.5	5077	57.6	6703	37.8	4422	40.3	4688	48.3	5596	63.5	7335
12	3	10.0	804	10.5	848	12.4	1001	15.1	1224	14.6	1232	15.2	1404	17.6	2090	21.5	2549								
	4	12.0	884	12.7	925	14.6	1165	18.4	1522	16.4	1815	17.5	1941	20.0	2247	24.9	2849								
	5	14.5	1148	14.7	1296	17.9	1738	23.3	2469	19.2	2084	19.6	2244	23.3	2817	29.9	3799	23.9	2744	24.4	2922	28.7	3576	36.5	4733
13	3	17.3	1591	18.1	1817	22.2	2416	29.4	3449	22.1	2531	23.0	2775	27.7	3497	36.1	4782	26.8	3195	27.9	3460	33.1	4261	42.8	5779
	4	19.3	1945	21.8	2104	25.8	2962	35.1	4171	23.1	2889	24.7	3396	31.3	4048	41.8	5204	27.8	3554	31.6	4094	36.8	4830	48.6	6446
	5	23.9	2181	26.1	2553	31.9	3327	42.4	4704	28.7	3123	31.1	3522	37.5	4414	49.2	6042	32.5	3796	36.1	4218	43.0	5191	56.1	6984
14	3	30.2	3429	32.3	3680	39.4	4488	52.7	6003	35.0	4373	37.9	4646	45.1	5580	58.6	7344	39.9	5099	42.4	5341	50.7	6353	66.5	8289
	4	42.8	5137	47.2	5372	56.4	6075	80.1	8124	47.8	6087	52.3	6340	62.2	7141	87.2	9470	52.7	6768	57.5	7045	67.9	7930	94.2	10420

88

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

ESTIMATE OF QUANTITIES
TYPE I HEADWALLS

<i>H. Allen Drell</i> CHIEF BRIDGE ENGR.	B-20.1.8-(502) ADOPTED 11/10 REVISION
---	--

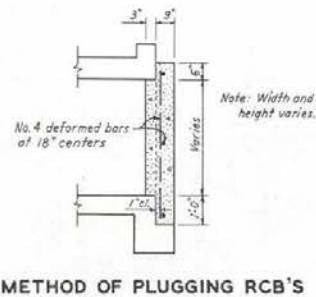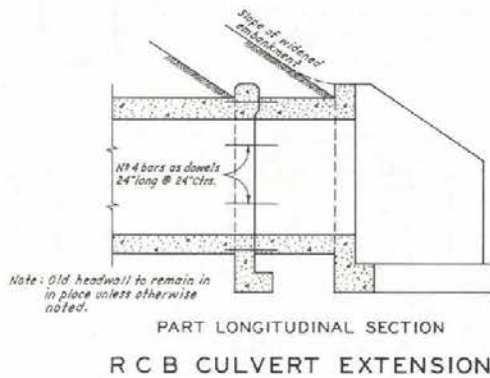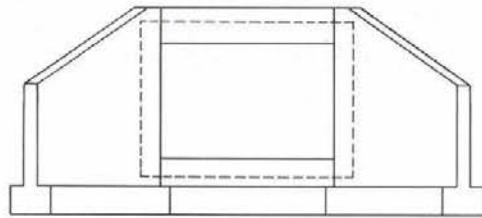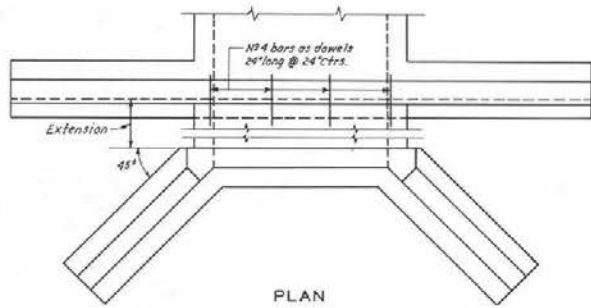

GENERAL NOTES

1. All concrete shall be Class A or AA.
2. Reinforcing steel shall be deformed bars wired tightly at all intersections and embedded at least 1" clear of concrete surface except as noted.
3. Footings shown are of minimum depth and shall be extended if soil is unstable.
4. Dowel holes shall be drilled to full depth and dowels carefully grouted in place with a thin neat cement mortar.




STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

METHOD OF EXTENDING
R C B CULVERTS




M. Alan Cokko CHIEF BRIDGE ENGR.	B-20.1.9-(502)	REVISION
	ADOPTED: 11/70	

Surcharge	Level	With Superimposed Load
Batter	No Live Load	
Wall On 1:6 Batter		
Wall Vertical		







① Curve number. TABLE Y

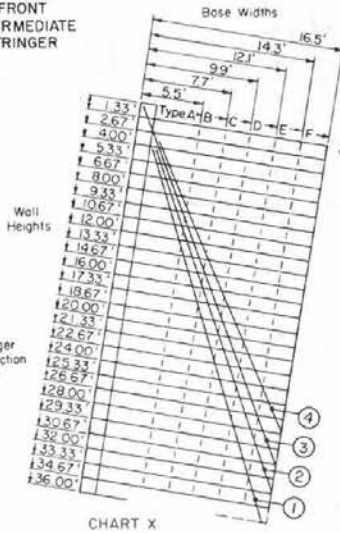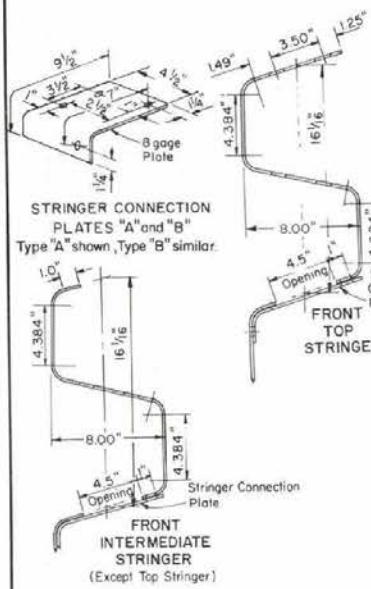



HOW TO USE: Select proper circled number in Table (Y) according to batter and surcharge conditions in Chart (X), determine where the line with that number intercepts the desired height.
 Example - Wall on 1:6 batter, with live load, wall height 18 ft. These conditions are found as (2) in table, in chart, line (2) intercepts the 18-ft. height line about midway of Type 'C' which has a base width of 9.9 feet

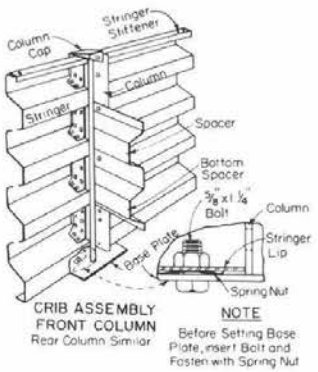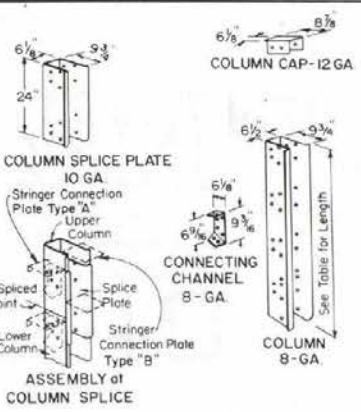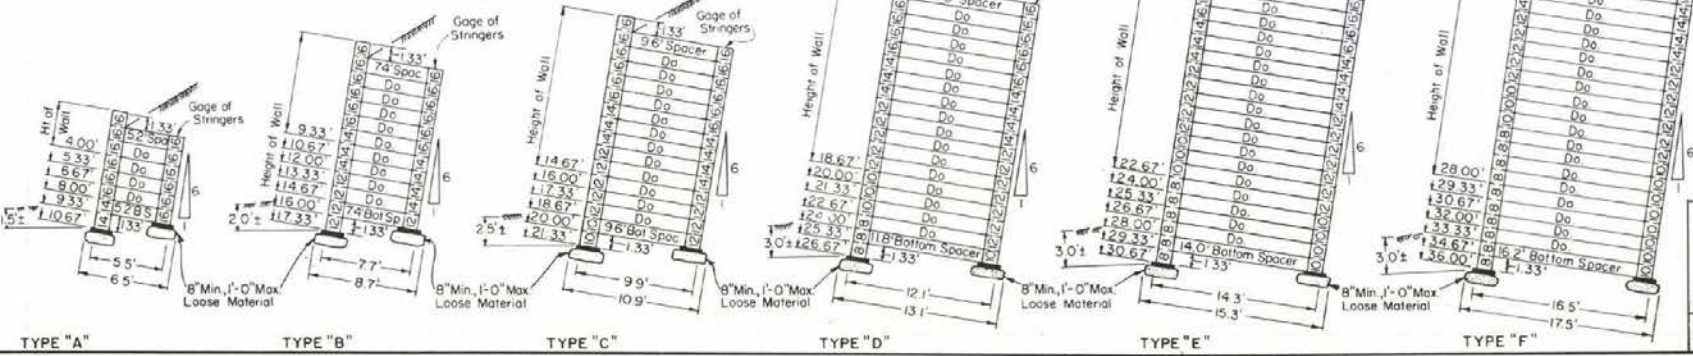


NOTE: Before Setting Base Plate, insert Bolt and Fasten with Spring Nut




NOTE: See Table on Sheet I for Gage and Length

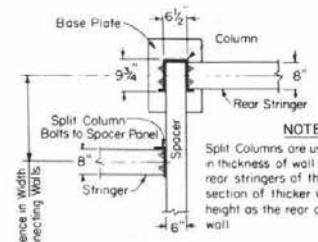

DETAIL SPLIT COLUMN ATTACHMENT



DETAIL - BASE PLATE PLACEMENT



BASE PLATE ARRANGEMENT








WALL WIDTH TYPE	h	L
"A"	3'	6'-7 7/8"
"B"	1 3/8'	8'-9 5/8"
"C"	5 3/4'	10'-11 3/8"
"D"	10 3/4'	13'-2 1/8"
"E"	14 3/8'	15'-4 3/8"
"F"	18 3/4'	17'-8 1/2"

*NOTE - Distance "h" for Type "A" is a Minus Quantity - that is, Front Column Base is LOWER than Rear Column Base


All bolts to be 3/8" with a minimum length of 1 1/4"

GENERAL NOTES
 Design "Type" to be shown on all crib layouts
 For Design Data see B-21.1.1


STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS
CONSTRUCTION DETAILS FOR METAL RETAINING WALL
 B-21.1.2-(612)
 H. Deane Smith CHIEF BRIDGE ENGR. ADOPTED: 8/99 REVISION

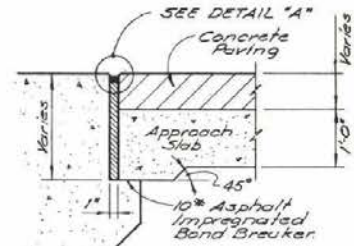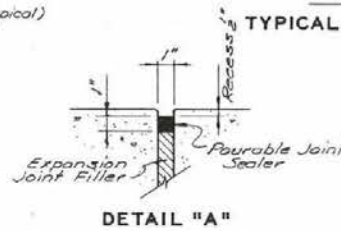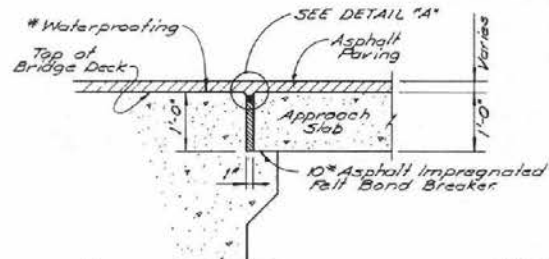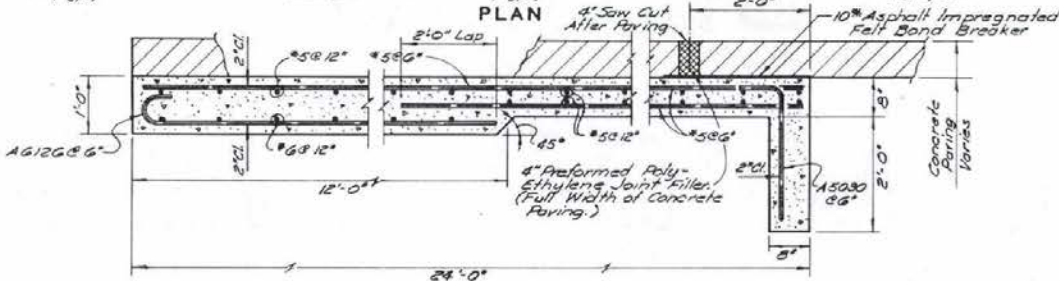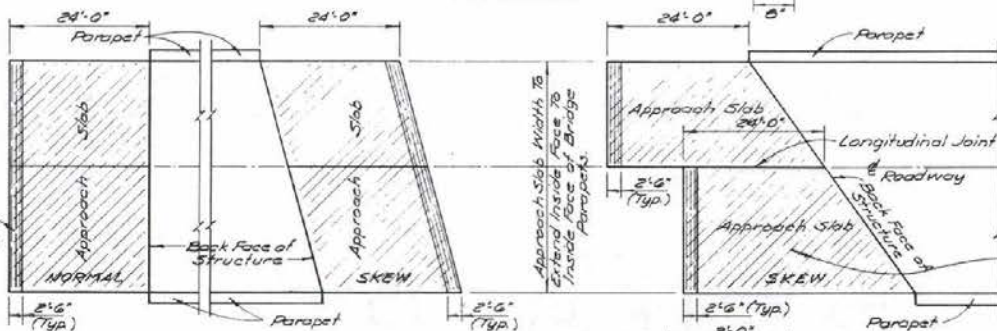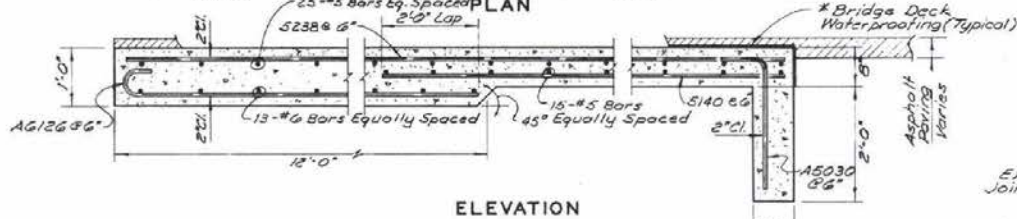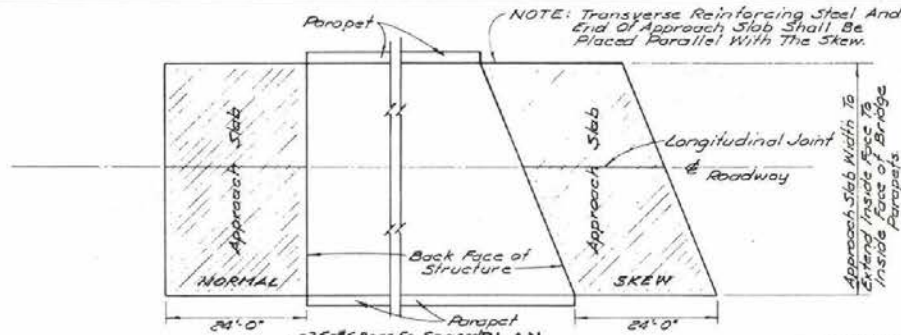

HAUNCHED SLAB DETAIL

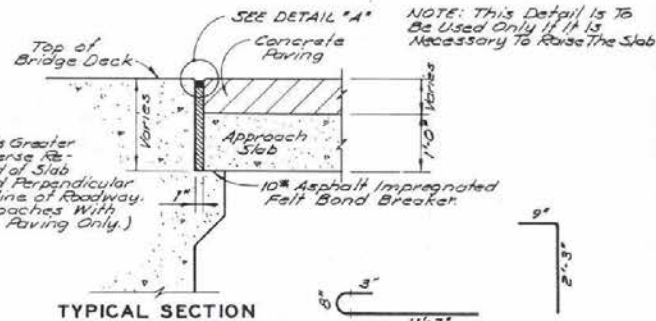


TYPICAL SECTION




NOTE: Bridge Deck Waterproofing NOT Required When It Is NOT Dailed For On The Bridge Deck.
NOTE: Expansion Material Required Between Approach Slab And Wingwall As A Bond Breaker.


STATE OF NEVADA DEPARTMENT OF HIGHWAYS	
APPROACH SLAB DETAILS	
Hugh C. Brinson CHIEF BRIDGE ENGR.	B-22.1.1-(802) ADOPTED: 11/78 REVISION

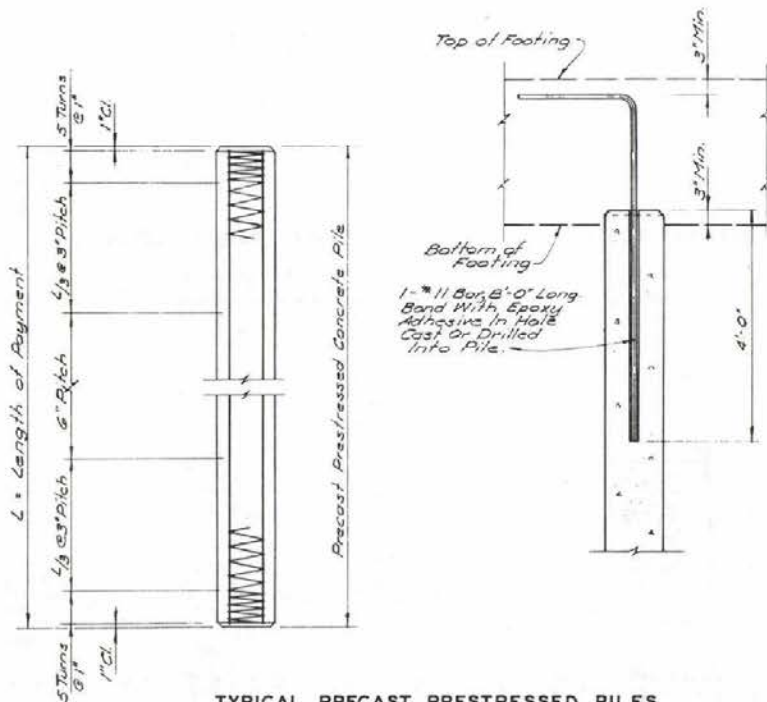


TYPICAL PRECAST PRESTRESSED PILES

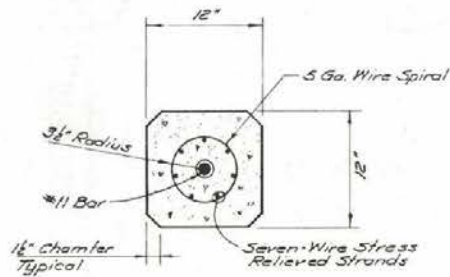

SECTION

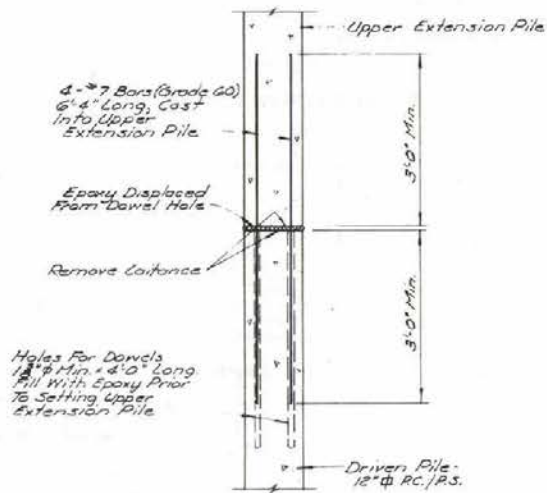

PILE SPLICE DETAILS

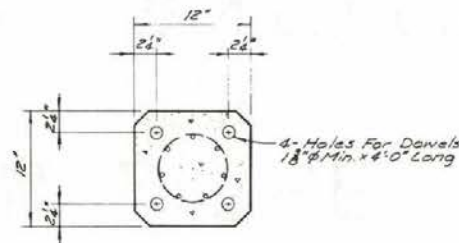


— GENERAL NOTES —

1. AASHTO STANDARD SPECIFICATIONS FOR HIGHWAY BRIDGES 1969 EDITION, INTERIM SPECIFICATIONS AASHTO 1971 - PRESTRESSED CONCRETE.
2. THE UNIT PRESTRESS AFTER LOSSES SHALL BE NOT LESS THAN 700 P.S.I.
3. CONCRETE STRENGTH: $f'_c = 4,000$ P.S.I.
 $f'_c = 6,000$ P.S.I.
4. PRESTRESSING REINFORCEMENT: SEVEN-WIRE STRESS RELIEVED STRANDS CONFORMING TO THE REQUIREMENTS OF ASTM DESIGNATION A416 SHALL BE USED.
5. STRANDS TO BE BURNED FLUSH.
6. CONCRETE MIX: ALL CONCRETE IN PILES AND PILE EXTENSIONS SHALL CONTAIN NOT LESS THAN 9 SACKS OF CEMENT PER CUBIC YARD. IF THE CLEARANCE TO ANY STEEL FROM THE SURFACE OF THE CONCRETE IS INCREASED TO 3", 7 SACKS OF CEMENT PER CUBIC YARD MAY BE USED.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

PRECAST PRESTRESSED
CONCRETE PILE DETAILS

Hugh E. Brinson
CHIEF BRIDGE ENGR. B-23 1.1 - (508)
ADOPTED: 1/74 REVISION

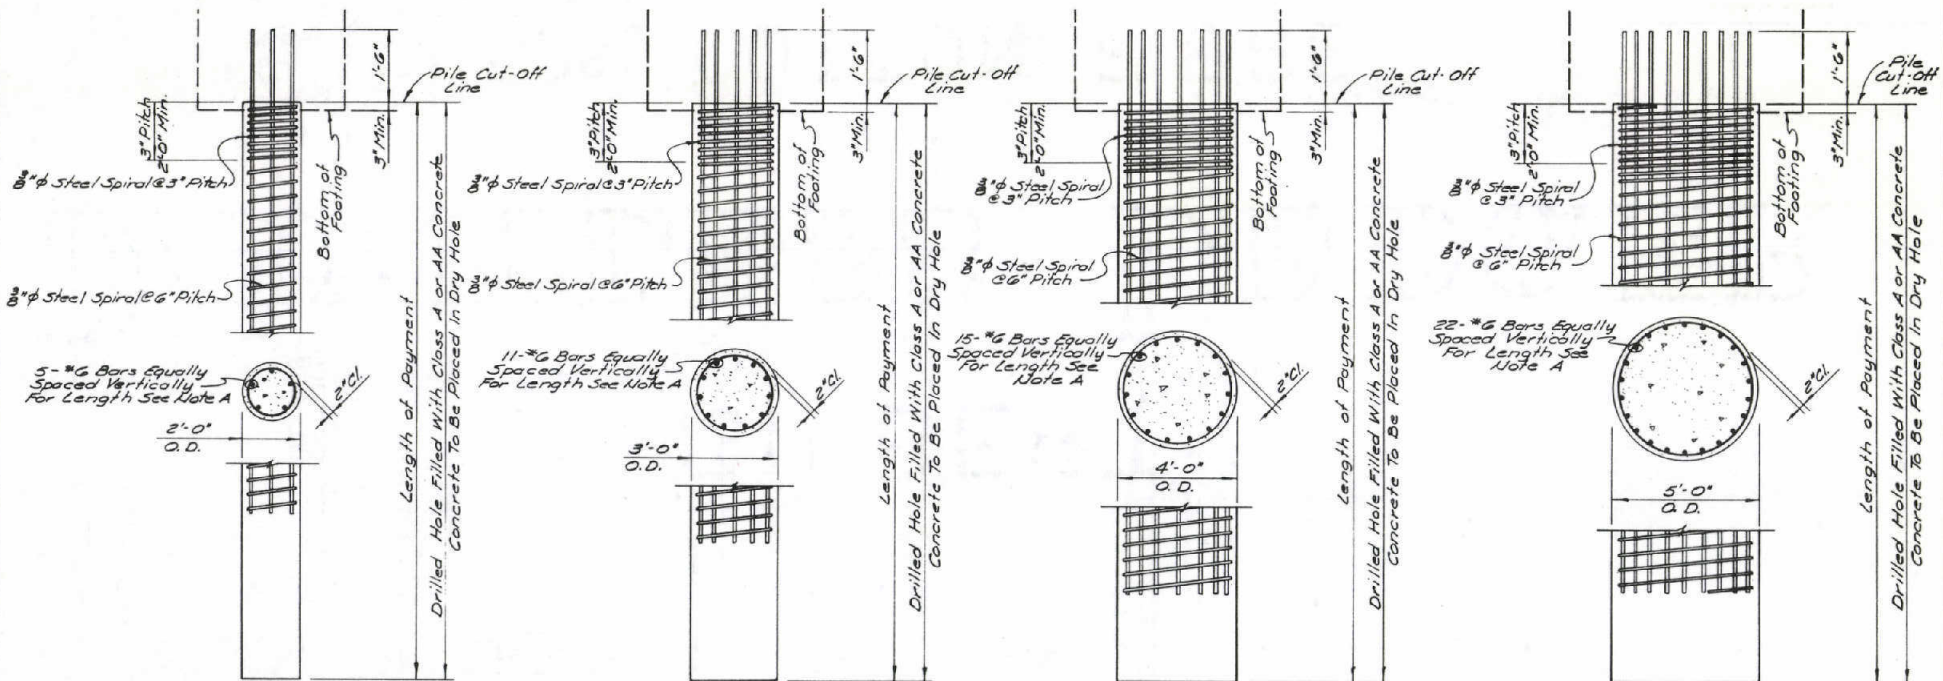

2'-0" DIAMETER PILES

3'-0" DIAMETER PILES

4'-0" DIAMETER PILES

5'-0" DIAMETER PILES


- NOTE A: THE #6 BARS SHALL EXTEND TO:
- 1) 12' - 0" BELOW THE LOWEST OF THE FOLLOWING:
 - A) BOTTOM OF FOOTING.
 - B) TOP OF FINAL GROUND SURFACE.
 - C) TOP OF ORIGINAL GROUND SURFACE WHEN HOLES ARE DRILLED THROUGH EMBANKMENT CONSTRUCTED BY CONTRACTOR.
 - 2) TO THE ELEVATION SHOWN ON THE PLANS OR SPECIFIED IN THE SPECIAL PROVISIONS.
- NOTE B: ALL BARS EXTENDED INTO SLAB OR FOOTING SHALL BE HOOKED AS REQUIRED TO PROVIDE 2" MINIMUM CLEARANCE.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**CAST-IN-DRILLED HOLE
CONCRETE PILE DETAILS**

<i>Hugh J. J. ...</i>	B-23.1.2-(508)
CHIEF BRIDGE ENGR.	ADOPTED: 1/74 REVISION

BIS

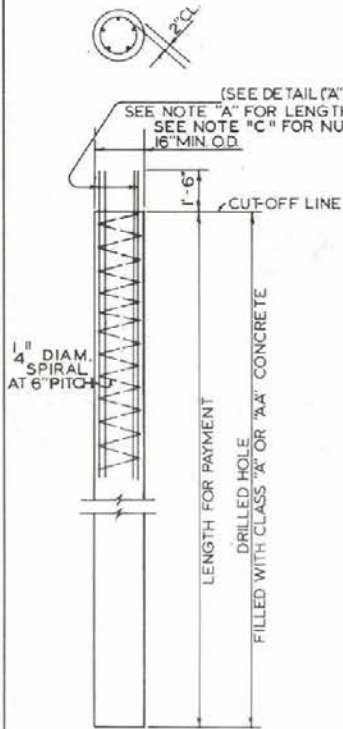

TO BE USED AS AN OPTION ONLY IF SPECIFIED ON THE PLANS.

NOTE "A" - THE BARS SHALL EXTEND A MINIMUM OF 12'-0" BELOW THE LOWEST OF THE FOLLOWING:


1. BOTTOM OF FOOTING
2. TOP OF FINAL GROUND SURFACE
3. TOP OF ORIGINAL GROUND SURFACE WHEN PILES ARE DRILLED THROUGH FILL

NOTE "B" - CONCRETE TO BE PLACED IN DRY HOLE

NOTE "C" - THE MINIMUM AREA OF REBAR SHALL BE 0.005 TIMES THE GROSS CROSS SECTION OF THE CONCRETE.

THE MINIMUM NUMBER OF BARS SHALL BE 5.

CAST-IN-DRILLED HOLE CONCRETE PILE

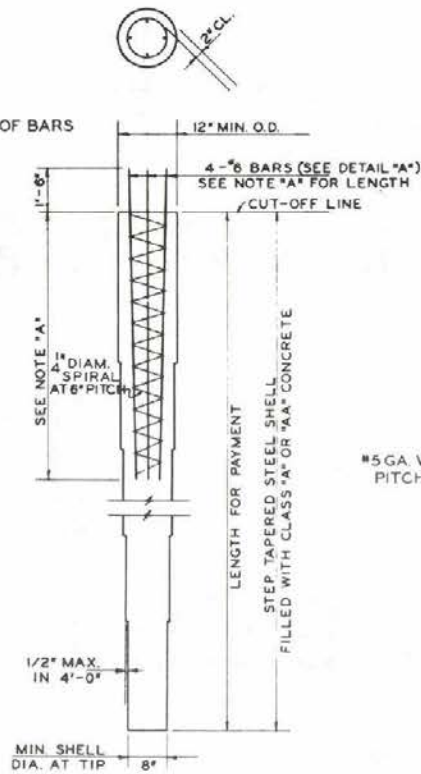


NOTE "A" - THE NO. 6 BARS SHALL EXTEND A MINIMUM OF 12' BELOW THE LOWEST OF THE FOLLOWING:

1. BOTTOM OF FOOTING
2. TOP OF FINAL GROUND SURFACE
3. TOP OF ORIGINAL GROUND SURFACE

NOTE "B" - 10" MIN. DIA. PIPE EXTENSION MAY BE USED WHEN STEP TAPER IS 30' OR MORE IN LENGTH. MINIMUM LENGTH OF EXTENSION IS 15'. MINIMUM THICKNESS OF PIPE EXTENSION = 0.1793t.


NOTE "C" - CONTRACTOR TO BE RESPONSIBLE FOR FURNISHING SHELLS OF SUFFICIENT STRENGTH TO DRIVE WITHOUT DISTORTION.

CAST-IN-PLACE CONCRETE PILE ALTERNATE "A"

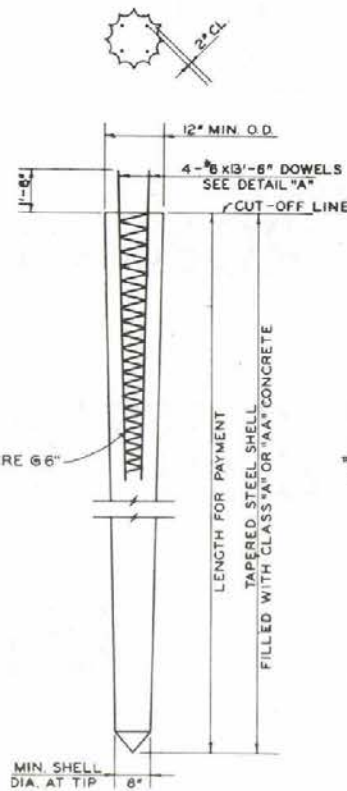

CONTRACTOR TO BE RESPONSIBLE FOR FURNISHING SHELLS OF SUFFICIENT THICKNESS TO DRIVE WITHOUT DISTORTION.


CAST-IN-PLACE CONCRETE PILE ALTERNATE "B"

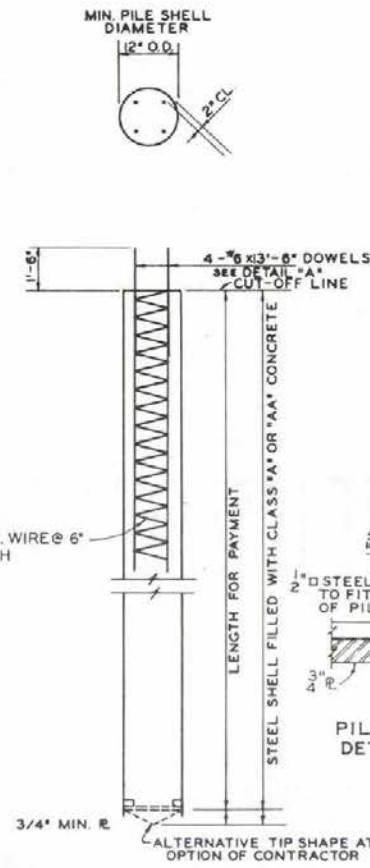


MINIMUM SHELL THICKNESS - 1/4"

CONTRACTOR TO BE RESPONSIBLE FOR FURNISHING SHELLS OF SUFFICIENT THICKNESS TO DRIVE WITHOUT DISTORTION.


CAST-IN-PLACE CONCRETE PILE

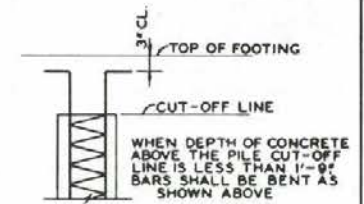

DETAIL "A"

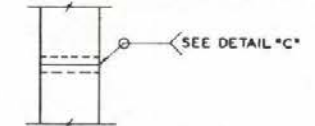

STEEL SHELL FIELD SPLICE

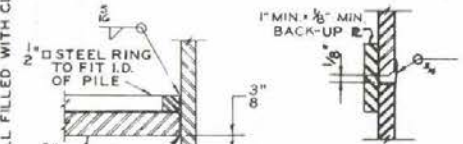

PILE TIP DETAIL

DETAIL "C"


NOTES

1. ALL REINFORCING SHOWN SHALL BE INCLUDED IN THE CONTRACT PRICE FOR FURNISHING STEEL SHELL FOR PILES.
2. IF LOAD TESTS ARE REQUIRED THE CONTRACTOR SHALL SUBMIT FOR APPROVAL DETAILED PLANS OF HIS PROPOSED TESTING METHOD.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

CONCRETE PILE DETAILS

8-23.1.3-(508)
ADOPTED: 1/74 REVISION

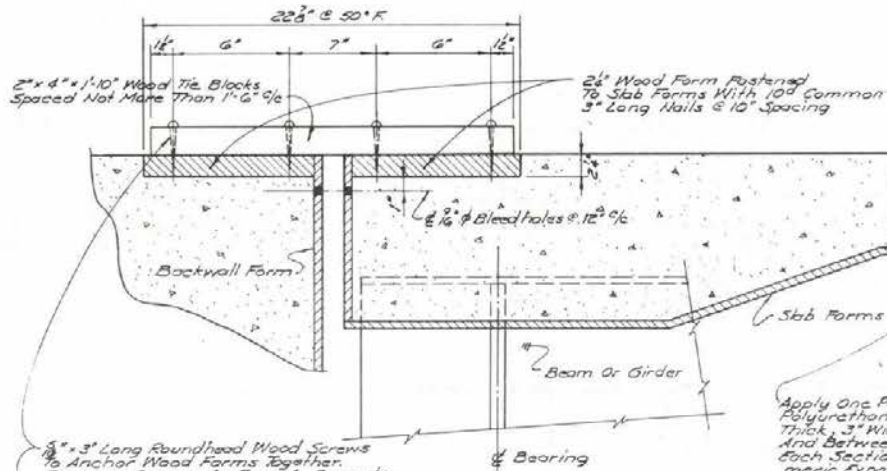

2" x 4" x 10" Wood Tie Blocks Spaced Not More Than 1'6" O.C.

2" x 4" Wood Form Fastened To Slab Forms With 10d Common 3" Long Nails & 10" Spacing

1/8" ϕ Bleedholes @ 12" O.C.

Backwall Form


Slab Forms

Beam Or Girder


Bearing

4" MOVEMENT

Surface Below Elastomeric Expansion Joint Dam To Be Provided To A Smooth Finish Parallel To The Profile Grade.

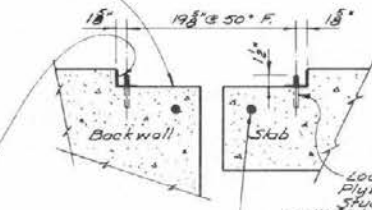

ANCHOR AND SEALING

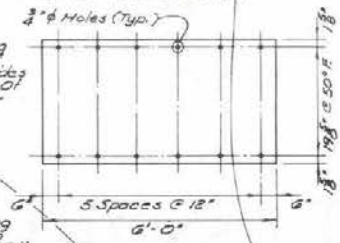

3" PLYWOOD TEMPLATE

Apply One Part Air Curing Polyurethane Sealant 3/8" Thick, 3" Wide Up Both Sides And Between The Ends Of Each Section Of Elastomeric Expansion Joint Seal.

Locate Holes With Plywood Template For 3/4" Studs (Expanding Anchor Type). Drill 1" ϕ 2" Deep With Carbide Percussion Drill Bit. Set Expansion Anchor Studs With 2 Lb. Hammer As An Alternate Method, Drill Holes 1 1/4" ϕ 4" Deep With Rotary Drill, And Grout In 3/4" x 6" Long Swedge Bolts.

Locate Holes With Plywood Template For 3/4" Stud (Expanding Anchor Type). Drill 1" ϕ , 2" Deep With Carbide Percussion Drill Bit. Set Expansion Anchor Stud With 2 Lb. Hammer As An Alternate Method Drill Holes As An 1 1/4" ϕ 4" Deep With Rotary Drill And Grout In 3/4" x 6" Long Swedge Bolts.

Tighten All Nuts To 85 Foot Pounds. Re-Tighten To 85 Foot Pounds, 6 Hour After Initial Tightening.


Wire Brush Bolt Cavity And Brush Bolt Cavity With Polyurethane Sealant. Push Plug Down To Snap Lock. Fill Bleeder Hole With Polyurethane Sealant. Scrape Off All Excess Polyurethane Sealant.

Important: When Placing Studs, Always Turn Anchor So That Slot In Its Base Points Toward The Expansion Joint In The Deck. Corrections Shall Be Made For Ambient Temperatures.

NOTE: Placement Of Re-Bar Shall Not Interfere With Anchor Bolts.

Steel Reinforced Elastomeric Expansion Joint Seal Or Equal.


Tighten All Nuts To 40 Foot Pounds. Re-Tighten To 40 Foot Pounds 6 Hour After Initial Tightening.

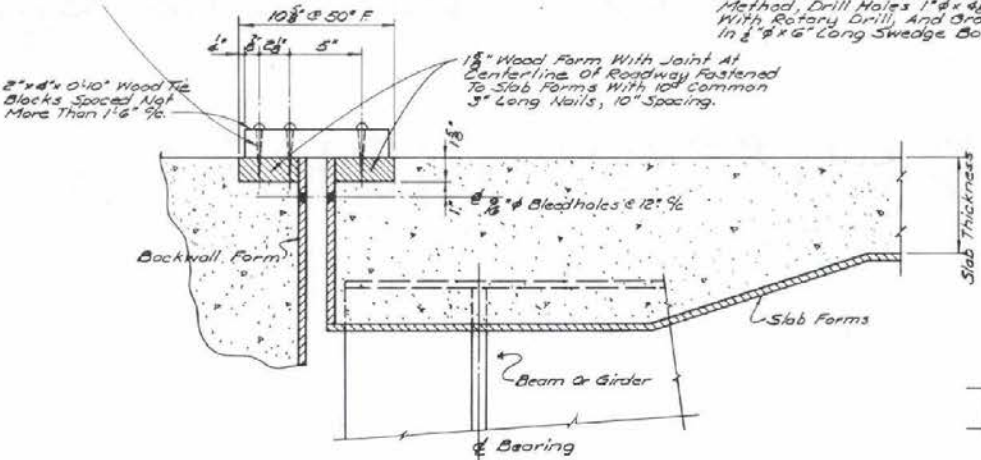

2" MOVEMENT

SECTION SHOWING SUGGESTED FORMING

ANCHOR AND SEALING


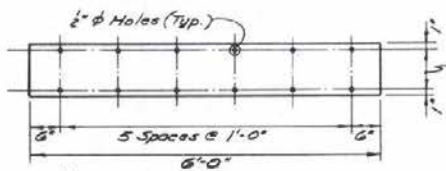


3" PLYWOOD TEMPLATE



Surface Below Elastomeric Expansion Joint Dam To Be Provided To A Smooth Finish Parallel To The Profile Line.

INSTALLATION OF ELASTOMERIC JOINT SEAL

STATE OF NEVADA DEPARTMENT OF HIGHWAYS	
STEEL REINFORCED ELASTOMERIC EXPANSION JOINT SEAL	
Hugh E. Brunner CHIEF BRIDGE ENGR.	B-24.1.1-(502) ADOPTED: 1/74 REVISION

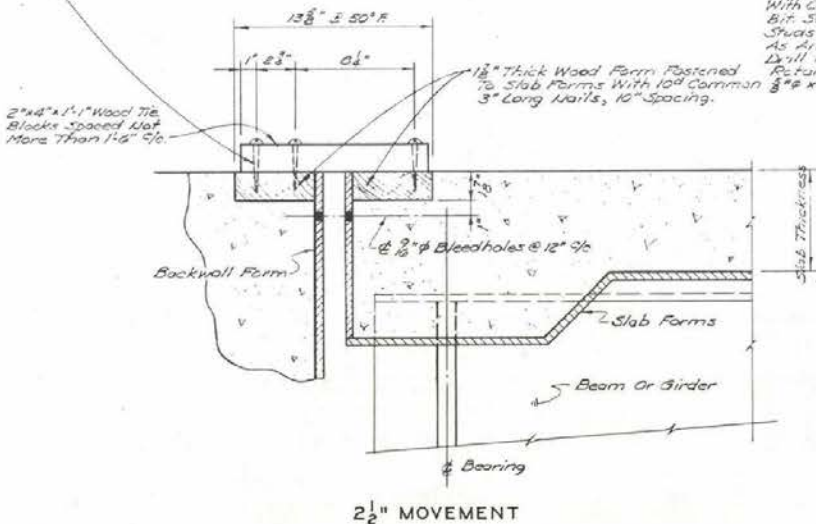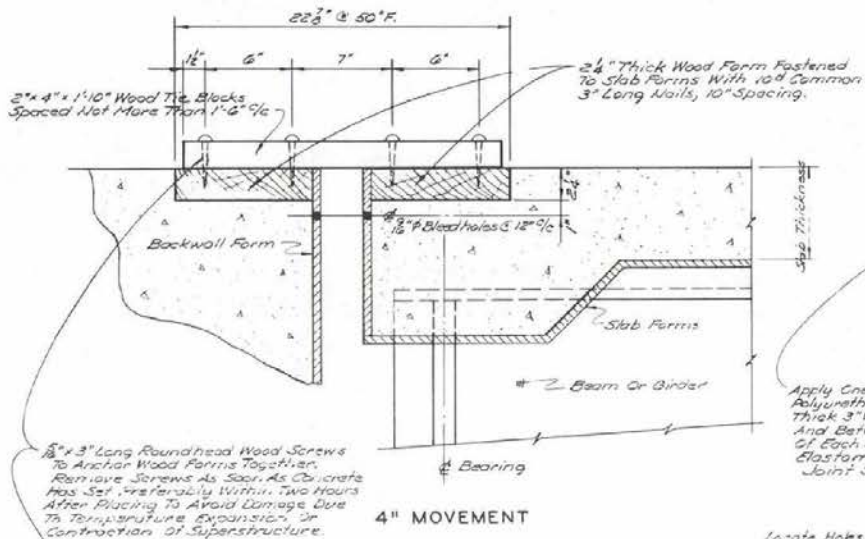


Surface Below Elastomeric Expansion Dam To Be Troweled To A Smooth Finish Parallel To The Profile Grade.

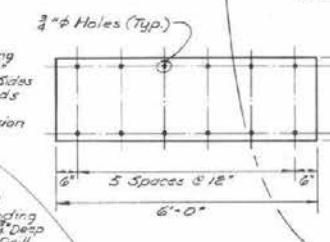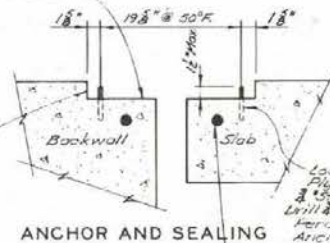

Steel Reinforced Elastomeric Expansion Joint Seal Or Equal.

Tighten All Nuts To 85 Foot Pounds. Re-Tighten To 85 Foot Pounds 1 Hour After Initial Tightening.

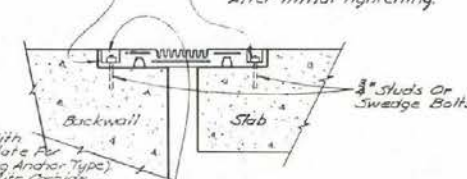

Locate Holes With Plywood Template For 3/4" Stud (Expanding Anchor Type). Drill 1/8" Deep With Carbide Percussion Drill Bit. Set Expansion Anchor Stud With 2 Lb. Hammer. As An Alternate Method Drill Holes 1" x 4" Deep With Rotary Drill And Grout In 3/8" x 6" Lg. Swedge Bolts.

Wire Brush Bolt Cavity And Brush Bolt Cavity With Polyurethane Sealant. Push Plug Down To Snap Lock. Fill Bleeder Hole With Polyurethane Sealant. Scrape Off All Excess Polyurethane Sealant.

Apply One Part Air Curing Polyurethane Sealant 3/4" Thick @ Wide Up Both Sides And Between The Ends Of Each Section Of Elastomeric Expansion Joint Seal.

Important! When Placing Studs Always Turn Anchor So That Slot In Its Base Points Toward The Expansion Joint In The Deck. Corrections Shall Be Made For Ambient Temperatures.

NOTE: Placement of Re-Bar Shall Not Interfere With Anchor Bolts.

Steel Reinforced Elastomeric Expansion Joint Seal Or Equal.

Tighten All Nuts To 85 Foot Pounds. Re-Tighten To 85 Foot Pounds 1 Hour After Initial Tightening.

Surface Below Elastomeric Expansion Dam To Be Troweled To A Smooth Finish Parallel To The Profile Grade.






INSTALLATION OF ELASTOMERIC JOINT SEAL

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

STEEL REINFORCED
ELASTOMERIC EXPANSION
JOINT SEAL

Hugh E. Brown
CHIEF BRIDGE ENGR.


B-24.1.2-(502)
ADOPTED: 11/74 REVISION

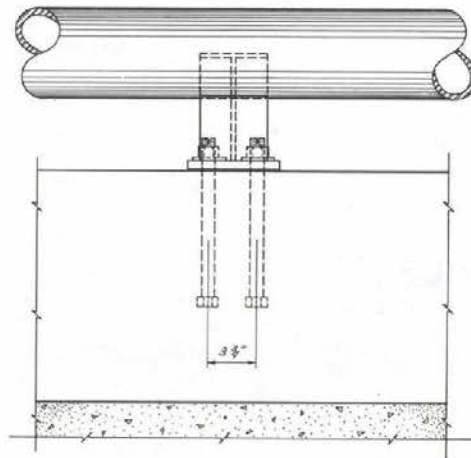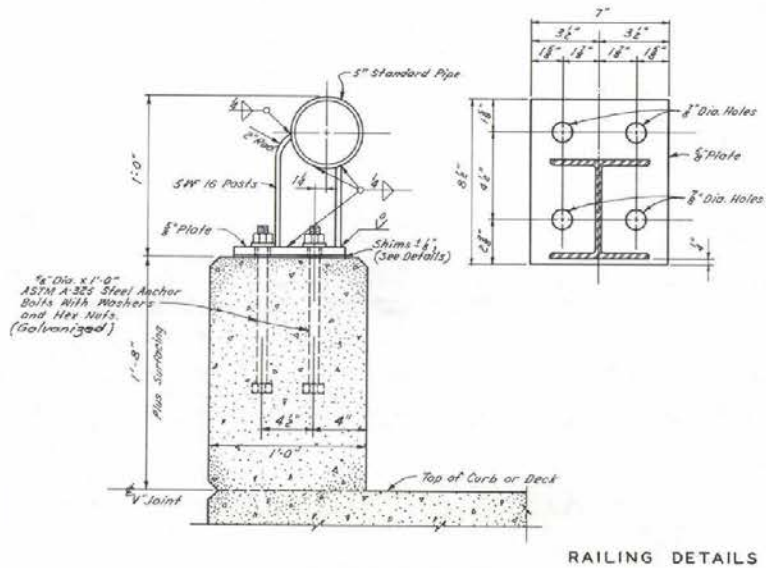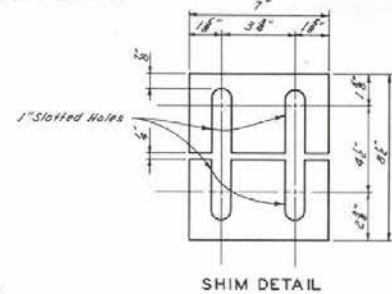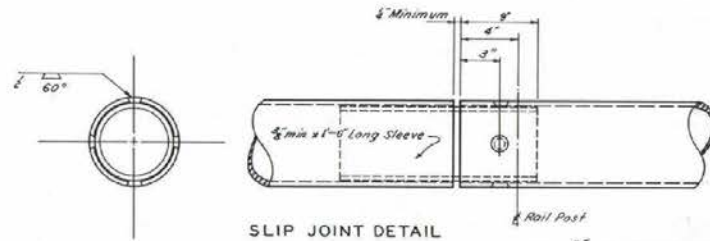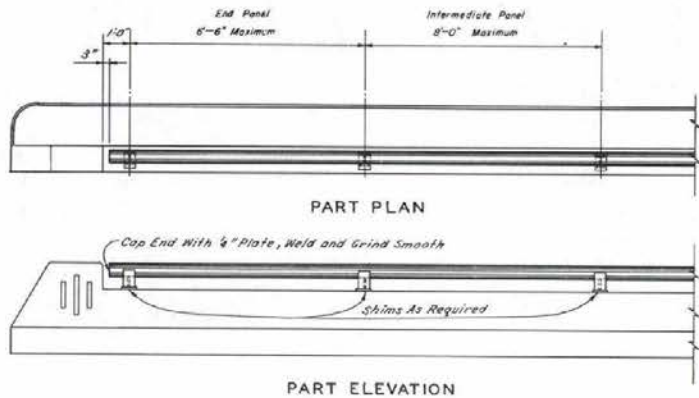

—GENERAL NOTES—

1. Railing to conform to vertical and horizontal alignment.
2. Joints to be spaced 40'-0" center to center, maximum.
3. Slip Joints to be placed in panels to match expansion joints in deck, the 4" for movement will be changed to match allowance for movement in the deck and curb.
4. Design Weight : 17 lbs. per. ft.
5. Railing Assembly Shall Be Galvanized After Fabrication.
6. All Exposed Surfaces of Railing Assembly Shall Be Painted White.

STATE OF NEVADA DEPARTMENT OF HIGHWAYS		
STEEL BRIDGE RAIL TYPE "H"		
<i>Hugh E. Brinson</i> CHIEF BRIDGE ENGR.	B-25.1.2-(508) ADOPTED:	REVISION

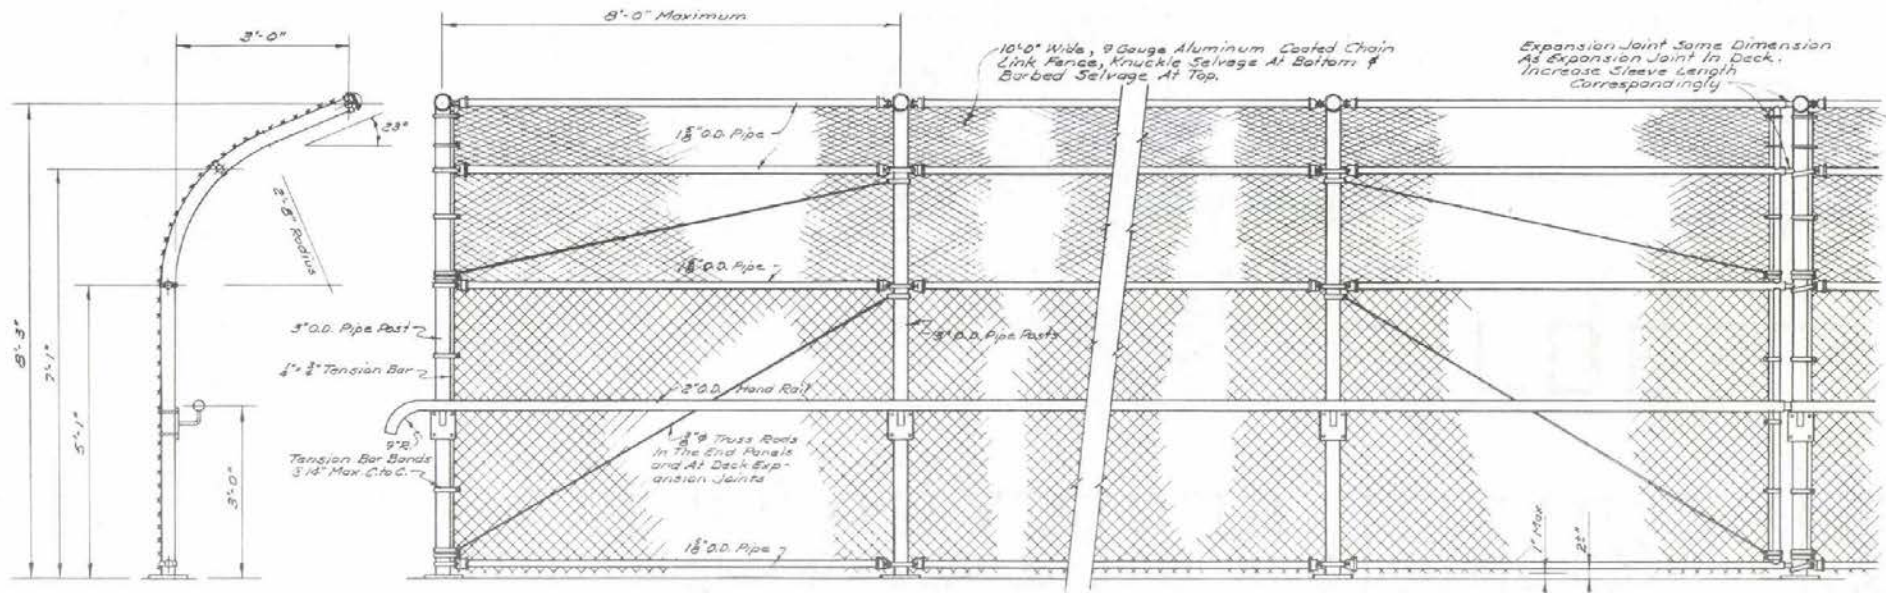


TYPICAL POST DETAILS

END POST



TYPICAL INTERIOR PANEL

AT EXPANSION JOINT

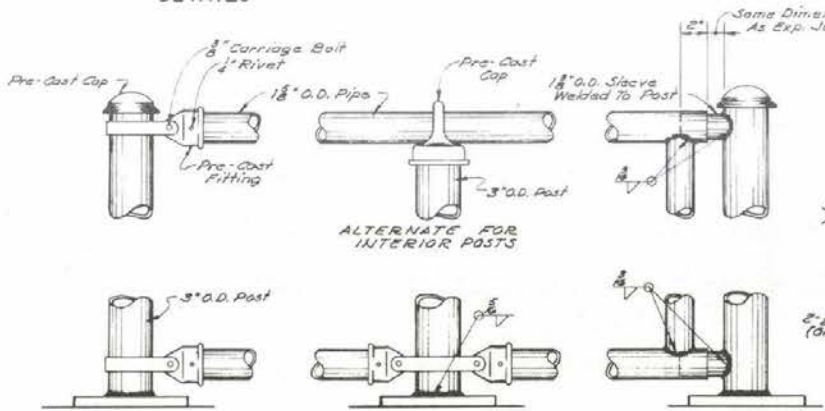

TYPICAL CONNECTION DETAILS

HAND RAIL BRACKET

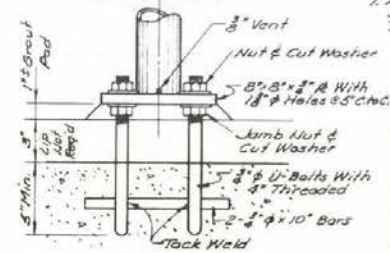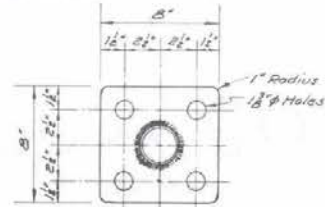

ANCHORAGE DETAILS

— GENERAL NOTES —

1. Bailing Assembly, except Chain Link Fabric, To Be Galvanized After Fabrication
2. Railing Shall Conform To Horizontal and Vertical Alignment. Posts Shall Be Vertical. Top, Intermediate and Bottom Pipes Shall Be Bent If The Radius Is 150' or Less; May Be On 8' Chords If Radius Is Over 150'.
3. Space Posts To Clear Expansion Joints By 6" Minimum To 6 Posts.
4. All Exposed Corners To Be Smooth.
5. Peen All 3/8" Bolts.
6. When Fence Is On Slope The 10' Fabric Shall Be Placed Parallel To The Slope.
7. Alternative Details May Be Submitted By The Contractor For The Engineer's Approval.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

PEDESTRIAN RAIL
TYPE "M"


Hugh C. Bremer
CHIEF BRIDGE ENGR.

B-25.1.4-(508)
ADOPTED: 1/75 REVISION


1. All Steel Railing Assembly Shall Be Galvanized After Fabrication.
 2. All Exposed Surfaces of Steel Railing Assembly Shall Be Painted White.

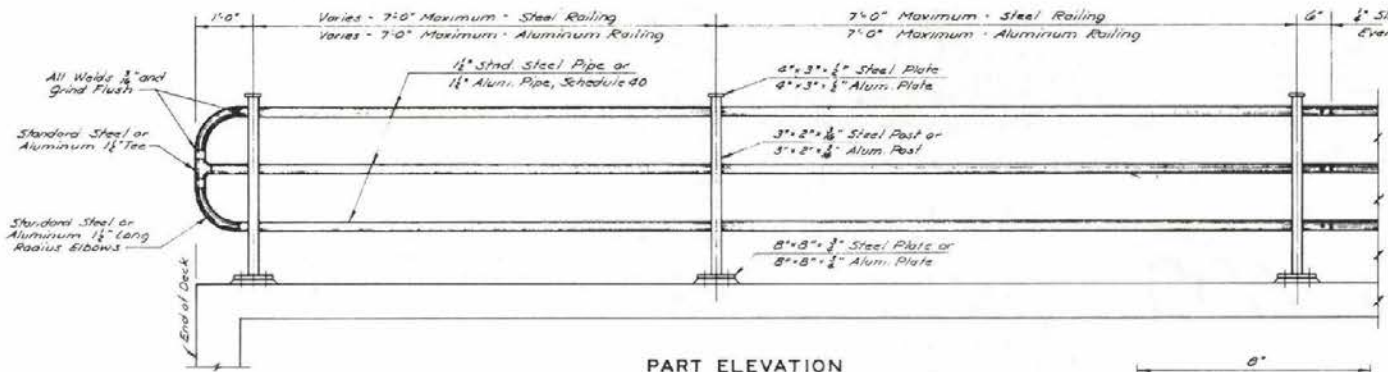


PART ELEVATION

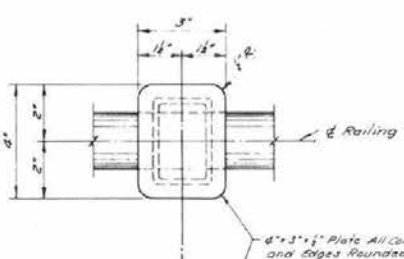


TOP POST PLATE DETAILS

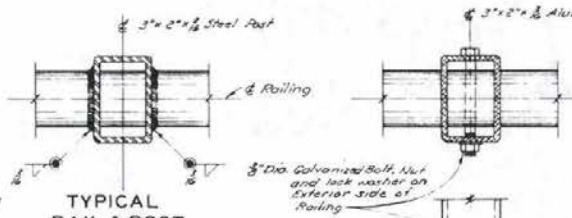


TYPICAL RAIL & POST CONNECTION STEEL




TYPICAL RAIL & POST CONNECTION ALUMINUM

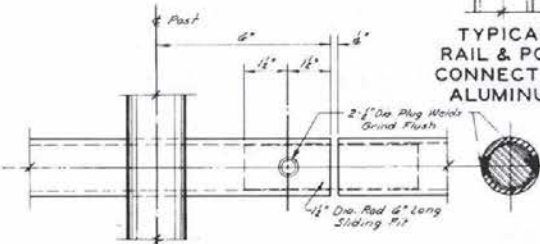

SLIP JOINT DETAILS

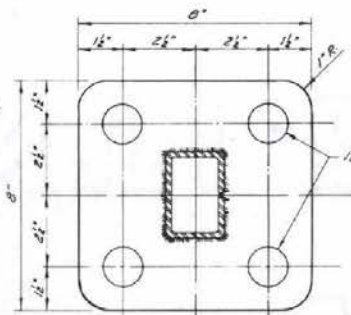


BOTTOM PLATE DETAILS

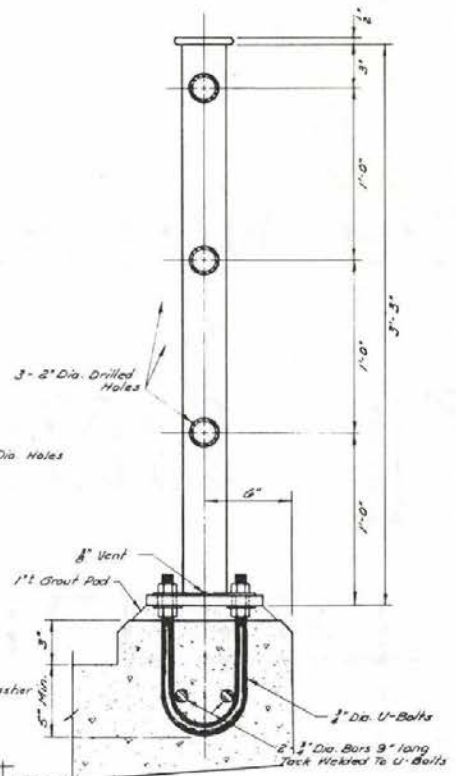

TYPICAL SECTION


STATE OF NEVADA DEPARTMENT OF HIGHWAYS		
PEDESTRIAN RAIL TYPE "R"		
Hugh E. Brainer CHIEF BRIDGE ENGR.	B-25.1.5-(508) ADOPTED: 1/14	REVISION

B22

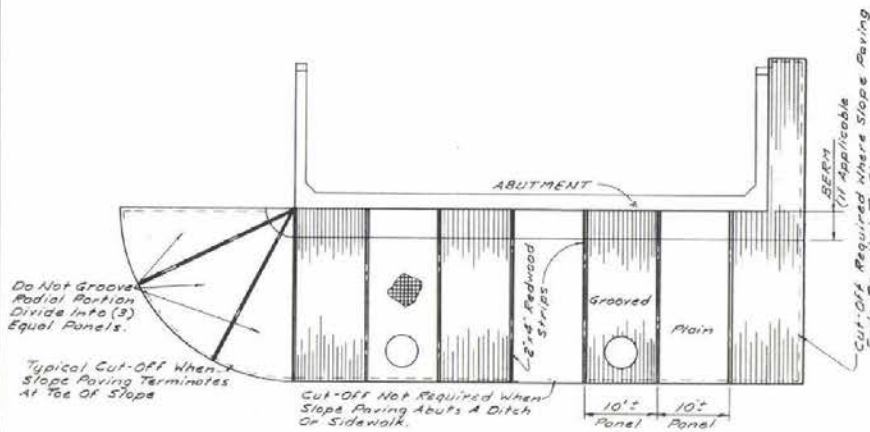


PLAN VIEW


NOTE: SLOPE PAVING IS TO BE DIVIDED INTO EQUALLY SPACED PANELS. THE WIDTH OF EACH PANEL IS TO BE AS NEARLY 10' AS SITE CONDITIONS WILL PERMIT. FOR PANELS WITH A GROOVED FINISH, CONCRETE MORTAR SHALL BE USED. IF ALTERNATELY GROOVED PANELS ARE CALLED FOR ON BRIDGE PLANS, THEN THE PANELS DIRECTLY BELOW STRUCTURE SHALL BE ALTERNATELY GROOVED AND PLAIN, SUCH THAT THE OUTER PANELS SHALL BE GROOVED.

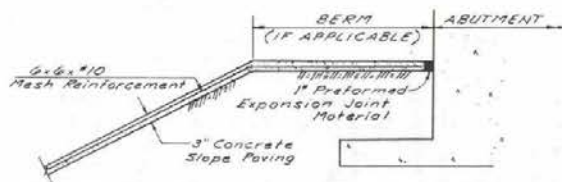


SECTION AT ABUTMENT

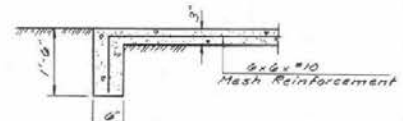


CUT-OFF AT
EDGE OF SLOPE

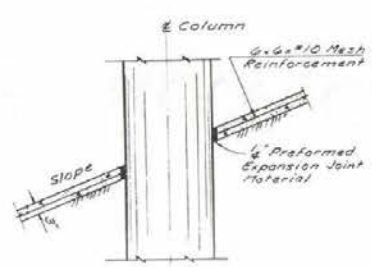


SECTION AT PIER

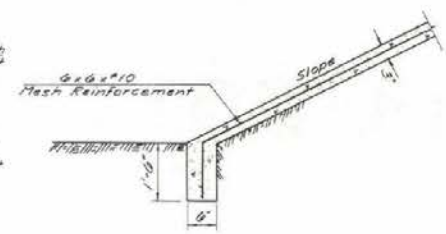


CUT-OFF AT
TOE OF SLOPE

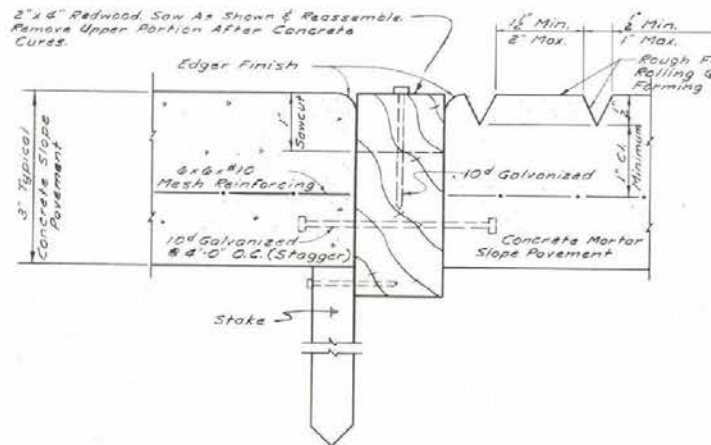


TYPICAL SECTION

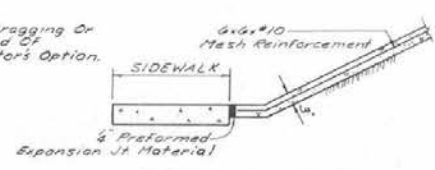

SECTION AT SIDEWALK

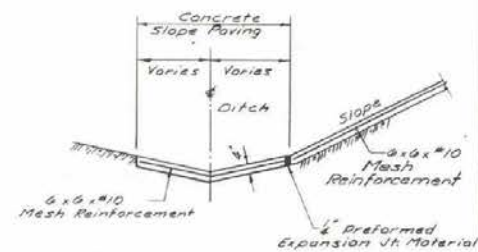


SECTION AT DITCH

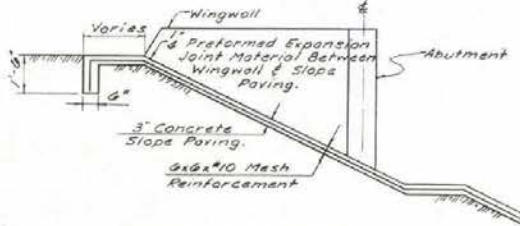

SECTION AT WINGWALL


NOTE: THESE DETAILS WILL NOT APPLY IN TOTAL TO ANY ONE SITE, BUT ARE INTENDED TO BE GENERAL ENOUGH TO COVER ALL POSSIBILITIES. TO OBTAIN LIMITS OF SLOPE PAVING FOR A SPECIFIC SITE, CONSULT THE DESIGN SHEETS.

STATE OF NEVADA DEPARTMENT OF HIGHWAYS		
CONCRETE SLOPE PAVING DETAILS		
High E. Brinson CHIEF BRIDGE ENGR.	B-20.1.1-(611) ADOPTED: 1/14	REVISION

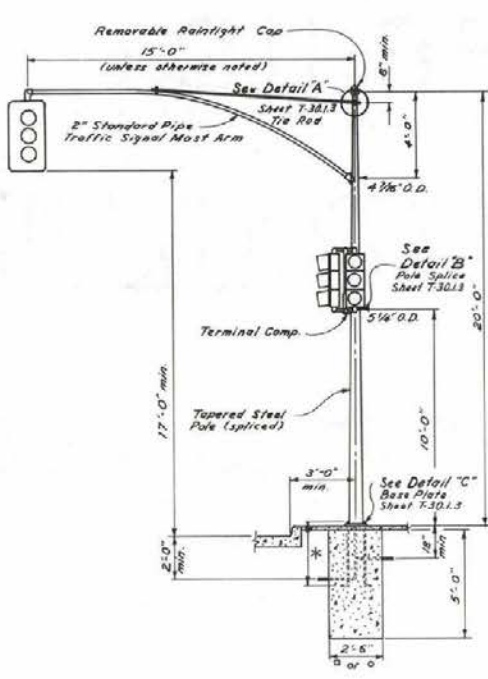


Type 2

* See Sheet T-30.1.3 for Anchor Bolt length and dimensions

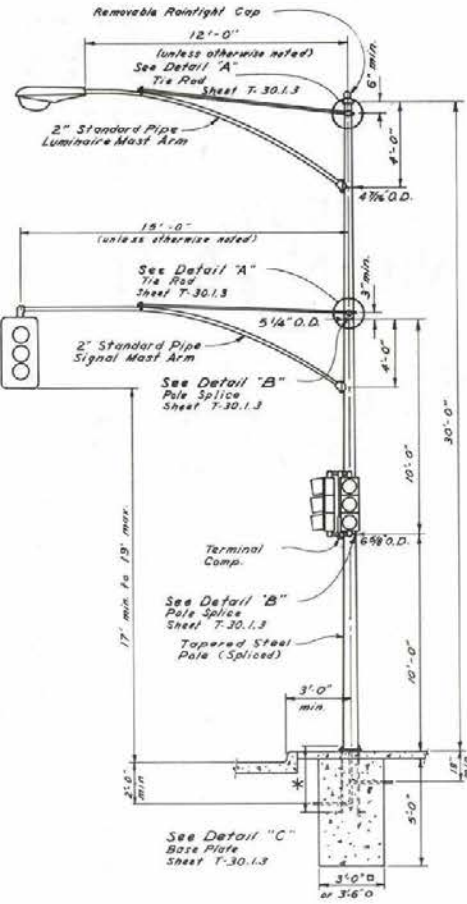

Type 3

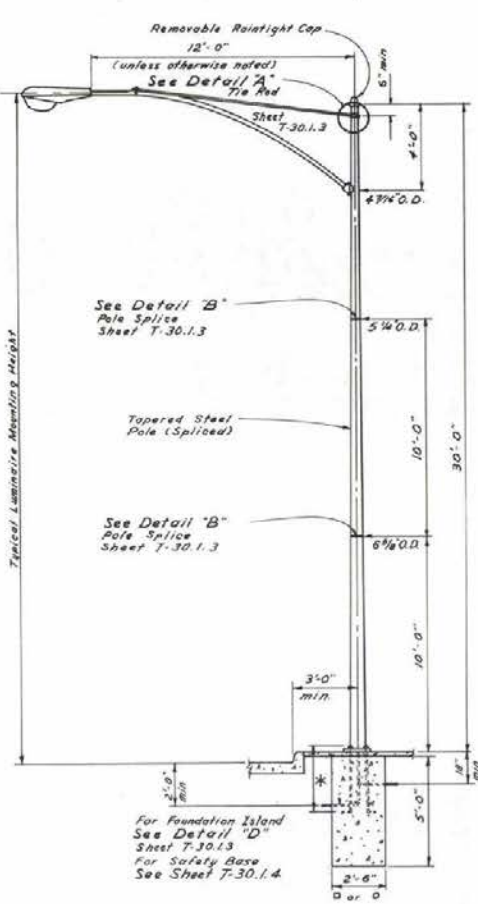

Type 4

POLE DATA

Pole Type	Pole Height & Gauge	Pole Base O.D.	Signal Arm Data			Luminaire Arm Data		
			Proj. Length	Pipe Size	Mtg. Height	Proj. Length	Pipe Size	Mtg. Height
2	20' x 10ga.	6 1/4"	15'-0"	2" Standard	See Pole Dwg	No Luminaire Arm		
3	30' x 7 ga.	8"	15'-0"	Pipe Sch 40	See Pole Dwg	12'-0"	2" Standard	30'-6" to 32'-0"
4	30' x 10ga.	8"	No Signal Arm			12'-0"	Pipe Sch 40	30'-6" to 32'-0"

GENERAL NOTES


- CALVANIZING**
- All steel poles, mast arms, bolts, screws, nuts, washers and tie rods shall be galvanized.
- STEEL MAST ARMS**
- Luminaire mast arms shall be so curved that when mast arm is fastened to pole the luminaire arm end shall not be below top of pole or more than 1'-6" above, for pole types 3 & 4.
 - The last 3' of the mast arm shall be straight and horizontal with luminaire or traffic signal attached.
 - Connection between mast arm and pole shall be made by means of a rainlight rocker or a design permitting simple removal of the mast arm.
 - Mast arms for Type 5, 6, and 7 shall be round tapered steel tube with maximum taper of 0.15 inches per foot and a 2 3/8" O.D. end section for mounting hardware. Standard 3" pipe extensions of 3'-0" max. on 12'-20" sizes may be used at the option of the manufacturer.
 - Signal arms and luminaire arms for poles 18, 19, 23 and 24 shall be ASTM A-375 Gr. C Steel.
- TIE RODS (TYPES 2, 3, AND 4 ONLY)**
- All traffic signal mast arms, and mast arms 12" and longer for luminaires with integral ballasts, shall be equipped with standard pipe tie rods with welded 5/8" round bolt tips, threaded 3". Weld shall be coated with zinc-oxide paint or galvanized.
 - Pipe tie rods shall be 3/4" for 12'-0" to 13'-0" mast arms and 1-1/4" for mast arms longer than 15'-0".
- ANCHOR BOLTS**
- Each standard shall be supplied with 4 anchor bolts. Each anchor bolt shall have 0" of thread and a 4'-00" bend with the exception of poles 23 and 24 which shall have a 6'-00" bend.
 - One anchor bolt shall be bonded to concrete.
 - Threads may be cut or rolled. Bolts shall be galvanized or plated after threads are formed. Each bolt shall be provided with 6" of threads and furnished with two nuts and two washers.
- STEEL POLES**
- Base covers required on all poles except where safety base is specified.
- WELDS**
- Longitudinal welds by submerged arc; circumferential butt welds shall have permanent back-up rings. All exposed butt welds ground flush.
- FOOTINGS**
- On sections without curb, bases shall be placed a minimum of 6' from shoulder or a minimum of 10' from traveled way, whichever is greater.
- SAFETY BASE**
- Type 4 and Type 7 poles will require safety base assembly unless otherwise noted on plans.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

LIGHTING AND SIGNALS


Russell C. Hill
CHIEF TRAFFIC ENGR.

T-30.1.1 (623)
ADOPTED 2/71
REVISION
3 0/75

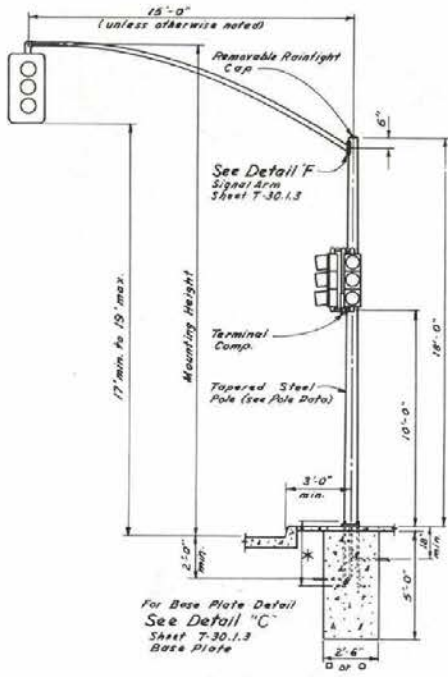


Type 5

* See Sheet T-30.1.3 for Anchor Bolt lengths and dimensions.

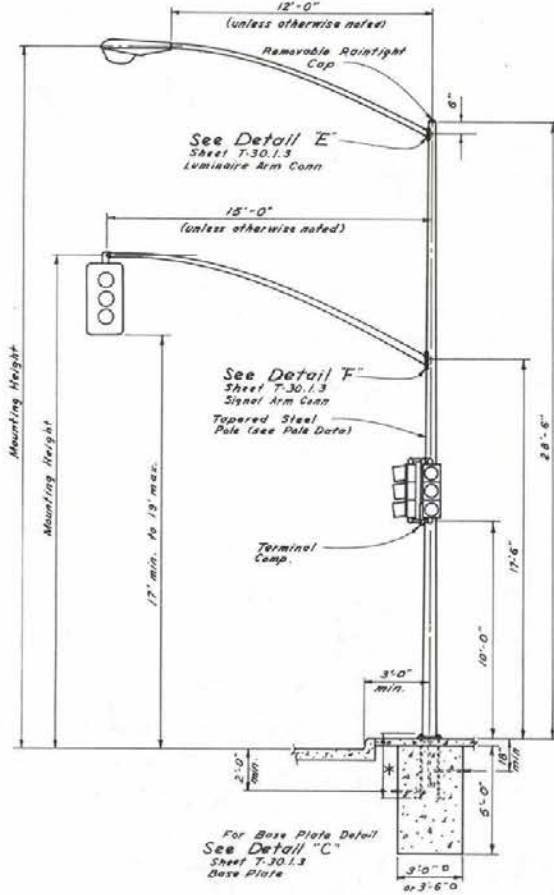

Type 6

For Base Plate Detail See Detail "C" Sheet T-30.1.3 Base Plate

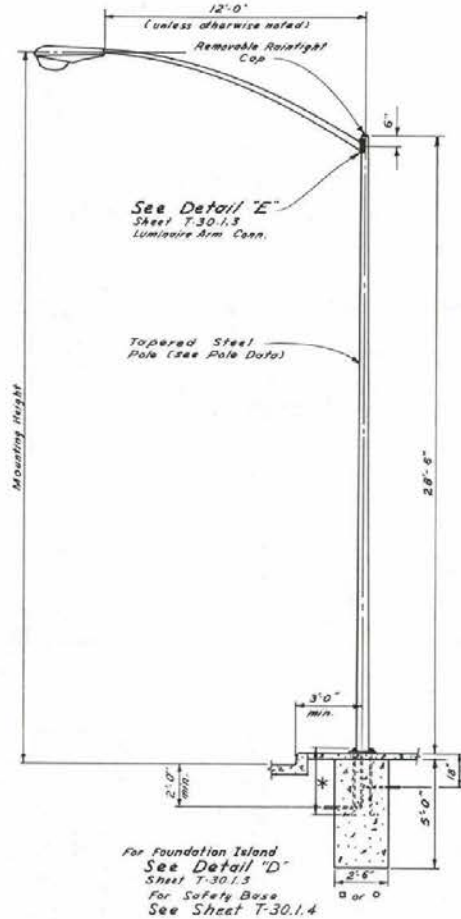

Type 7

For Foundation Island See Detail "D" Sheet T-30.1.3 For Safety Base See Sheet T-30.1.4


POLE DATA

Pole Type	Pole Height & Gauge	Pole O.D. Base Top	Signal Arm Data				Luminaire Arm Data			
			Proj. Length	Gage	Min. @ Pole	Mtg. Height	Proj. Length	Gage	Min. @ Pole	Mtg. Height
5	18'-0" x 10 ga	7 1/2"	15'-0"	10 ga	4 1/2"	22'-4" ±	No Luminaire Arm			
6	28'-6" x 7 ga	7 1/2"	12'-0"	10 ga	4 1/2"	22'-4" ±	12'-0"	10 ga	3 1/2"	32'-4" ±
7	28'-6" x 10 ga	7 1/2"	No Signal Arm				12'-0"	10 ga	3 1/2"	32'-4" ±


FOR GENERAL NOTES SEE SHEET T-30.1.1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


LIGHTING AND SIGNALS


 T-30.1.2 (623)
 CHIEF TRAFFIC ENGR. ADOPTED 2/71 REVISION 2 8/75


Arm drilled and dimpled (A), or with tapered washers to permit straight tie rods (B).

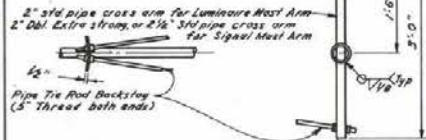


PLAN

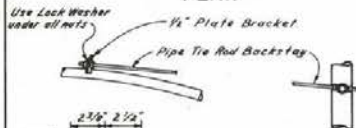


ELEV.



BRACKET
Detail "A"
MAST ARM TIE ROD AND CROSS ARM




Detail "B"
POLE SPLICE

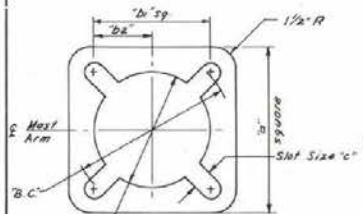


Detail "C"
BASE PLATE

(POLE TYPES 2, 3, 5, 6)
(Used on Pole Types 4 & 7 when mounted on structures or when safety base is not required).

3' x 5' Handhole (Type 2, 3, 4),
4' x 6' Handhole (Type 5, 6, 7), twinforced with 1/2" x 3/8" ring welded to outside of pole; cover plate of No. 10 ga.

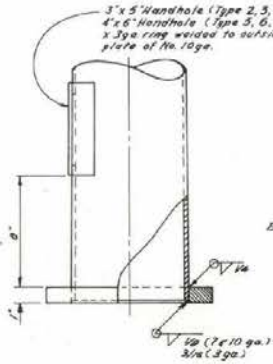

TYPICAL FOUNDATION ISLAND

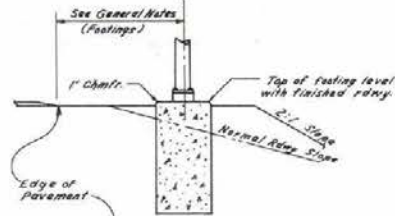


Detail "D"

Pole Type	Base Plate				Anchor Bolt	Size
	"a"	"b"	"c"	"d"	"B.C."	
2	11 1/2"	8 1/2"	4 1/2"	1 1/2"	9 3/8"	1" x 3/8" x 4"
3	11 1/2"	8 1/2"	4 1/2"	1 1/2"	11"	1 1/8" x 4 1/2" x 4"
5	11 1/2"	7 3/4"	3 3/4"	1 1/2"	11"	1" x 3/8" x 4"
6	11 1/2"	7 3/4"	3 3/4"	1 1/2"	11"	1 1/8" x 4 1/2" x 4"


Base Plate Dim. for Types 4 & 7 When Mounted on Structures or when safety base is not required.

Note: Types 4 & 7 normally use Safety Base (Ref. Sheet T-30.1.4.)

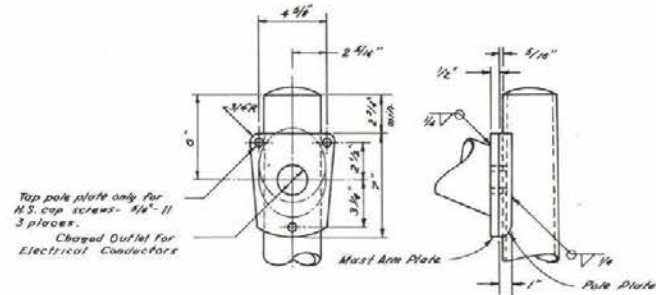

Detail "E"
LUMINAIRE ARM CONNECTION

Top pole plate only for H.S. cap screws - 3/8" - 11 3 places.
Charged Outlet for Electrical Conductors

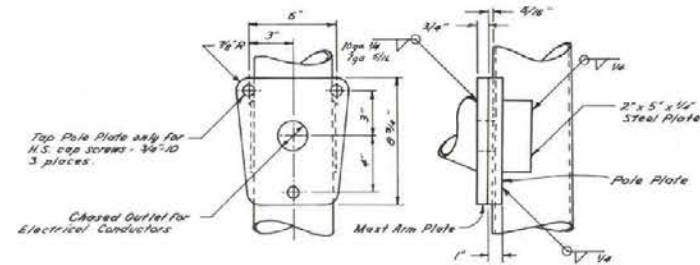

Detail "F"
SIGNAL ARM CONNECTION

(Note: Alternative details approved by the Engineer may be substituted for the arm connections shown.)


FOR GENERAL NOTES SEE SHEET T-30.1.1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


LIGHTING AND SIGNALS

Russell C. Hill
CHIEF TRAFFIC ENGR.


T-30.1.3 (523)
ADOPTED: 2/71
REVISION
3 8/75

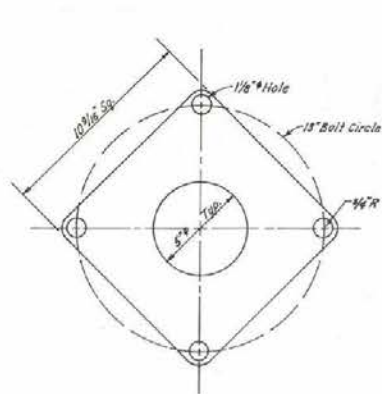


SLIP BOLT GASKET
22 Gage Galvanized Sheet Metal

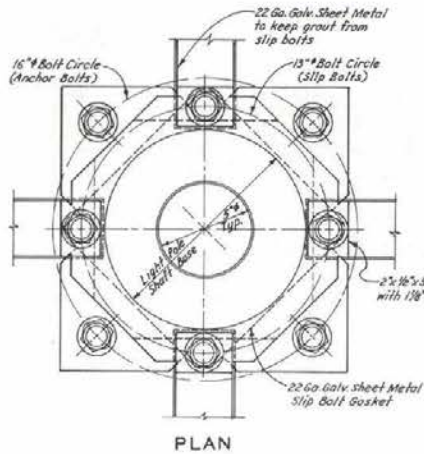


PLAN

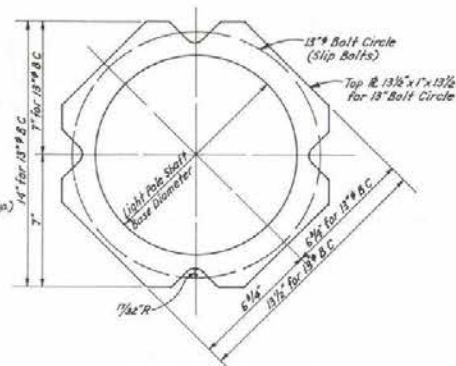

PLAN OF TOP PLATE

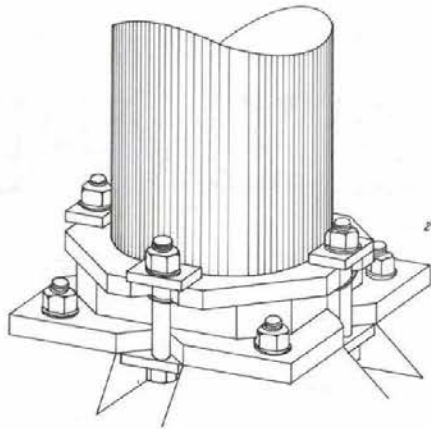

LIGHT POLE BASE

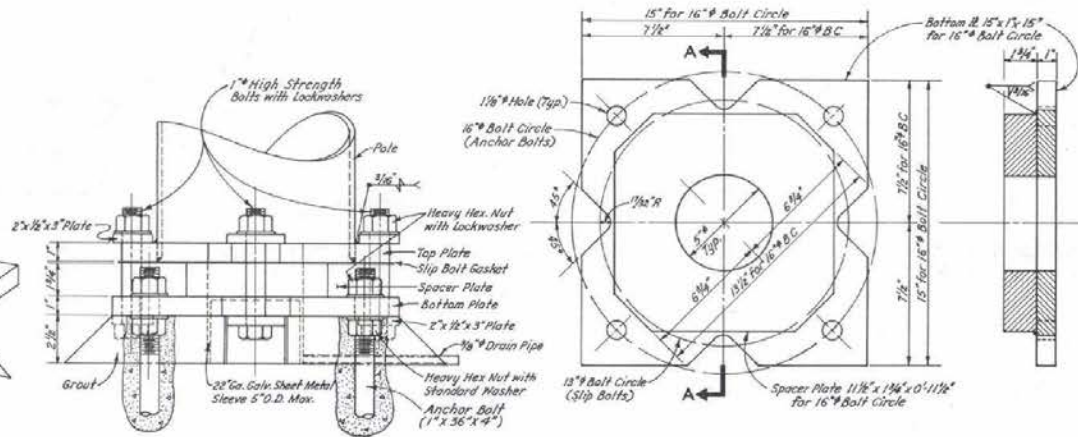

PLAN OF BOTTOM AND SPACER PLATE

GENERAL NOTES


1. Place bottom plate with spacer plate and leveling nuts on anchor bolts and fasten in place.
2. Top plate shall be furnished by light pole fabricator as light pole base plate with dimensions as shown in plan view.
3. Erect light pole and secure with 1" high strength bolts. Bolts shall be installed in the slots so that the bolt shanks are in contact with the plates.
4. See Sheet T-30.1.1 General Notes for anchor bolt details.
5. All steel plate assemblies shall be hot-dip galvanized after fabrication.
6. All nuts, bolts and washers shall be electro-plated cadmium in accordance with ASTM A-165, Type TS.
7. All contact areas of plates shall be free of galvanizing beads or runs.
8. Safety bases shall be utilized on all steel light poles except on structures or unless otherwise noted on the plans.
9. Slip bolts shall be torqued to 150 foot-pounds or 1800 inch-pounds.
10. Grouting shall be done after light pole has been located in final position.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**SAFETY BASE
FOR LIGHT POLES**

Russell C Hill
CHIEF TRAFFIC ENGR

T-30.1.4 (623)
ADOPTED: 2/71 REVISION
8/76

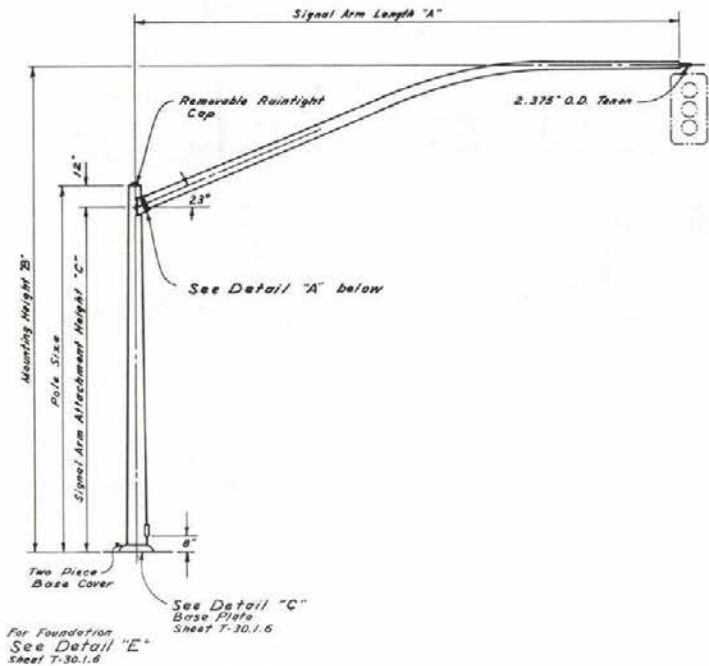


Type 18 & 23

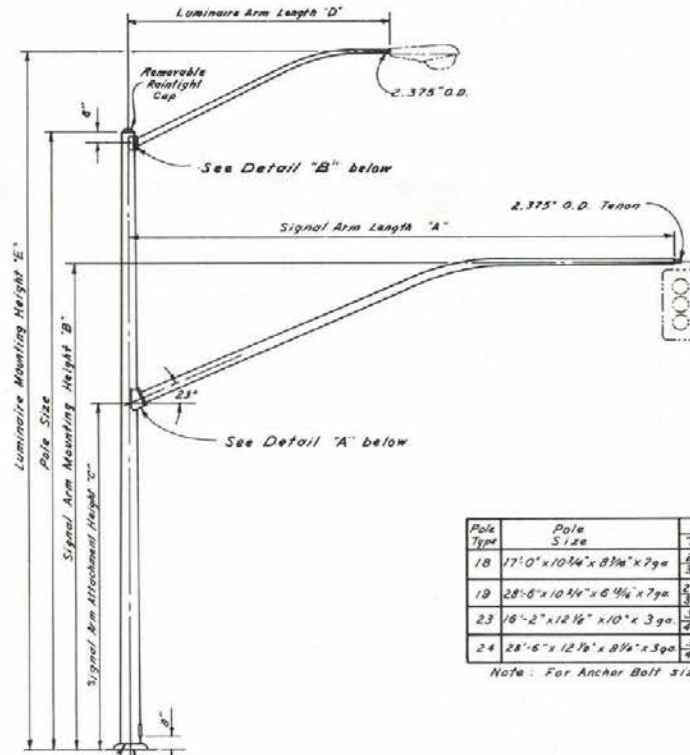



Type 19 & 24

Pole Type	Pole Size	Signal Arm			Luminaire Arm	
		A' O.D. x O.D. x ga	B' "	C' "	D' O.D. @ Pole x ga	E' "
18	17'-0" x 10 1/4" x 8 3/8" x 7 ga	25' 7 3/8" x 3 3/8" x 7 ga	22'-6"	16'-0"	No Luminaire	
		30' 8" x 3 7/8" x 7 ga	23'-0"	16'-0"		
19	28'-6" x 10 1/4" x 6 1/4" x 7 ga	25' 7 3/8" x 3 3/8" x 7 ga	22'-6"	16'-0"	4 5/8" x 10 ga	32'-3"
		30' 8" x 3 7/8" x 7 ga	23'-0"	16'-0"	4 5/8" x 10 ga	32'-3"
23	18'-2" x 12 1/2" x 10" x 3 ga	35' 4 1/2" x 3 3/8" x 3 ga	23'-0"	15'-2"	No Luminaire	
		40' 3 3/8" x 3 3/8" x 3 ga	23'-0"	15'-2"		
24	28'-6" x 12 1/2" x 8 1/2" x 5 ga	35' 8 1/2" x 3 3/8" x 3 ga	23'-0"	15'-2"	4 5/8" x 10 ga	32'-3"
		40' 3 3/8" x 3 3/8" x 3 ga	23'-0"	15'-2"	4 5/8" x 10 ga	32'-3"

Note: For Anchor Bolt sizes see Detail "C" Sheet T-30.1.6

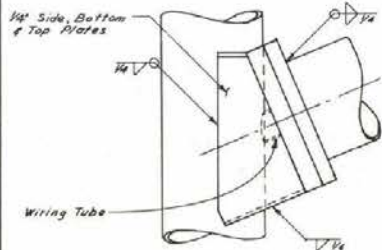

Detail "A"
SIGNAL ARM ATTACHMENT

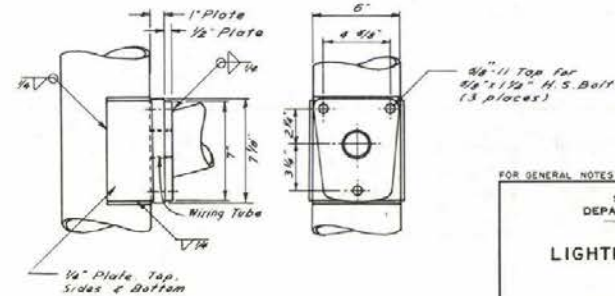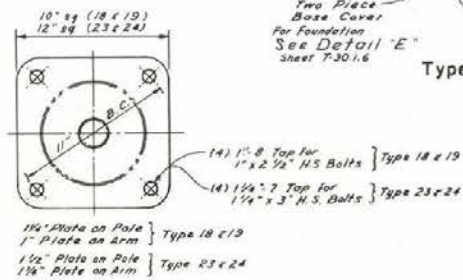

Detail "B"
LUMINAIRE ARM ATTACHMENT

FOR GENERAL NOTES SEE SHEET T-30.1.1

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

LIGHTING AND SIGNALS

 CHIEF TRAFFIC ENGR.	T-30.1.5	(625)
	ADOPTED: 2/71	REVISION



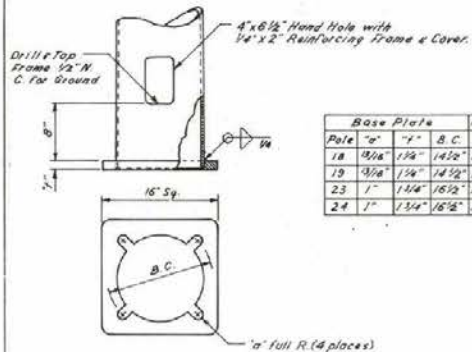


Plate	"a"	"b"	B.C.	Anchor Bolts	Size
18	15 1/2	15 1/2	14 1/2	1/2"	1/4" x 4" x 4"
19	15 1/2	15 1/2	14 1/2	3/8"	1/2" x 4" x 4"
23	17	17	16 1/2	1/2"	1/4" x 6" x 6"
24	17	17 1/4	16 1/2	3/4"	1/4" x 6" x 6"


Detail "C"
BASE PLATE
Plate Type 18, 19, 23 & 24

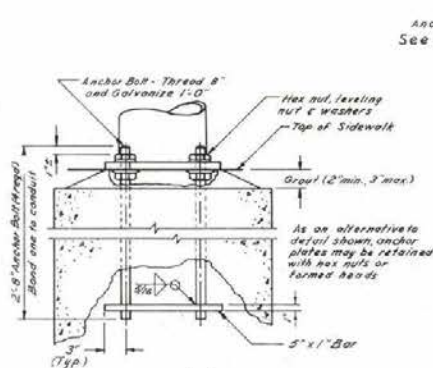


Detail "D"
ANCHOR BOLT DETAIL
Optional Type 18, 19, 23 & 24

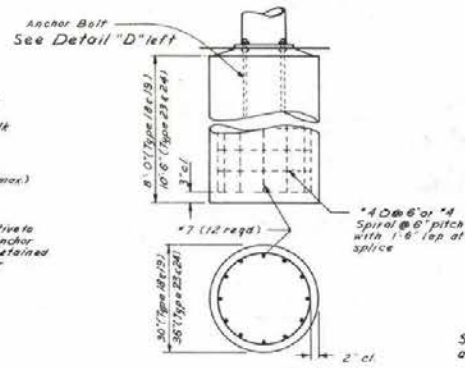

Detail "E"
CAST IN DRILLED HOLE PILE

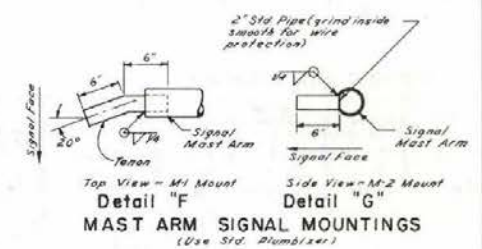


Detail "F"
MAST ARM SIGNAL MOUNTINGS
(Use Std. Plumbing)

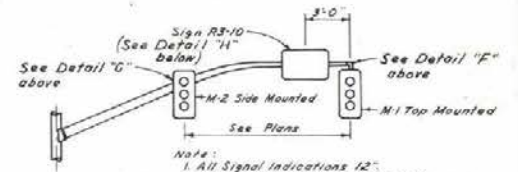


MAST ARM SIGNAL PLACEMENT


- Note:**
1. All Signal indications 12"
 2. Backslashes shall be Equipped
 3. Sign R3-10 required for all left turn signals.

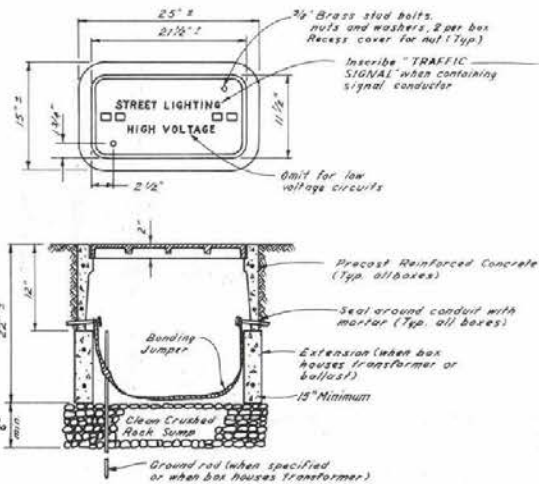

NO 5

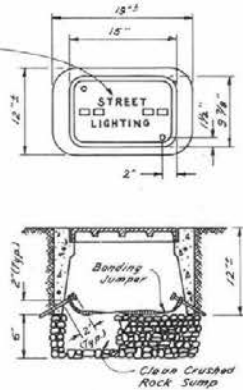


NO 3 1/2

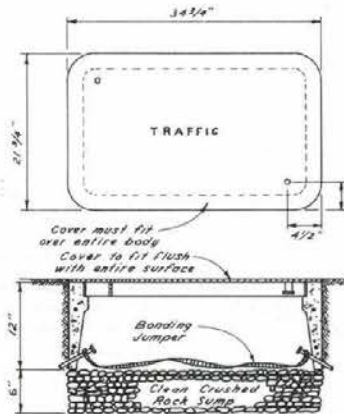

NO 7

DETAILS - PULL BOXES

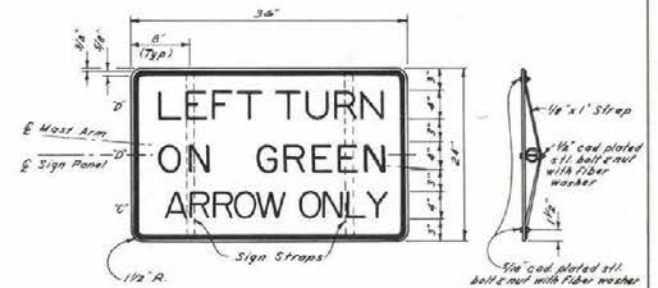


Detail "H"
SIGN R3-10
(Black on ReflectORIZED White)

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

LIGHTING AND SIGNALS


Russell C. Hill
CHIEF TRAFFIC ENGR

T-301.6 (623)
ADOPTED 2/71 (REVISION 3-1/78)

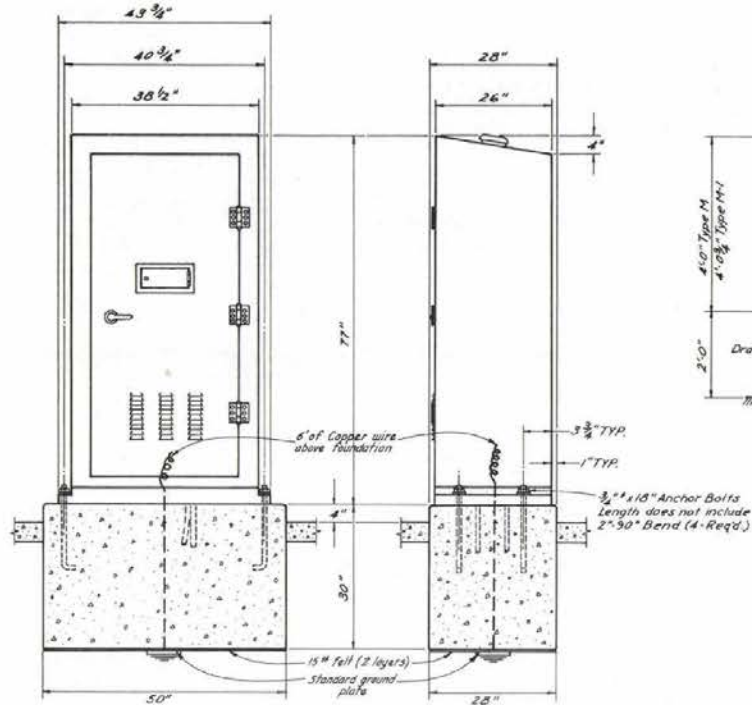


TYPE "R" CABINET

1/2" Marine Plywood Backpanel, painted black and installed in the back of cabinet for mounting of relays.

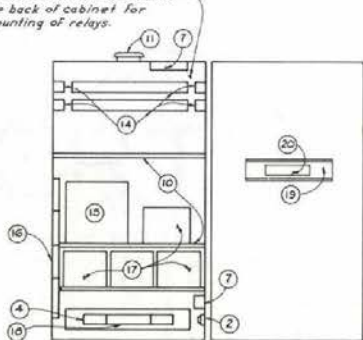


TYPE "R" CABINET

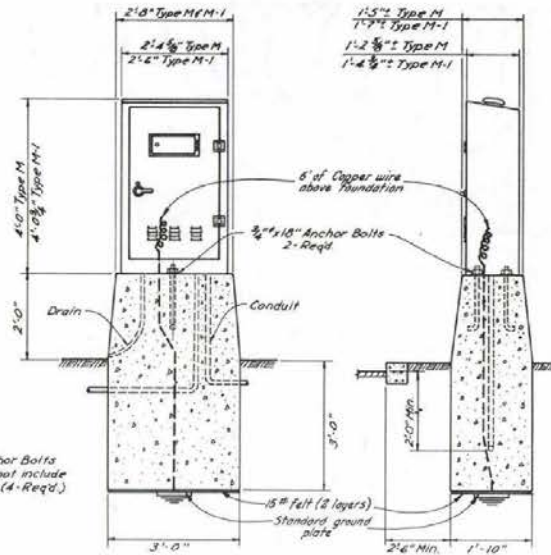


TYPE M & M-I CABINET

NOTES FOR TYPE M-I:


1. Material shall be 14ga sheet steel.
2. Door shall lock at three points.

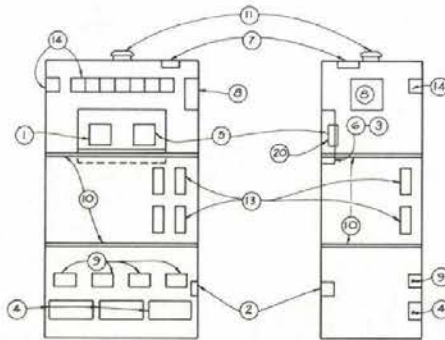

TYPE M & M-I CABINET

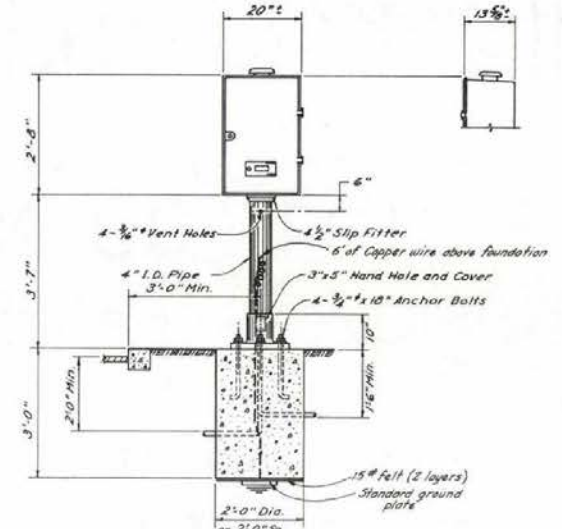


TYPE "G" CABINET

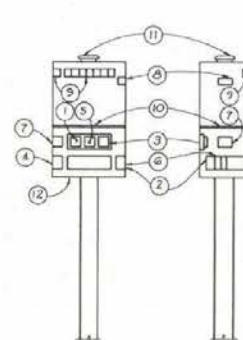

TYPE "G" CABINET


1. Main Switch.
2. Plug Fuse.
3. Signal Flash Switch Inside Cabinet.
4. Field Wire Terminal Blocks.
5. Auxiliary Door Flash Switch.
6. N.E.M.A. Standard Plug Receptacle with Grounding Contact.
7. Radio Interference Suppressor.
8. Solid State Signal Flasher (Cabinet M-I: To Determine Poles & Capacity, unless Otherwise Specified).
9. External Light Relays.
10. Shelf.
11. Thermostat-Controlled Fan with T Vent.
12. Eight 1/2" Screened Vent Holes.
13. Instrument Terminal Strip.
14. Control Relays.
15. Dispatcher Unit.
16. Internal Interconnect Terminal Strips.
17. Minor Movement Units.
18. Slant Panel.
19. Police Panel.
20. Internal Power Panel and Recall Switches for all Detected Phases.

CABINET WIRING

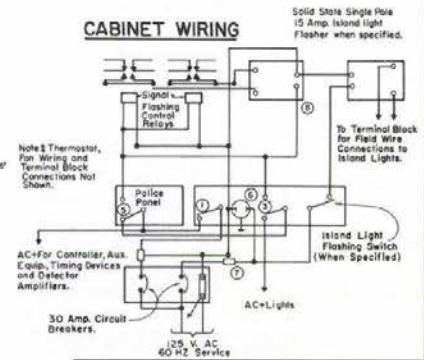

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS
LIGHTING AND SIGNALS



--- Russell Hill --- T-30.1.7 (623)
CHIEF TRAFFIC ENGR. --- ADOPTED: 2/71 REVISION 2 //72

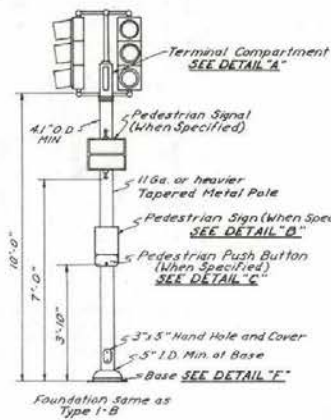

TYPE I-A


SIGNAL STANDARDS

TYPE I-B

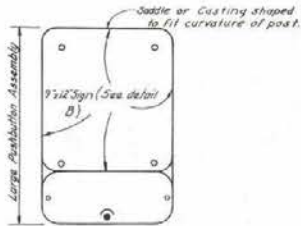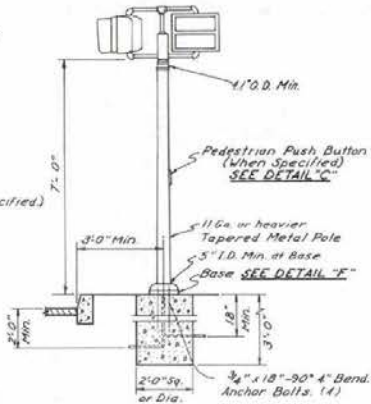


DETAIL-"C"

Note: All Pedestrian Push Buttons mounted on posts shall have a mounted height of 3'-10".

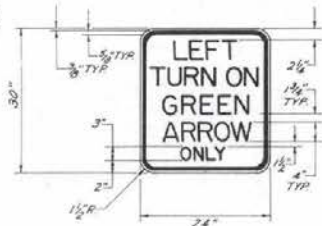

DETAIL-"D"

Note: Sign R3-10 to be Black on Reflectorized White.

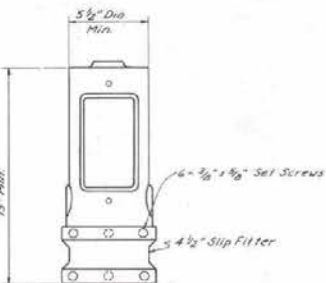

DETAIL-"A"



PUSH BUTTON FOR GREEN LIGHT

(For 3 Light Signal)




PUSH BUTTON FOR WALK SIGNAL


(For Walk Signal)

NOTES:
1. Arrow to be left or right or both as required.
2. Porcelain enameled, 9"x12" sign, Black letters on white background.

DETAIL-"B"

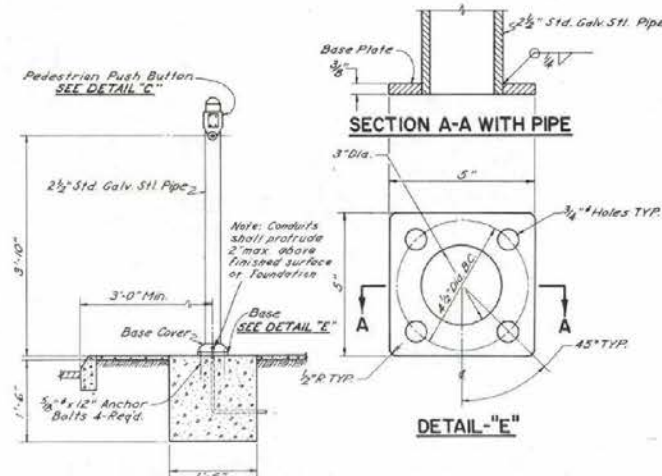

PEDESTRIAN PUSH BUTTON POST

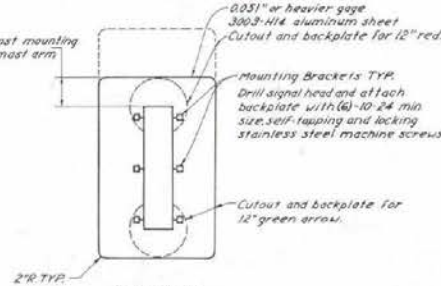


REAR VIEW

Note: No background light to show between plate and head. Mast Arm Backplates shall be lowered.

DETAIL-"G"




TYPICAL DIRECTIONAL LOUVER

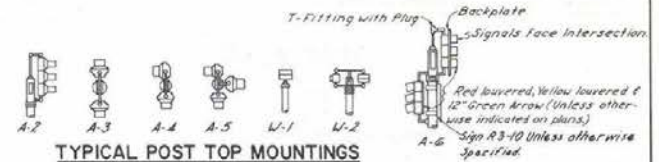

TYPICAL POST TOP MOUNTINGS



TYPICAL BRACKET MOUNTINGS



DETAIL-"F"

DETAIL-"E"

TYPICAL ARROW LENS






STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

LIGHTING AND SIGNALS

Russell C. Hill
CHIEF TRAFFIC ENGR.

T-301.8 (623)
ADOPTED: 2/71 REVISION
3-1/75

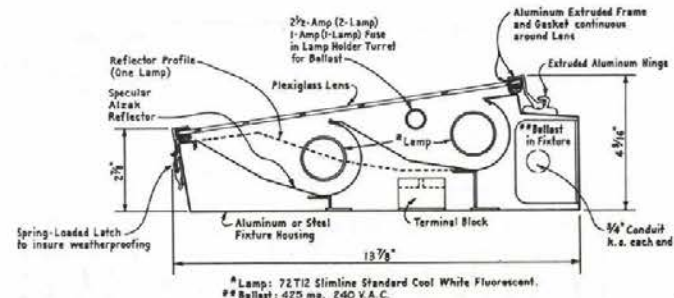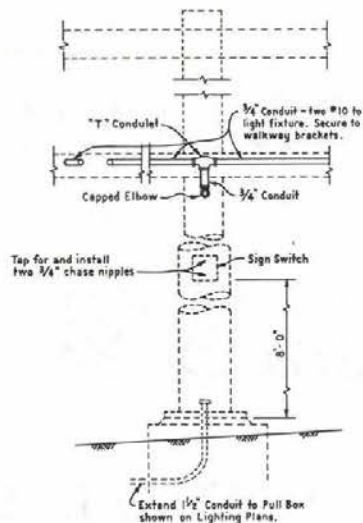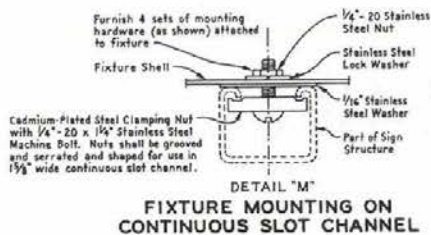

SECTION - LIGHTING FIXTURE

GENERAL NOTES

- Where steel is indicated, part shall be hot-dipped galvanized after fabrication. Where sheet steel is indicated, part shall be fabricated from hot-dipped galvanized sheet steel. After fabrication, edges and flaws in galvanizing shall be cleaned and painted with two coats of Mil. Spec. Mil.-P-21035. Other metal parts shall be made of bronze, phosphor bronze, brass, copper beryllium or A151 Type 316 stainless steel, unless otherwise noted.
- Wiring between fixtures shall be run in 3/4" liquid-tight flexible conduit. Flexible conduit shall be secured to nearest walkway structural member bracket using galvanized bonding strap and brass machine screws.
- Two lamp fixtures shall be used for signs over 70" vertical dimension and one lamp fixture shall be used for signs with vertical dimension of 70" and less.
- Alternate fixture fabrication methods and design details may be acceptable provided the light distribution, lamp size, mounting details and integral ballast are equivalent to the fixture shown. All variations must be approved by the Engineer.
- Manufacturer shall submit five copies of shop drawings to the Engineer for approval prior to fabrication if fixtures have not previously been approved.
- For method of mounting fluorescent fixtures see walkways plan titled "Walkway Details NE 1" and "Walkway Details NE 2" (T-36.1.9 and T-36.1.10).
- See sign layout sheets for size of panels.

LIGHTING FIXTURE DATA

LENGTH OF PANEL (FEET)	HEIGHT OF PANEL (INCHES)	NUMBER OF FIXTURES	NUMBER OF LAMPS	CONSECUTIVE SPACING FROM LEFT EDGE OF PANEL TO CENTER OF FIXTURES (INCHES)
10	40-70 80-120	1	1 2	60
12	40-70 80-120	2	2 4	36.5 - 74
14	40-70 80-120	2	2 4	42 - 84
16	40-70 80-120	2	2 4	47.5 - 97
18	40-70 80-120	3	3 6	36.5 - 74 - 74
20	40-70 80-120	3	3 6	40 - 80 - 80
22	40-70 80-120	3	3 6	44 - 88 - 88
24	40-70 80-120	4	4 8	36.5 - 74 - 74 - 74
26	40-70 80-120	4	4 8	39 - 78 - 78 - 78
28	40-70 80-120	4	4 8	42 - 84 - 84 - 84
30	40-70 80-120	4	4 8	45 - 90 - 90 - 90
32	40-70 80-120	5	5 10	38 - 77 - 77 - 77
34	40-70 80-120	5	5 10	42 - 81 - 81 - 81
36	40-70 80-120	5	5 10	44 - 86 - 86 - 86
38	40-70 80-120	6	6 12	38 - 76 - 76 - 76 - 76
40	40-70 80-120	6	6 12	40 - 80 - 80 - 80 - 80
42	40-70 80-120	6	6 12	42 - 84 - 84 - 84 - 84
44	40-70 80-120	7	7 14	38 - 76 - 76 - 76 - 76
46	40-70 80-120	7	7 14	36.5 - 80 - 80 - 80 - 80


DETAILS OF TYPICAL WIRING AND SIGN SWITCH INSTALLATION

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**LIGHTING FIXTURES
OVERHEAD FLUORESCENT
INTEGRAL BALLAST**

Russell S. Hill
CHIEF TRAFFIC ENGR.


T-301.9 - (623)
ADOPTED: 1/75 REVISION

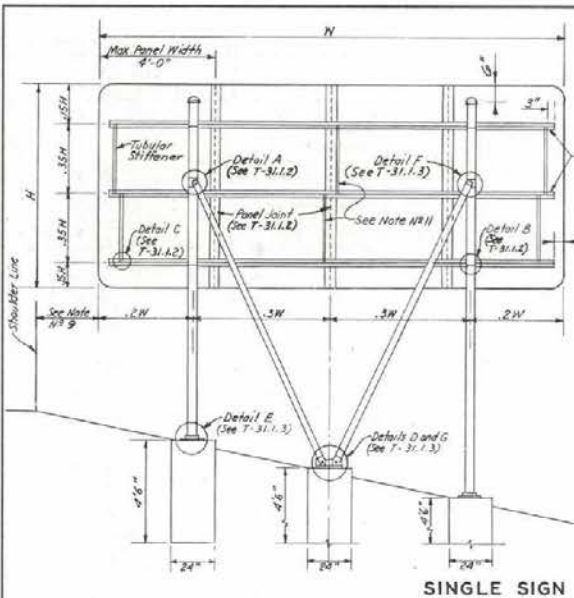


SINGLE SIGN

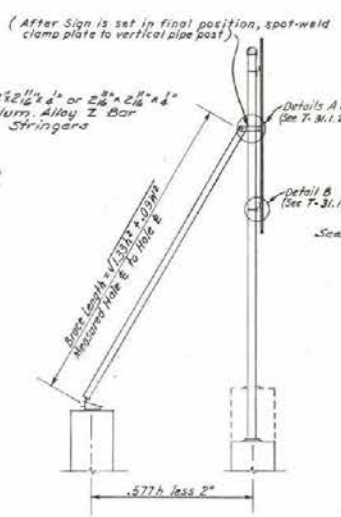

DOUBLE SUPPORT WITH BRACES

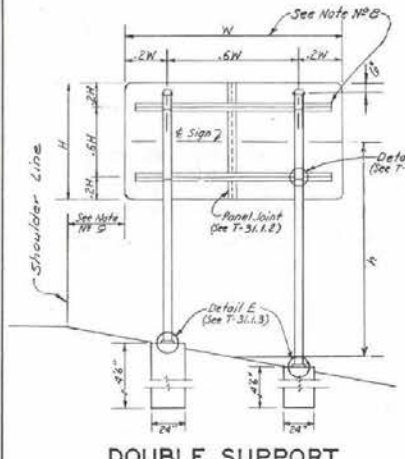


DOUBLE SUPPORT

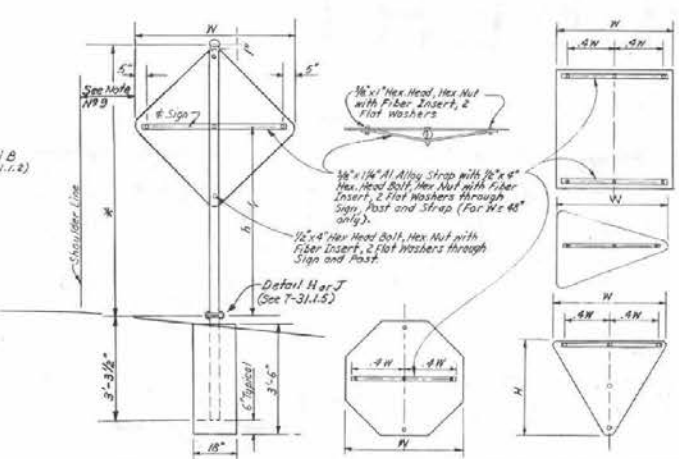

SINGLE SUPPORT

* Post length as shown on Sign Summary Sheet

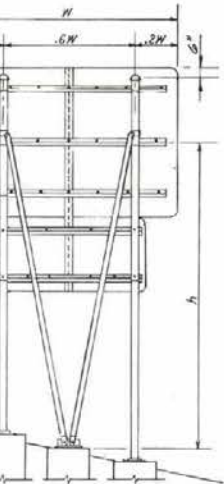

DOUBLE SIGN

PIPE SIZE FOR BRACED PIPE SUPPORTS

VERTICAL POST SIZE						BRACE SIZE					
SIGN AREA SQ. FT.	0' to 5'	5' to 6'	6' to 10'	10' to 12'	12' to 15'	SIGN AREA SQ. FT.	0' to 8'	8' to 9'	9' to 11'	11' to 12'	12' to 15'
0' to 70'	2"	2"	3"	3"	3"	0' to 70'	2"	2"	2"	3"	3"
70' to 140'	2"	2"	3"	3"	3"	70' to 140'	2"	2"	2"	3"	3"
140' to 200'	3"	3"	3"	3"	3"	140' to 200'	2"	2"	3"	3"	3"

NOTE: When pipe sizes from tables for vertical posts and braces differ, use larger diameter indicated for both supports.


PIPE SIZE DETERMINATION FOR SINGLE POST AND DOUBLE POST WITHOUT BRACE

SIGN AREA SQ. FT.	0' to 5'	5' to 10'	10' to 12'	12' to 14'	14' to 15'	15' to 17'
0' to 5'	5"	5"	5"	5"	5"	5"
5' to 7.5'	5"	5"	5"	5"	5"	5"
7.5' to 10'	5"	5"	5"	5"	5"	5"
10' to 12.5'	5"	5"	5"	5"	5"	5"
12.5' to 15'	5"	5"	5"	5"	5"	5"
15' to 17.5'	5"	5"	5"	5"	5"	5"
17.5' to 20'	5"	5"	5"	5"	5"	5"
20' to 25'	5"	5"	5"	5"	5"	5"
25' to 43'	5"	5"	5"	5"	5"	5"

S = Single Pipe, Nom. Dia.
D = Double Pipe, No Braces, Nom. Dia.
h = Height of Sign & above ground

GENERAL NOTES





- Sizes of signs, posts and braces are shown on Sign Summary Sheet.
- For materials specifications, see Special Provisions.
- Footings to be drilled holes, as shown, and filled with Class A or Class AA concrete.
- Sign panels to be aluminum sheet construction.
- Tubular stiffeners required only when 2W exceeds 2'-0" on alum. sheet construction.
- Sign island required only when h exceeds 15'-0". Island to be compacted to 95%. (See T-31.1.4)
- For double sign, double support with braces, area for tables is total area of two signs. 'h' is not considered part of H.
- 2" bars may be eliminated on any regulatory or warning signs requiring 2 posts. When these signs require 2 posts spacing to be 2'9" to 4'.
- See T-31.1.4 for sign placement.
- See T-31.1.5 for anchor bolt details.
- Tubular stiffeners to be added when "W" exceeds 10'-0".
- For Alternate Double Support With Braces see Sheet T-31.1.5
- Refer to the Standard Highway Sign Manual for drill hole placements.

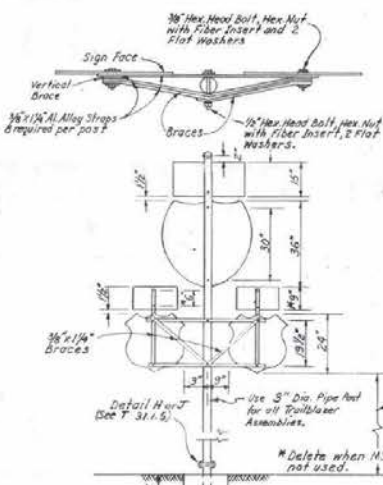


SEE MOUNTING HEIGHT TABLE ON SHEET T-31.1.4 (SINGLE GUIDE SIGN COLUMN)

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS
GROUND MOUNTED
SIGN SUPPORTS
(ROUND METAL POSTS)


T-31.1.1 (627)
ADOPTED: 4/59 REVISION: 9-1/76
CHIEF TRAFFIC ENGINEER

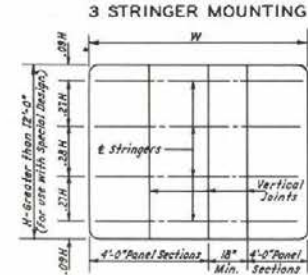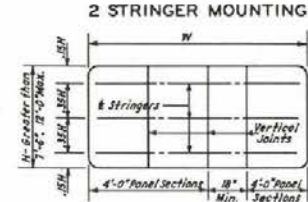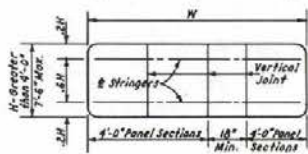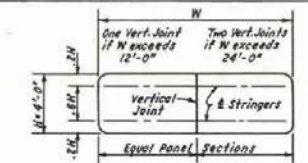


PANEL JOINT CLOSURE STRIP
ALUMINUM SHEET CONSTRUCTION

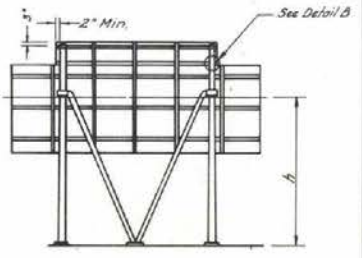


EXIT PANEL ATTACHMENT





CLAMP PLATE

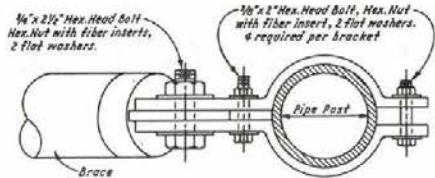

CLAMP ASSEMBLY
DETAIL A
(After sign is set in final position, spot-weld clamp plate to vertical pipe post.)

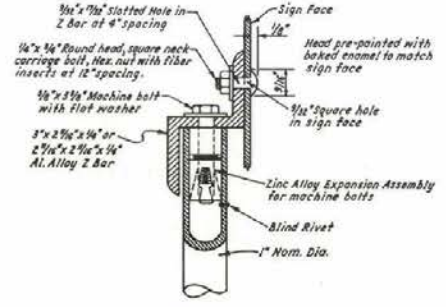

DETAIL C

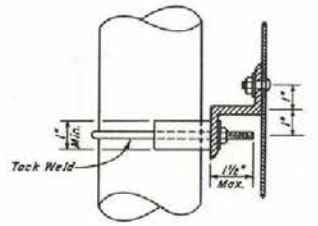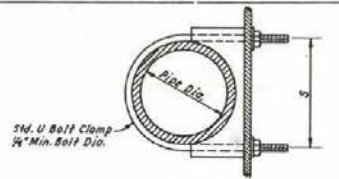

DETAIL B

POST NOM. DIA.	PR	PD	S
2"	1 1/2"	2 3/8"	2 1/8"
3"	1 3/4"	3 1/8"	3 1/4"

- GENERAL NOTES**
- 1- For materials not directly specified, See Special Provisions.
 - 2- Flat washers required on all bolts, 1 or 2 as necessary.
 - 3- All nuts to have fiber inserts.
 - 4- To obtain desired panel width, Max. of 2 panels may be cut less than 4'-0" (18" Min. each).


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**GROUND MOUNTED
SIGN SUPPORTS
(ROUND METAL POSTS)**


T-31.1.2 - (627)

ADOPTED: 8/69 REVISION 4-1/76


Charles J. Hill
CHIEF TRAFFIC ENGR.

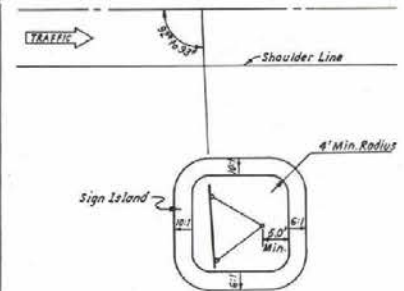


PLAN

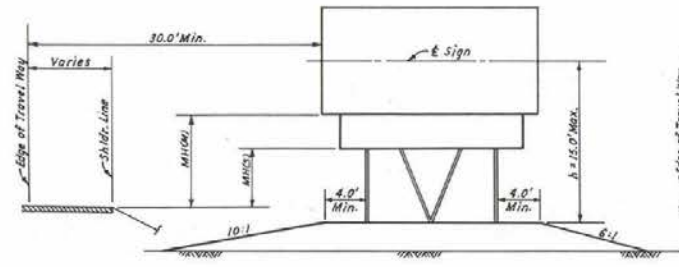

LEVEL

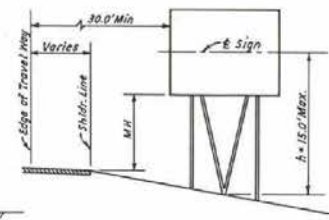


BRACED

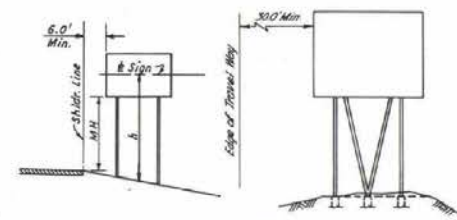


UNBRACED
EMBANKMENT
(WITHOUT SIGN ISLAND)


When the sign location is in original ground, the area between the supports and the braces shall be leveled to maintain identical post lengths. (No Direct Payment for The Leveling)

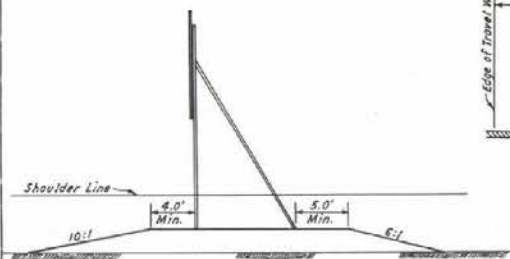

ELEVATION


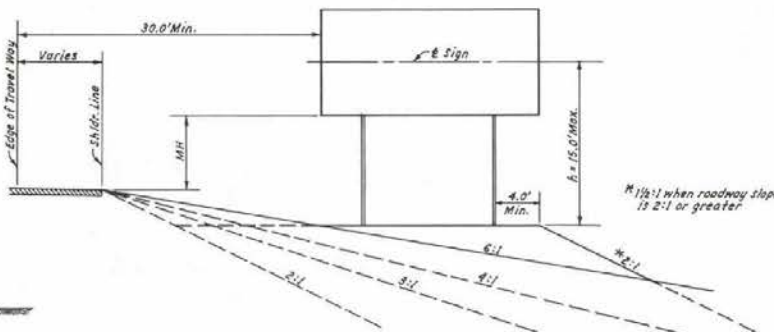


EMBANKMENT

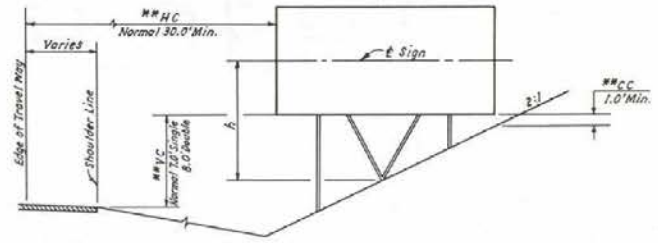


EXCAVATION

**NOTE: If CC is less than 1.0' Minimum
(1) Raise sign until CC=1.0' or VC=10.0' Max for single sign, VC=11.0' Max for double sign, or h=15.0' Max.
(2) Maintain VC=10.0' or 11.0' and move sign toward shoulder until CC=1.0', HC=16.0' Min., or h=15.0' Max.
(3) Special consideration is necessary if given limits are exceeded.

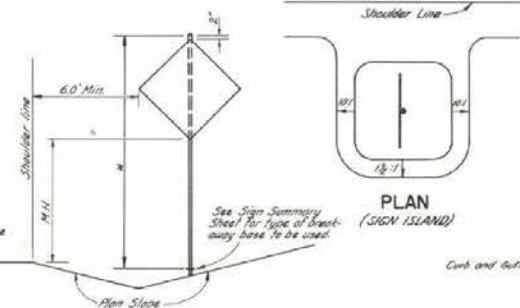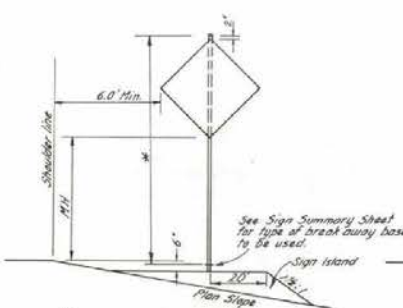

PLAN
(SIGN ISLAND)

TYPICAL SINGLE SIGN SUPPORT

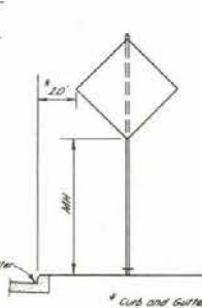

* Curb and Gutter Section 1.0' Max. When Sign is Placed in Groove With or Without Curb and Gutter.

MOUNTING HEIGHTS (MH) FOR SIGNS

	SINGLE GUIDE SIGNS	ALL OTHER SINGLE SIGNS	DOUBLE GUIDE SIGNS	ALL OTHER DOUBLE SIGNS
FREWAYS & EXPRESSWAYS	7' MIN	7' MIN	8' MIN (H) 5' MIN (S)	5' MIN (S)
COMMERCIAL RESIDENTIAL & CURB & CUTTER	7' MIN	7' MIN	7' MIN (S)	7' MIN (S)
RURAL	5' MIN	5' MIN	5' MIN (S)	5' MIN (S)

(H) = MAJOR SIGN (S) = SECONDARY SIGN
NOTE: FOR MOUNTING HEIGHTS (MH) FOR CONSTRUCTION SIGNS AND TEMPORARY SIGNS, (SEE SHEET T-31.1.6).

GENERAL NOTES


1. Sign island required only when h exceeds 15.0'. Island to be compacted to 95%.
2. Posting and sign details shown on sheets T-31.1.1, T-31.1.2, T-31.1.3.
3. 30.0' min. distance from edge of travel way to edge of sign panel may be reduced to 15.0' min. in special situations.
4. All sign supports shall be of break away design.
5. Signs should not be closer than 8 ft. from the edge of the shoulder, or 11 ft. from the edge of the traveled way. In urban areas a lesser clearance may be used where necessary.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


GROUND MOUNTED
SIGN SUPPORTS
(ROUND METAL POSTS)

Russell Hill
CHIEF TRAFFIC ENGR.

T-31.1.4 - (627)
ADOPTED: 8/69 REVISION 10/78

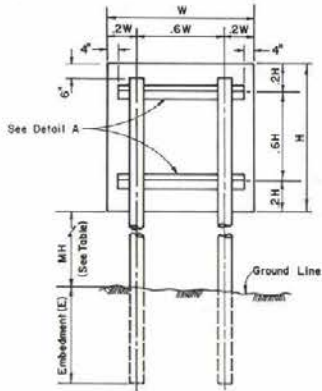

RECTANGULAR TIMBER POST SELECTION

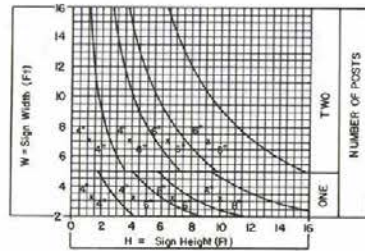


SIGN POST EMBEDMENTS

4" x 4" = 3'-0"	4" x 6" = 4'-0"
6" x 6" = 5'-0"	6" x 8" = 6'-0"

MOUNTING HEIGHTS (MH) FOR SIGNS


	SINGLE SIGN	DOUBLE SIGN	SIDEWALK OR PEDESTRIAN AREAS
CONVENTIONAL REGISTRATION	7' MIN.	7' MIN.	
CONVENTIONAL INFORMATION			
RURAL	5' MIN.	3' MIN.	

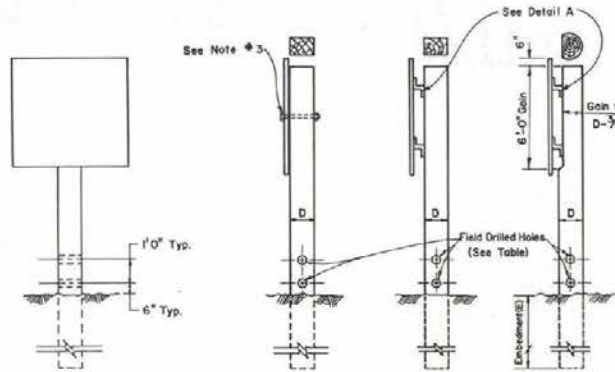



TIMBER POST SIGN SUPPORT

TABLE OF BOLT DIMENSIONS

POST SIZE	LESS THAN 6" x 6"	6" x 6" OR 8" x 8"
WOLE DIA.	3/4"	1"
NO. HOLES	2	4

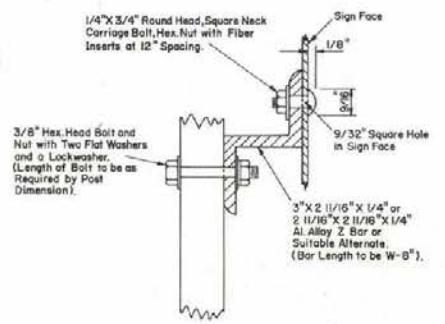


DETAIL A




SIGN ISLAND

POST LENGTH AS SHOWN ON SIGN SCHEDULE SHEET. POST LENGTH CALCULATIONS ARE BASED ON USE OF SIGN ISLAND. SIGN ISLAND SHALL BE USED EXCEPT WHEN SIGN POST IS LOCATED IN BACKSLOPE. SIGN ISLANDS TO BE USED FOR ALL TEMPORARY SIGNS AND CONSTRUCTION SIGNS G-20-1, G-20-2, AND INFORMATIONAL SIGNS G-23, G-26 and G-27.


RURAL AND URBAN
ERECTOR: RIGHT-HAND SIDE OF ROADWAY, FACING AND AT RIGHT ANGLES TO DIRECTION OF TRAFFIC.

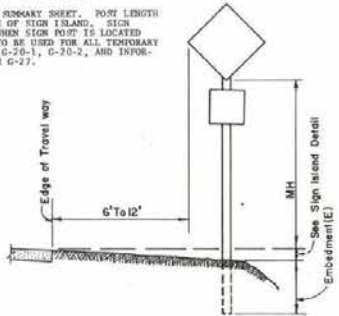


RURAL AREA

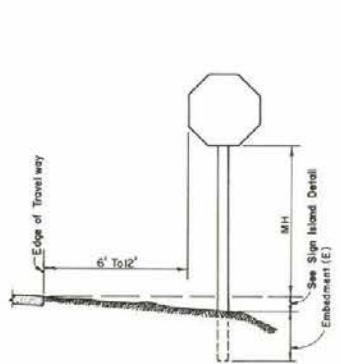

URBAN AREA

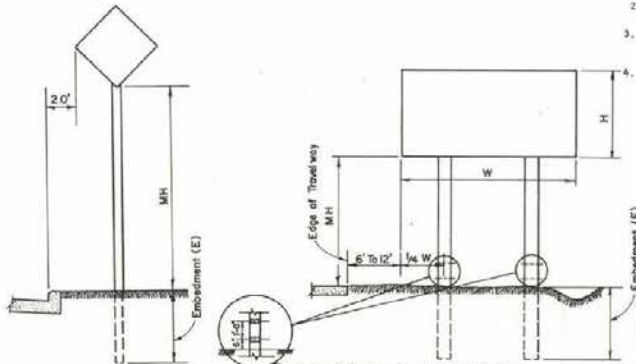

TYPICAL SIGN ERECTION

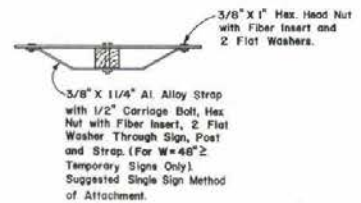

- GENERAL NOTES**
- ALL BOLTS, NUTS AND WASHERS TO BE GALVANIZED.
 - ALL POSTS WITH CROSS SECTIONAL AREA LARGER THAN 24 SQUARE INCHES ARE TO BE DRILLED AS SHOWN.
 - 2" BARS ARE NOT REQUIRED ON REGULATORY OR WARNING SIGNS. WHEN TWO POSTS ARE REQUIRED ON THESE SIGNS, SPACING TO BE 2'-8" CENTERLINE TO CENTERLINE.
- TRIPOD MOUNTING TO BE USED ON CONSTRUCTION SIGN ONLY.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**GROUND MOUNTED
SIGN SUPPORTS
(TIMBER POSTS)**


Ronald C. Hill
CHIEF TRAFFIC ENGR.

T-31.1.6 (625)
ADOPTED 8/73 REVISION 2-78


*POST LENGTH AS SHOWN ON SIGN SUMMARY SHEET.
 POST LENGTH CALCULATIONS ARE BASED ON USE OF
 SIGN ISLAND. SIGN ISLAND SHALL BE USED EXCEPT
 WHEN SIGNPOST IS LOCATED IN BACKSLOPE.

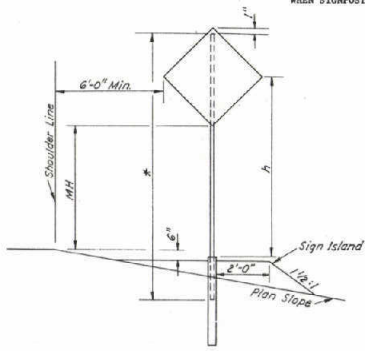



ELEVATION

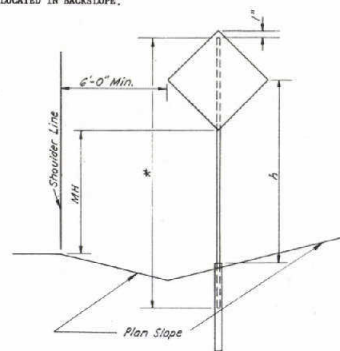

SIGN ON BACKSLOPE

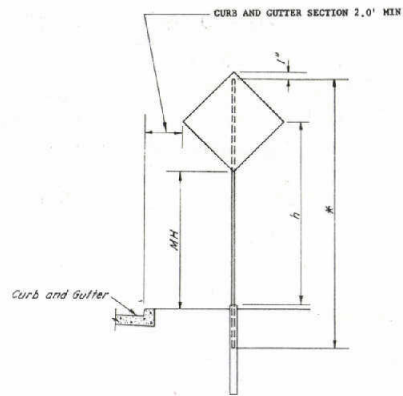


SIGN ON GORE

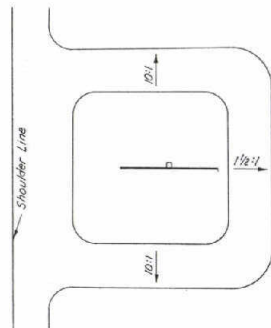
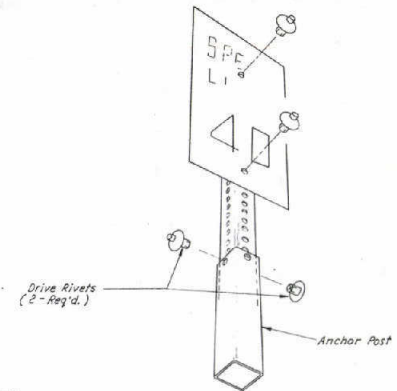


PLAN

SIGN ON SIGN ISLAND

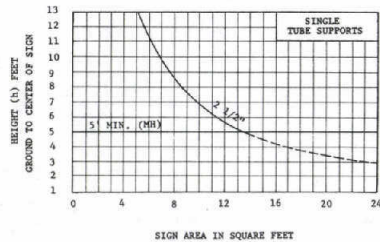

	MOUNTING HEIGHTS (MH) FOR SIGNS		
	SINGLE SIGN	DOUBLE SIGN	
COMMERCIAL			SIDEWALK OR PEDESTRIAN AREAS
RESIDENTIAL	7' MIN.	7' MIN.	
CURB&GUTTER			
RURAL	5' MIN.	5' MIN.	

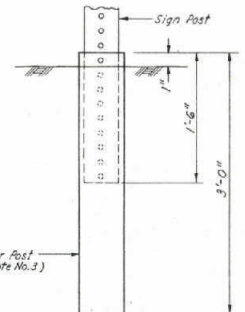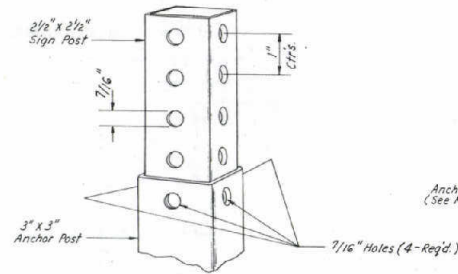

GENERAL NOTES

- SIGN ISLAND TO BE COMPACTED TO 95%.
- SIGNS SHOULD NOT BE CLOSER THAN 6 FT. FROM THE EDGE OF THE SHOULDER, OR IF NONE, 12 FT. FROM THE EDGE OF THE TRAVELED WAY. IN URBAN AREAS A LESSER CLEARANCE MAY BE USED WHERE NECESSARY.
- ANCHOR POST TO BE INCLUDED IN COST OF POST LENGTH AS SHOWN ON THE SIGN SUMMARY SHEET.

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

GROUND MOUNTED
 SIGN SUPPORTS
 (SQUARE METAL POSTS)

Lucas C. Hill
 CHIEF TRAFFIC ENG.

T-31.1.7 (625)
 ADOPTED: 1/76 REVISION

GENERAL NOTES:

- ALL WARNING SIGNS ("W" SERIES) SHALL BE BLACK ON REFLECTIVE ORANGE.
- SPEED LIMITS FOR CURVES SHALL BE DETERMINED BY THE PERCENT OF A RAIL BANK INDICATOR OR OTHER APPROVED METHOD. (SEE TABLE)
- TRAFFIC CONES SHALL BE PLACED IN ACCORDANCE WITH THE TABLE FOR SPACING OF TRAFFIC CONES AND TRAFFIC DELINEATORS AND SHALL BE NO CLOSER THAN 2'-0" NOR MORE THAN 4'-0" OUTSIDE THE SOLID WHITE LINE OR THE DOUBLE YELLOW LINES. TRAFFIC CONES SHALL BE ORANGE IN COLOR AND SHALL BE REFLECTORIZED WITH 3" WHITE PRISMATIC REFLECTORS WHEN USED WITH WHITE LINE AND 3" YELLOW PRISMATIC REFLECTORS WHEN USED WITH THE YELLOW LINE DURING NIGHTTIME HOURS.
- WHENEVER A TWO LANE ROADWAY PARALLELS A FOUR LANE ROADWAY OR WHENEVER A TWO LANE ROAD MAY BE CONSIDERED WITH A FOUR LANE ROADWAY, USE WARNING SIGN W-1-1 AT ONE MILE INTERVALS.
- TEMPORARY PAVEMENT STRIPING TAPE SHALL BE USED WHERE SURFACES ARE TO REMAIN AS FINAL SURFACE OR WHERE THE STRIPING PATTERN IS TO BE CHANGED OR AS OTHERWISE NOTED.
- "END CONSTRUCTION" (S20-2) SHALL BE USED WHERE APPLICABLE.

TABLE FOR SPACING TRAFFIC CONES & TRAFFIC DELINEATORS

DEGREE OF CURVE	RADIUS	SPEED	SPACING	DEGREE OF CURVE	RADIUS	SPEED	SPACING
2	10,000	80	100	9	600	45	30
	2,500	75	80		500	40	45
3	2,000	70	75	15	350	35	40
	1,800	65	70	21	250	30	30
4	1,400	60	65	25	200	25	20
	1,200	55	60	30	100	20	10
5	1,000	50	55				
7	800	50	55				

1. Spacing may be closer where conditions warrant.
2. When used on inside of curves, double the spacing.

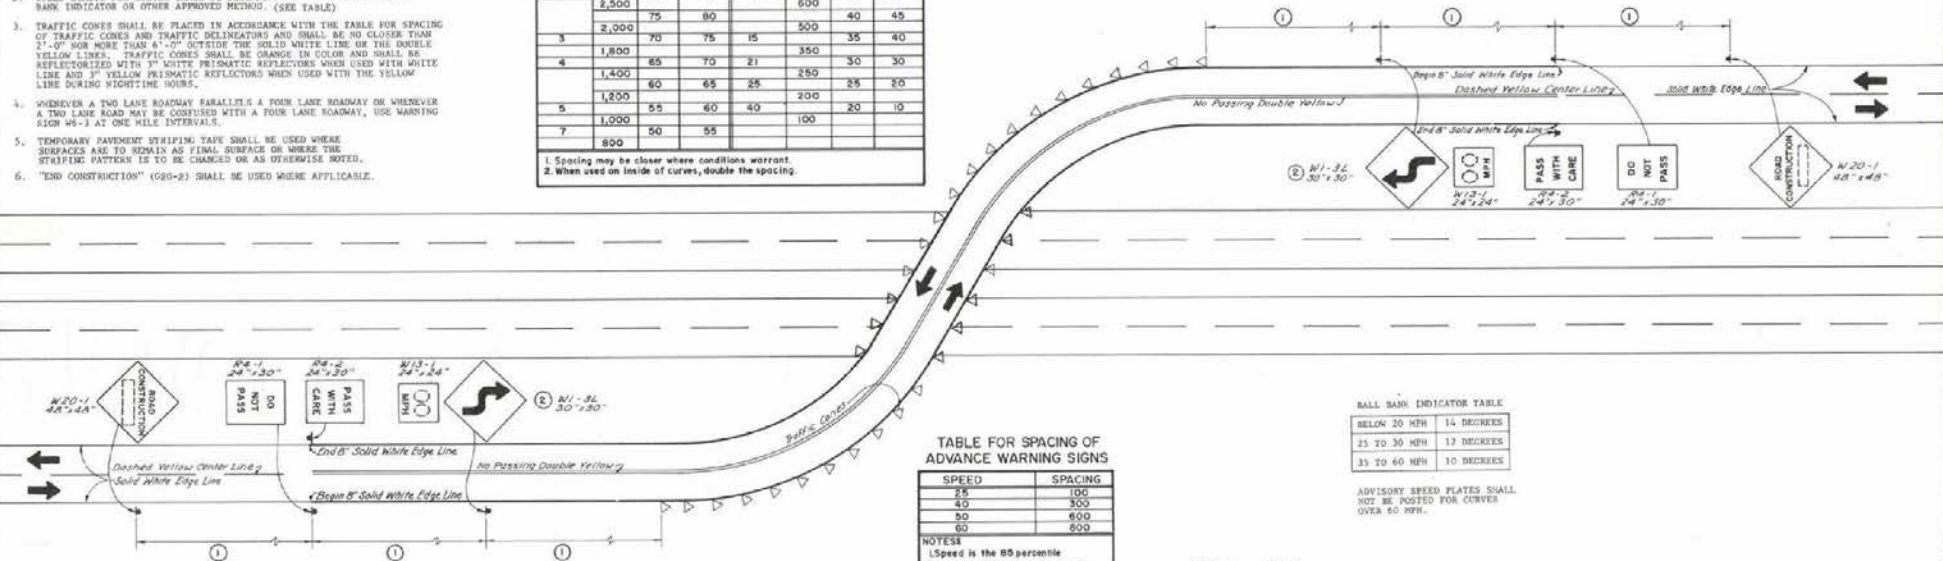


TABLE FOR SPACING OF ADVANCE WARNING SIGNS

SPEED	SPACING
25	100
40	300
50	600
60	900


NOTES:
1. Speed is the 85 percentile.
2. Spacing is minimum and may be adjusted to meet existing conditions.

RAIL BANK INDICATOR TABLE

BELOW 30 MPH	14 DEGREES
35 TO 30 MPH	12 DEGREES
35 TO 60 MPH	10 DEGREES

ADVISORY SPEED PLATES SHALL NOT BE POSTED FOR CURVES OVER 50 MPH.

- See Table for Spacing of Advance Warning Signs.
- W-1-1/W-1-2 Be Used Where Speeds are From 30 to 60 M.P.H.

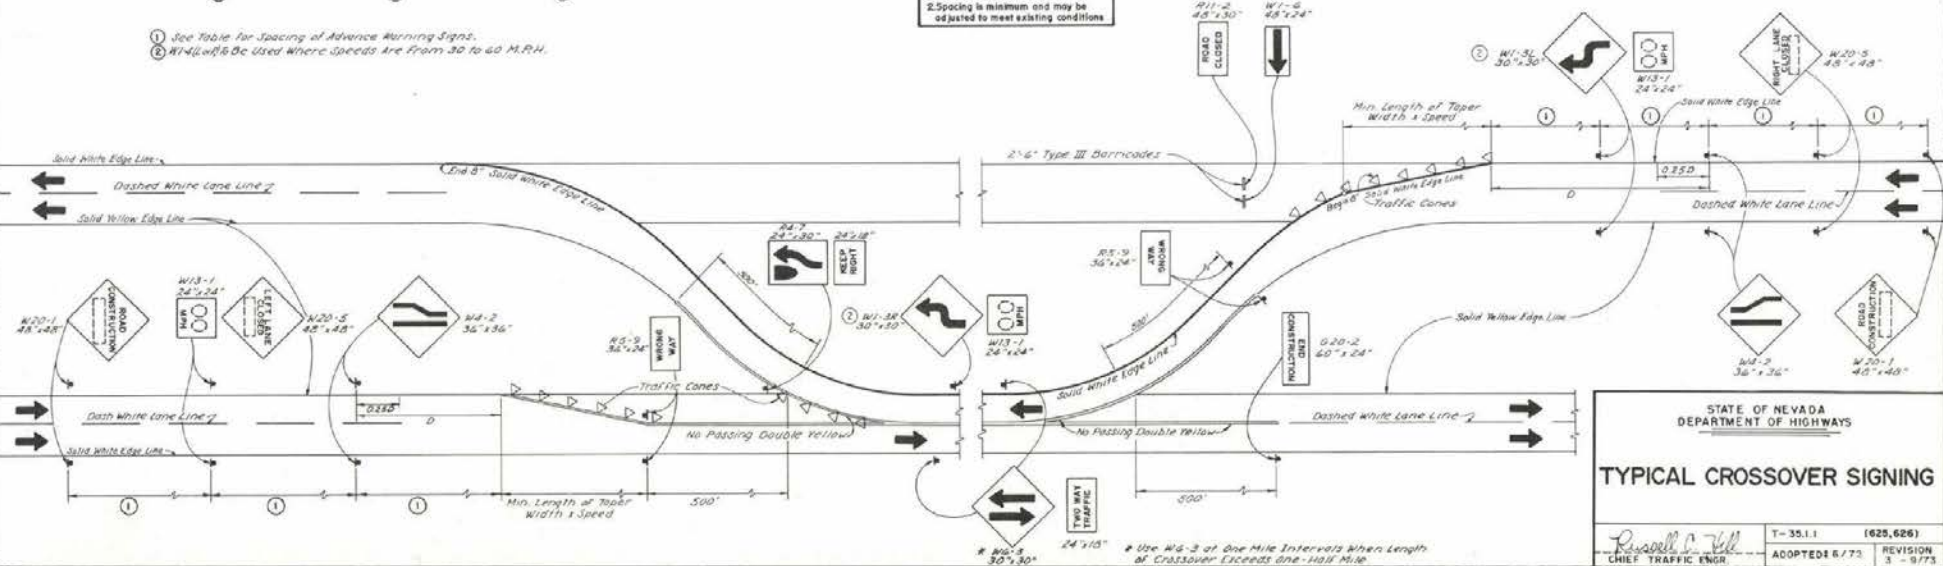

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

TYPICAL CROSSOVER SIGNING

Russell C. Vell
CHIEF TRAFFIC ENGR

T-35.1.1 (625,626)
ADOPTED 6/73 REVISION 3-9/73

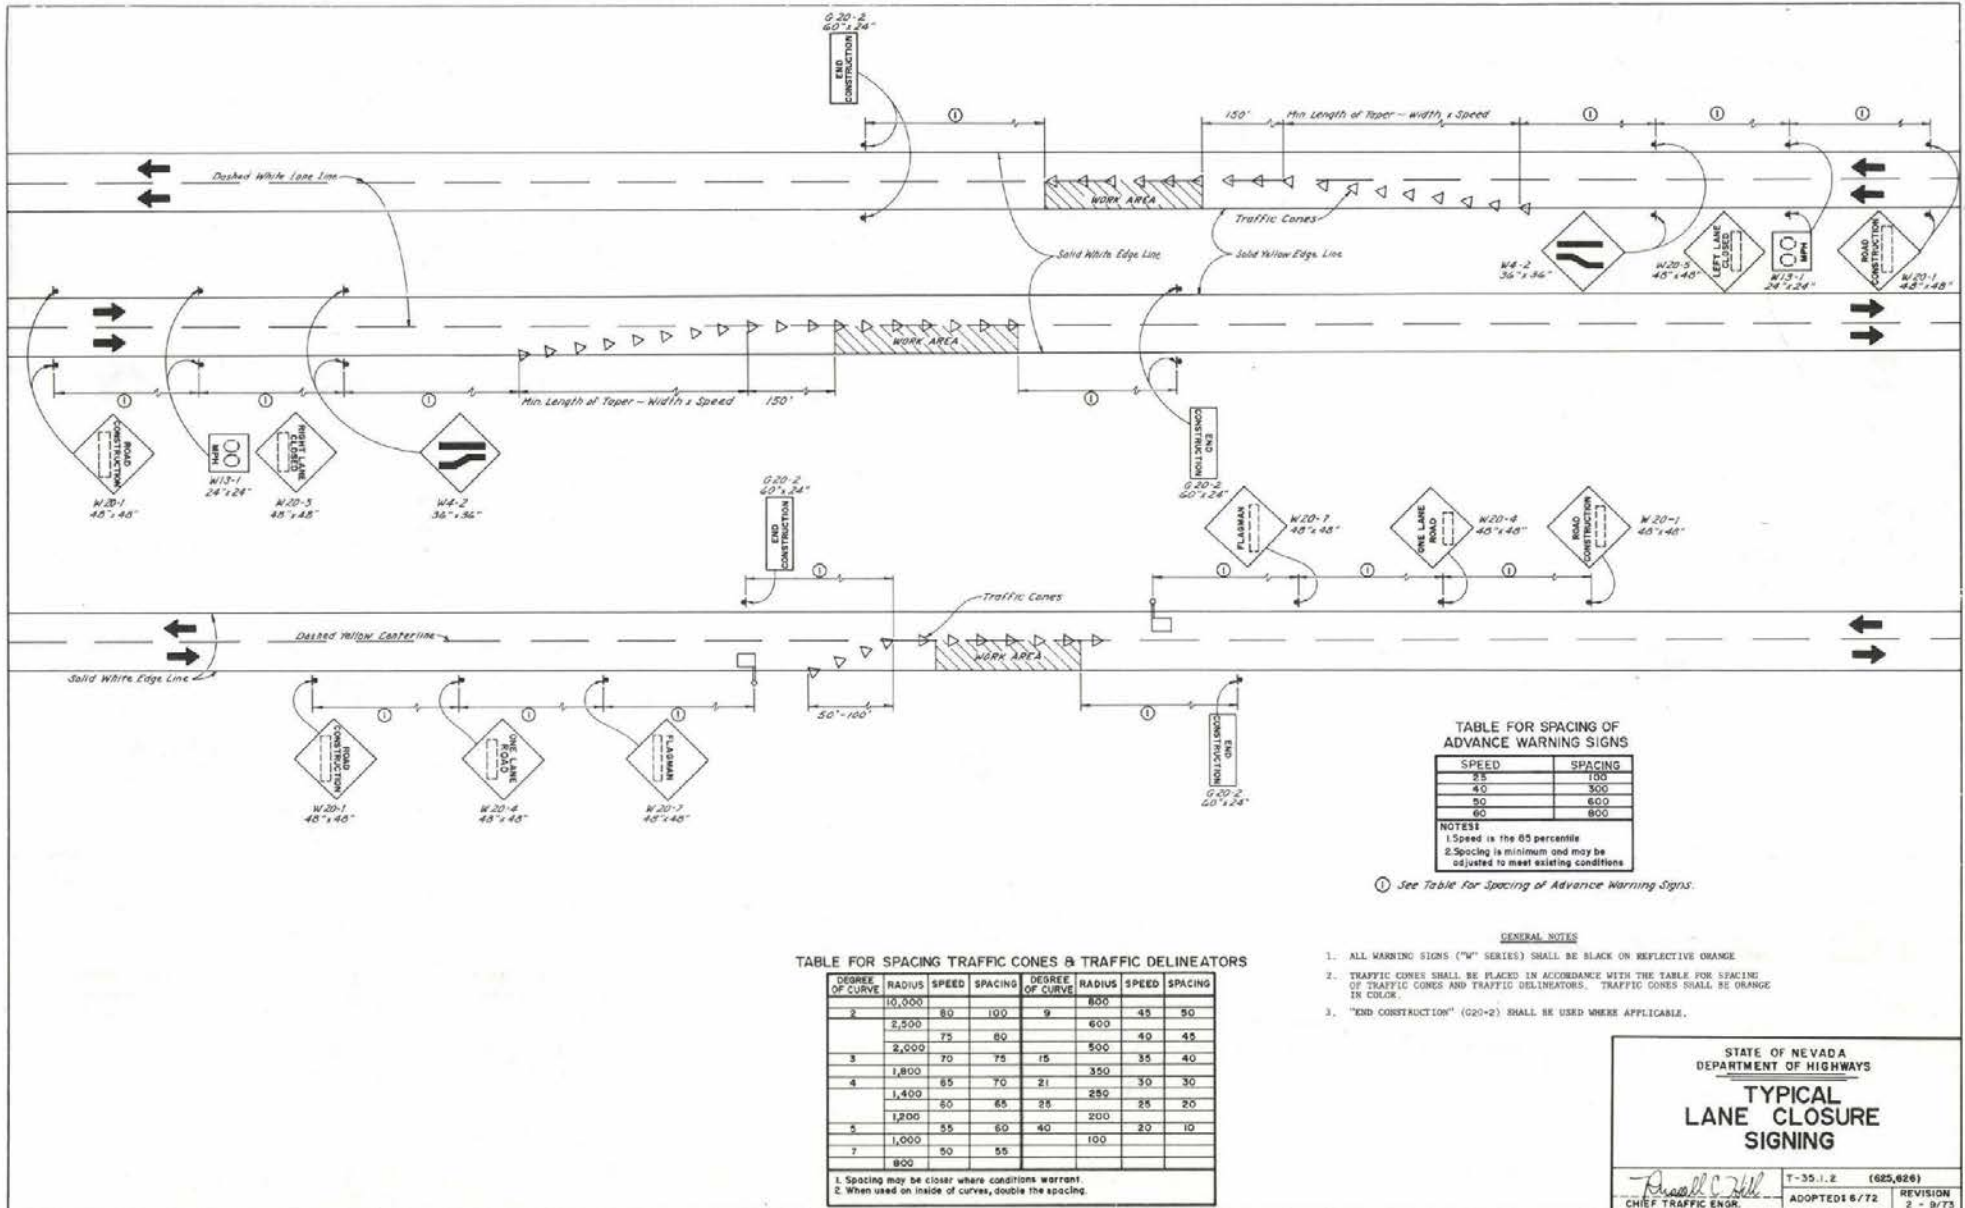


TABLE FOR SPACING OF ADVANCE WARNING SIGNS

SPEED	SPACING
25	100
40	300
50	600
60	800

NOTES:
 1. Speed is the 85 percentile
 2. Spacing is minimum and may be adjusted to meet existing conditions

① See Table for Spacing of Advance Warning Signs.

TABLE FOR SPACING TRAFFIC CONES & TRAFFIC DELINEATORS

DEGREE OF CURVE	RADIUS	SPEED	SPACING	DEGREE OF CURVE	RADIUS	SPEED	SPACING
2	10,000	80	100	9	800	45	50
		75	80			40	45
3	2,500	70	75	15	500	35	40
		65	70			30	30
4	1,800	60	65	25	250	25	20
		55	60			20	10
7	1,000	50	55	100	100		

1. Spacing may be closer where conditions warrant.
 2. When used on inside of curves, double the spacing.

GENERAL NOTES


1. ALL WARNING SIGNS ("W" SERIES) SHALL BE BLACK ON REFLECTIVE ORANGE.
2. TRAFFIC CONES SHALL BE PLACED IN ACCORDANCE WITH THE TABLE FOR SPACING OF TRAFFIC CONES AND TRAFFIC DELINEATORS. TRAFFIC CONES SHALL BE ORANGE IN COLOR.
3. "END CONSTRUCTION" (G20-2) SHALL BE USED WHERE APPLICABLE.

STATE OF NEVADA
 DEPARTMENT OF HIGHWAYS

**TYPICAL
 LANE CLOSURE
 SIGNING**


 CHIEF TRAFFIC ENGR.

T-35.1.2 (625,626)
 ADOPTED 6/72 REVISION
 2 - 9/73

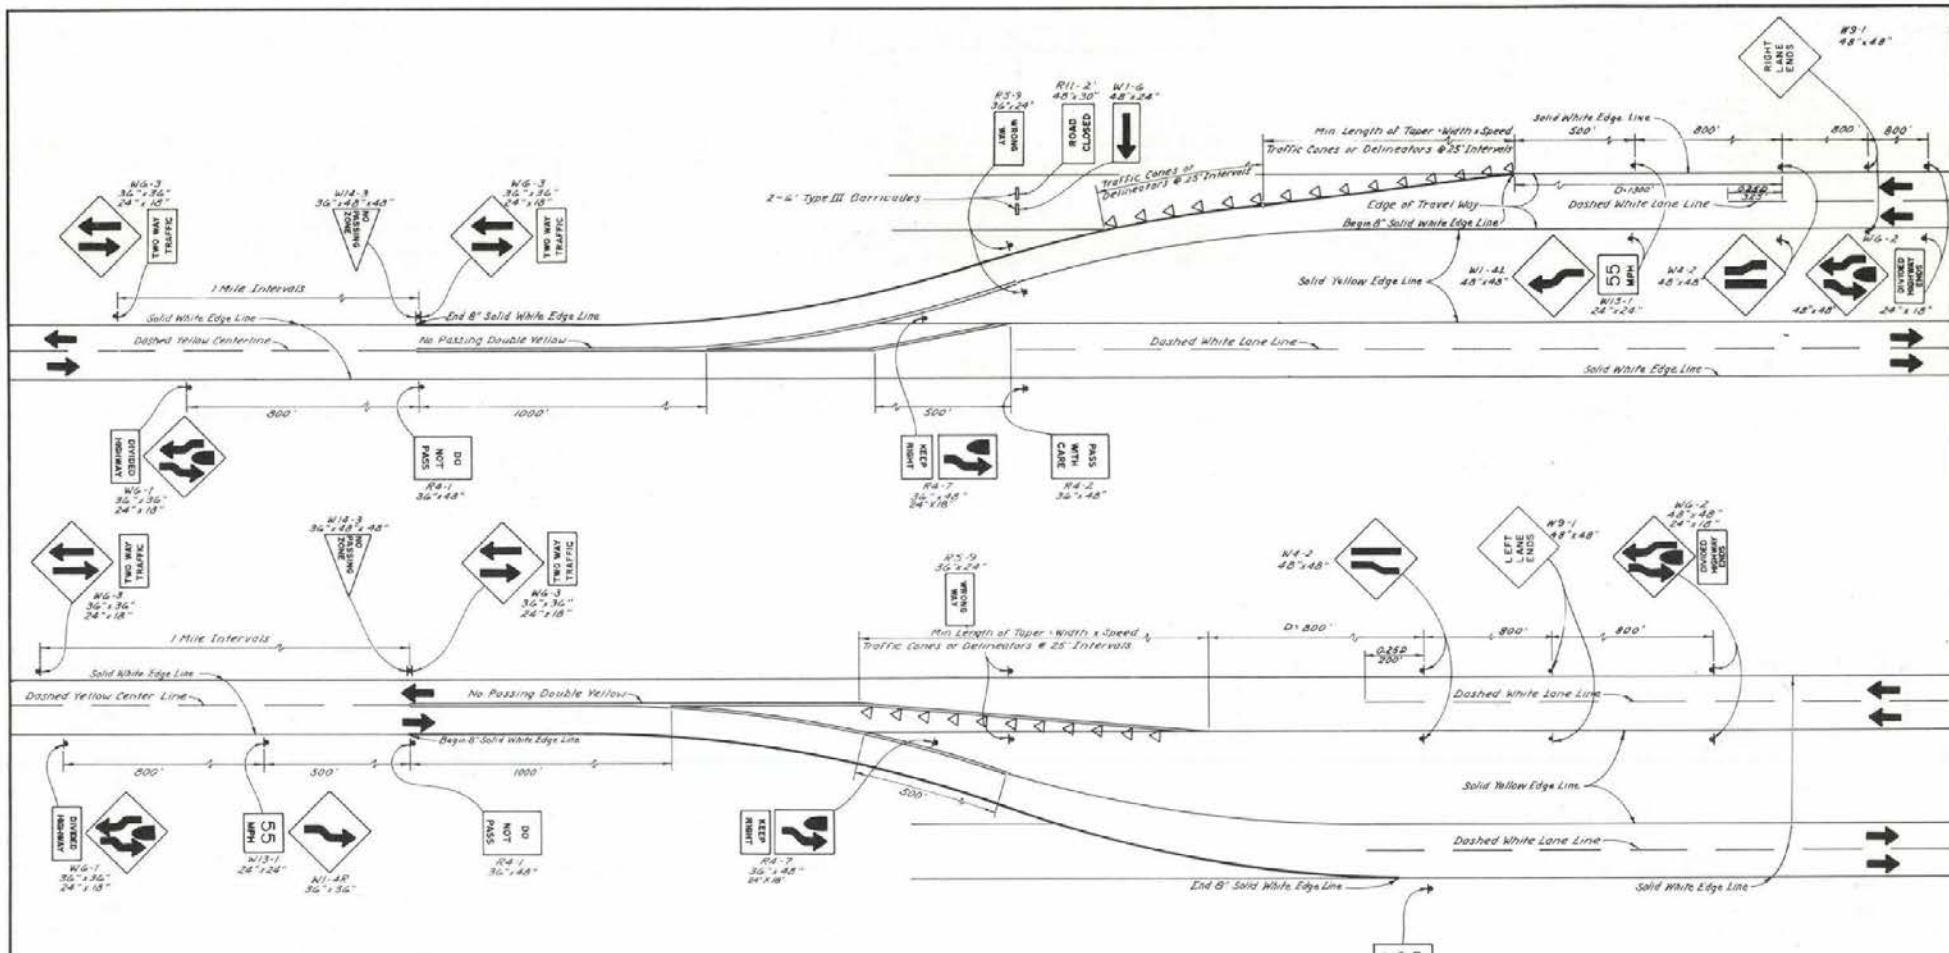

GENERAL NOTES:

1. ALL WARNING SIGNS ("W" SERIES) SHALL BE BLACK ON REFLECTIVE YELLOW FOR SEMI-PERMANENT INSTALLATIONS AND SHALL BE BLACK ON REFLECTIVE ORANGE FOR TEMPORARY INSTALLATIONS. (CONSTRUCTION AND MAINTENANCE).
2. TRAFFIC DELINEATORS ON METAL POSTS SHALL BE USED TO OUTLINE LANE DROP TAPERS FOR SEMI-PERMANENT INSTALLATIONS AND TRAFFIC CONES FOR TEMPORARY INSTALLATIONS. THEY SHALL BE NO CLOSER THAN 2'-0" NOR MORE THAN 4'-0" OUTSIDE THE SOLID WHITE LINE OR DOUBLE YELLOW LINES. TRAFFIC DELINEATORS SHALL CONSIST OF A 3" PRISMATIC YELLOW OR WHITE REFLECTOR AND SHALL BE USED WITH THEIR RESPECTIVE LINES DURING NIGHTTIME HOURS. TRAFFIC CONES SHALL BE ORANGE IN COLOR AND ALSO EQUIPPED WITH REFLECTORS AND USED IN THE SAME MANNER AS THE TRAFFIC DELINEATORS.
3. SPEED LIMITS THROUGH TRANSITION CURVES SHALL BE 55 MPH UNLESS DETERMINED TO BE LESS BY THE USE OF A BALL BANK INDICATOR OR OTHER APPROVED METHOD. (SEE TABLE).
4. CURVE SIGNS W1-3 (FOR R) SHALL BE USED WHEN SPEEDS ARE FROM 0-30 MPH AND SIGN W1-4 (FOR R) WHEN SPEEDS ARE FROM 30-60 MPH.
5. CURVE SIGN W1-3 (FOR L) SHALL BE USED WHEN SPEEDS ARE FROM 0-30 MPH AND SIGN W1-4 (FOR L) WHEN SPEEDS ARE FROM 30-60 MPH.
6. "END CONSTRUCTION" (G00-2) SHALL BE USED WHERE APPLICABLE.

BALL BANK INDICATOR TABLE

BELOW 20 MPH	16 DEGREES
25 TO 30 MPH	12 DEGREES
35 TO 40 MPH	10 DEGREES


ADVISORY SPEED PLATES SHALL NOT BE POSTED FOR CURVES OVER 60 MPH.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**TYPICAL 2 LANE
TO 4 LANE CONNECTION
SIGNING (RURAL)**


T-35.1.3 (625,626)
ADOPTED 1/6/72 REVISION 5-9/73



CHIEF TRAFFIC ENGR

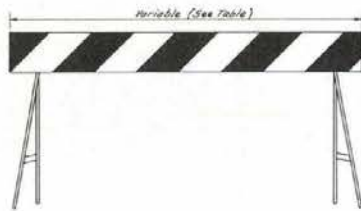

TYPE I BARRICADE

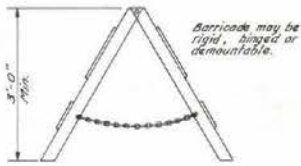

TYPE II BARRICADE
(FRAMEWORK TO BE PAINTED WHITE)




TRAFFIC CONES

Weights as necessary to maintain position

- CONES TO BE PREDOMINATELY ORANGE.
- CONES TO BE USED DURING HOURS OF DARKNESS SHALL HAVE 6" REFLECTIVE BAND.
- CONES SHALL HAVE WEIGHTED BASES. HOWEVER, IF THE CONTRACTOR WISHES IN LIEU OF WEIGHTED BASES, HE MAY EPOXY OR NAIL THE CONES IN PLACE.

GENERAL NOTES

- SUITABLE ALTERNATES WHICH MAINTAIN THE BASIC DESIGN CONCEPT WILL BE ACCEPTABLE WHEN APPROVED BY THE ENGINEER.


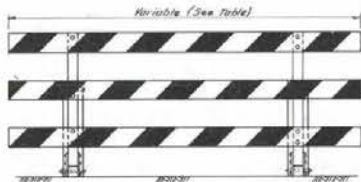


TYPE III BARRICADE


TABLE--BARRICADES--CHARACTERISTICS

	TYPE		
	I	II	III
WIDTH OF RAIL	8" MIN--12" MAX	8" MIN--12" MAX	8" MIN--12" MAX
LENGTH OF RAIL	2' MIN--MAX VARIES	2' MIN--MAX VARIES	2' MIN--MAX VARIES
WIDTH OF STRIPES	RAIL LENGTH < 3'-4" MIN. LENGTH 3' 4"-6'	RAIL LENGTH < 3'-4" MIN. LENGTH 3' 4"-6'	RAIL LENGTH < 3'-4" MIN. LENGTH 3' 4"-6'
HEIGHT	3 FT MIN	3 FT MIN	3 FT MIN
TYPE OF FRAME	DEMOUNTABLE OR HEAVY "A" FRAME	LIGHT "A" FRAME	POST OR SKIDS
FLEXIBILITY	ESSENTIALLY MOVABLE	PORTABLE	ESSENTIALLY PERMANENT



MARKINGS FOR BARRIER RAILS AND VERTICAL PANELS SHALL BE ALTERNATE REFLECTORIZED ORANGE AND REFLECTORIZED WHITE STRIPES SLOPING DOWNWARD AT AN ANGLE OF 45 DEGREES IN THE DIRECTION OF TRAFFIC.

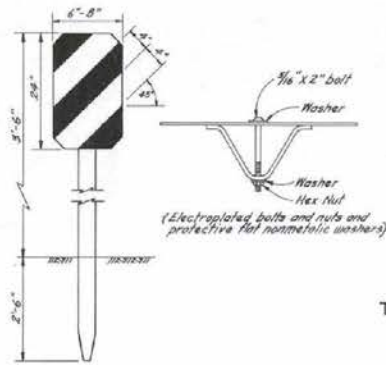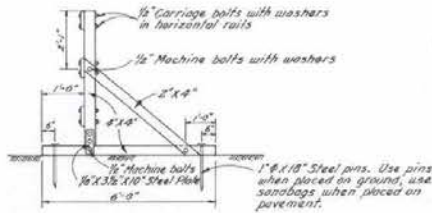

VERTICAL PANEL

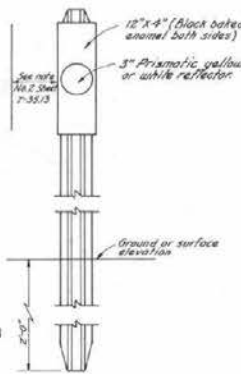

TRAFFIC DELINEATOR

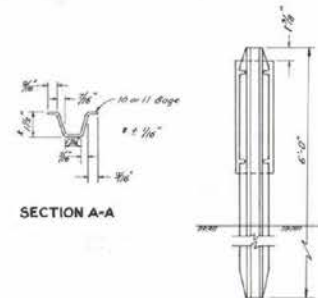


SECTION A-A

POST DETAILS


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

BARRICADES


Russell C. Bell
CHIEF TRAFFIC ENGINEER
T-35.1.5 (REV. 8-26)
ADOPTED 6/72

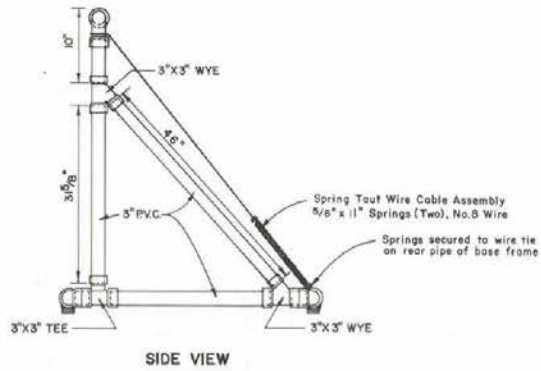


SIDE VIEW

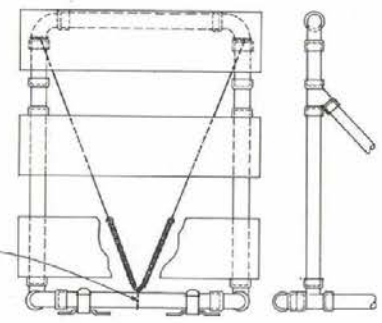


FRONT VIEW

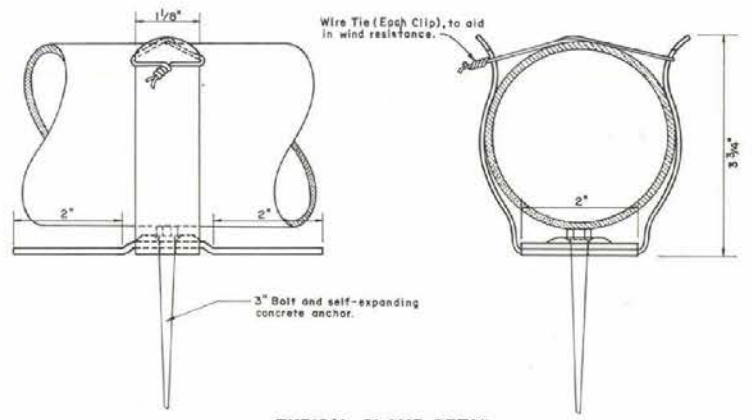

TYPICAL CLAMP DETAIL
(Single Fire Extinguisher Clips, 3 1/2" Dia.)

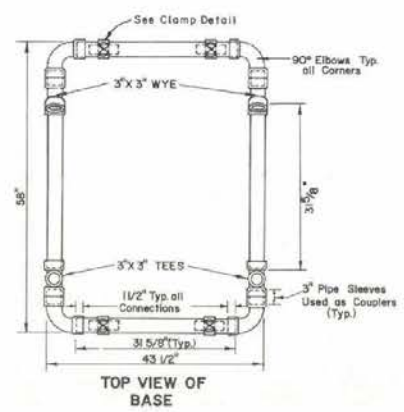

TOP VIEW OF BASE

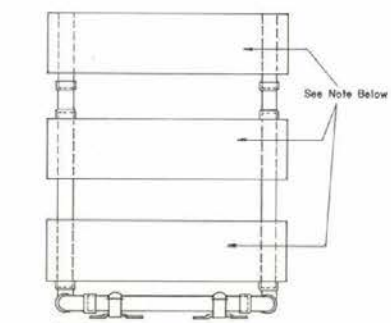

Note: 9' X 48" Barricade Hazard Panels Orange and Black Right or Left (1.025 Anodized Aluminum)
Panels Attached with 1" No. 14 Pan Head Metal Screw.

Type III B Barricade

STATE OF NEVADA DEPARTMENT OF HIGHWAYS		
TEMPORARY BARRICADE (SPECIAL)		
<i>R. W. Hill</i> CHIEF TRAFFIC ENGR.	T-35.16 ADOPTED 1/76	(626) REVISION

INSTRUCTIONS TO FABRICATOR

FORMAT SHEET SHOWS:

- 1 - Sign structure location.
- 2 - Length of structure frame.
- 3 - Panel size and locations on structure.
- 4 - Post type and height to bottom of frame.
- 5 - Base plate elevation.
- 6 - Footing elevation or location of alternate pile foundation.
- 7 - Photoelectric cell location if required.

REFER TO THE FOLLOWING SHEETS FOR DETAILS NOT SHOWN ON FORMAT SHEET:

- T-36.1.1 - Instructions and examples.
- T-36.1.2 - Post type II thru VIII.
- T-36.1.3 - Post type I-s thru VII-s.
- T-36.1.4 - Structural frame members (single post type).
- T-36.1.5 - Structural frame members (two post type).
- T-36.1.6 - Structural frame details.
- T-36.1.7 - Frame juncture details.
- T-36.1.8 - Removable sign panel frames.
- T-36.1.10 - Walkway details no. 1 B no. 2.
- T-36.1.11 - Walkway safety railing details.
- T-36.1.12 - Alternate pile foundations.

WALKWAY BRACKETS: Maintain uniform spacing where possible. Maximum spacing shall not exceed 5'-6".

LIGHTING FIXTURE SUPPORTS: Where distance from walkway bracket to end of sign panel exceeds 1'-4", extend lighting fixture supports to next walkway bracket. See example 2.

WALKWAY AND SAFETY RAILING: Walkway to be continuous for entire length of frame for single post signs and for 2 post signs from the nearest post continuous across all the sign panels. Safety railing to protect entire walkway, but continuous for no more than 11' in one unit.

NOTE: Signs are shown and dimensioned looking in the direction of traffic. Double faced signs are shown and dimensioned looking ahead along stationing.

GENERAL NOTES

SPECIFICATIONS:

DESIGN: A.A.S.H.O. Specifications for the design and construction of structural supports for highway signs, dated 1968.

CONSTRUCTION: Standard Specifications for Road and Bridge Construction, Current Edition and Supplements There to.

LOADING:

WIND LOADING: Normal to face of sign: 30 P.S.F.
Transverse to face of sign: 0.2 of normal force.

WALKWAY LOADING: Dead load + 500 lbs. concentrated live load.

UNIT STRESSES:

STRUCTURAL STEEL: $F_s = 20,000$ P.S.I.


REINFORCED CONCRETE: $F_s = 20,000$ P.S.I.,
 $F_c = 1,200$ P.S.I.

FOOTING SOIL PRESSURE: $1\frac{1}{4}$ tons/sq. ft.


MINIMUM CLEARANCE: Vertical roadway clearance 18'-0"

WELDING: All welding continuous unless otherwise noted on the plans. All welding to be done in accordance with the standard specifications for road and bridge construction.


FINISH: All steel parts to be hot-dipped galvanized after fabrication except as shown on plans or as called for in special provisions.

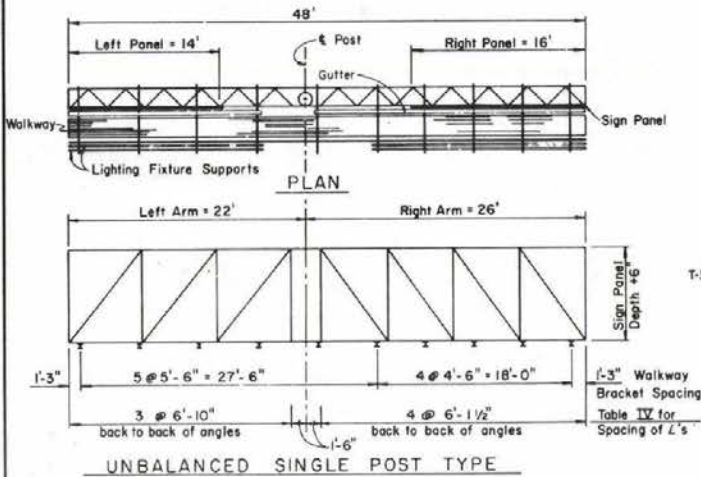

EXAMPLE NO. 1

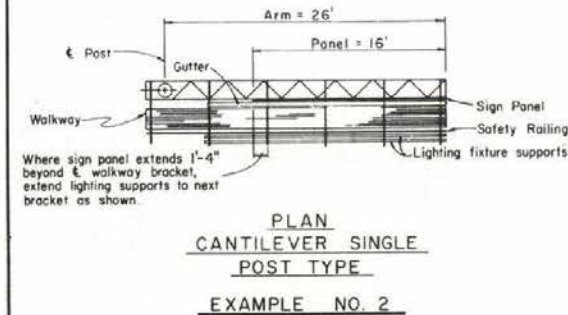

PLAN
CANTILEVER SINGLE
POST TYPE
EXAMPLE NO. 2

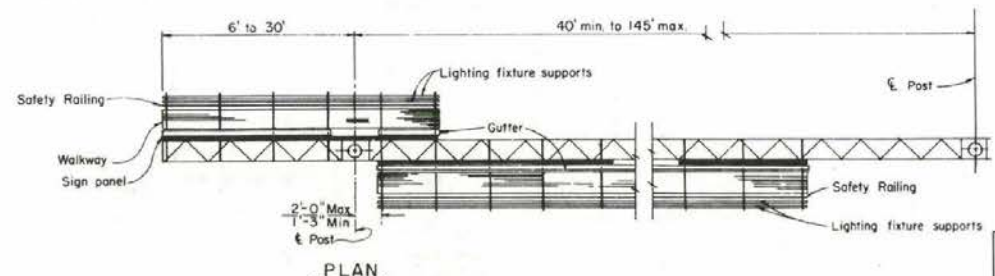

PLAN
TWO POST TYPE WITH CANTILEVER
(PART DOUBLE-FACED)

EXAMPLE NO. 3


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS
INSTRUCTIONS & EXAMPLES**

T-36.1.1-(627)

ADOPTED: 8/66 REVISION: 2-1/74

Russell C. Hill
CHIEF TRAFFIC ENGINEER

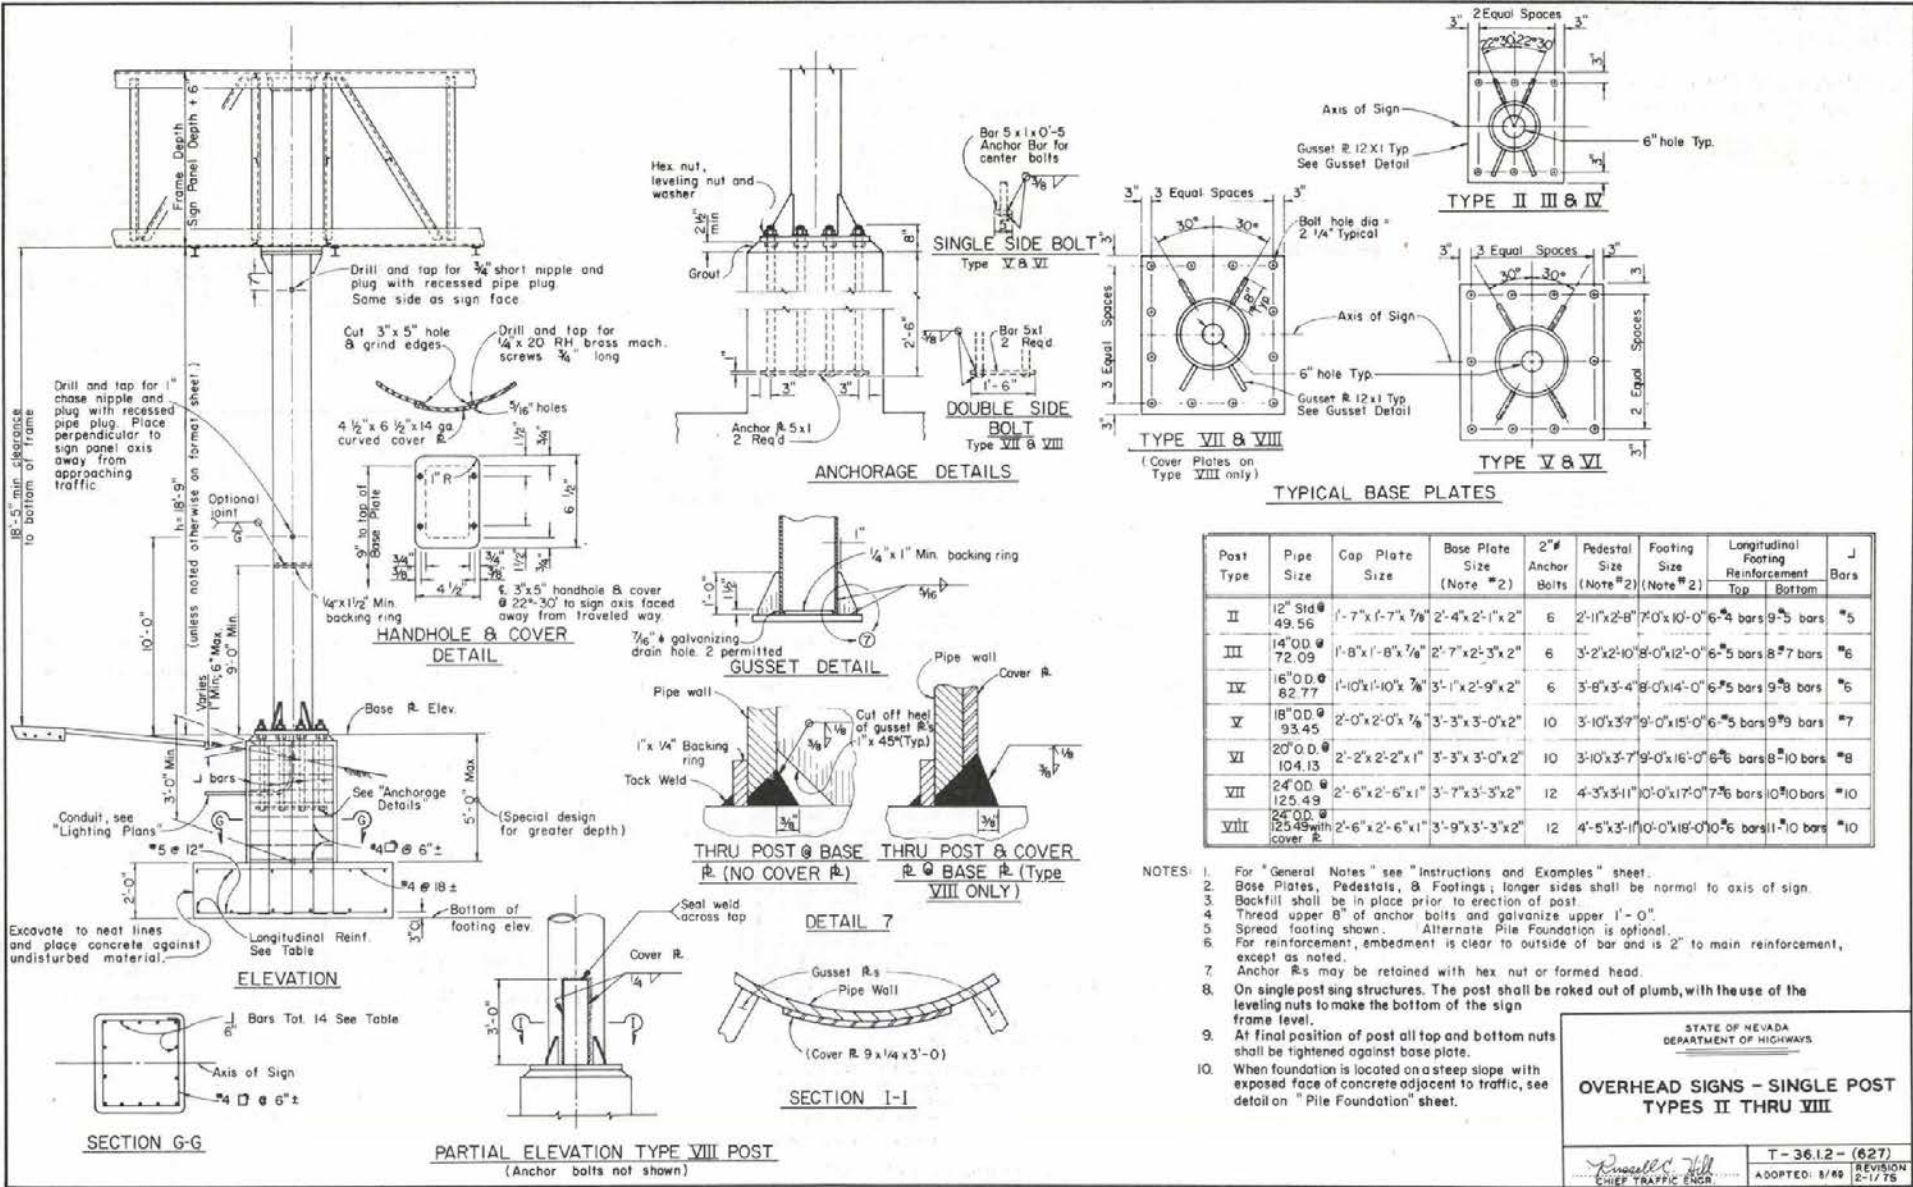

Post Type	Pipe Size	Cap Plate Size	Base Plate Size (Note #2)	2" Anchor Bolts	Pedestal Size (Note #2)	Footing Size (Note #2)	Longitudinal Footing Reinforcement		J Bars
							Top	Bottom	
II	12" Std # 49.56	1'-7" x 1'-7" x 7/8"	2'-4" x 2'-1" x 2"	6	2'-11" x 2'-8"	7'-0" x 10'-0"	6 #4 bars	9 #5 bars	#5
III	14" O.D. # 72.09	1'-8" x 1'-8" x 7/8"	2'-7" x 2'-3" x 2"	6	3'-2" x 2'-10"	8'-0" x 12'-0"	6 #5 bars	8 #7 bars	#6
IV	16" O.D. # 82.77	1'-10" x 1'-10" x 7/8"	3'-1" x 2'-9" x 2"	6	3'-8" x 3'-4"	8'-0" x 14'-0"	6 #5 bars	9 #8 bars	#6
V	18" O.D. # 93.45	2'-0" x 2'-0" x 7/8"	3'-3" x 3'-0" x 2"	10	3'-10" x 3'-7"	9'-0" x 15'-0"	6 #5 bars	9 #9 bars	#7
VI	20" O.D. # 104.13	2'-2" x 2'-2" x 1"	3'-3" x 3'-0" x 2"	10	3'-10" x 3'-7"	9'-0" x 16'-0"	6 #6 bars	8 #10 bars	#8
VII	24" O.D. # 125.49	2'-6" x 2'-6" x 1"	3'-7" x 3'-3" x 2"	12	4'-3" x 3'-11"	10'-0" x 17'-0"	7 #6 bars	10 #10 bars	#10
VIII	24" O.D. # 125.49 with cover R	2'-6" x 2'-6" x 1"	3'-9" x 3'-3" x 2"	12	4'-5" x 3'-11"	10'-0" x 18'-0"	6 bars	10 bars	#10

- NOTES:
- For "General Notes" see "Instructions and Examples" sheet.
 - Base Plates, Pedestals, & Footings; longer sizes shall be normal to axis of sign.
 - Backfill shall be in place prior to erection of post.
 - Thread upper 8" of anchor bolts and galvanize upper 1'-0".
 - Spread footing shown. Alternate Pile Foundation is optional.
 - For reinforcement, embedment is clear to outside of bar and is 2" to main reinforcement, except as noted.
 - Anchor R's may be retained with hex nut or formed head.
 - On single post sign structures. The post shall be raked out of plumb, with the use of the leveling nuts to make the bottom of the sign frame level.
 - At final position of post all top and bottom nuts shall be tightened against base plate.
 - When foundation is located on a steep slope with exposed face of concrete adjacent to traffic, see detail on "Pile Foundation" sheet.


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS - SINGLE POST
TYPES II THRU VIII**


T - 36.1.2 - (627)

ADOPTED: 8/68 REVISION: 2-1/78

Russell C. Hill
CHIEF TRAFFIC ENGR.

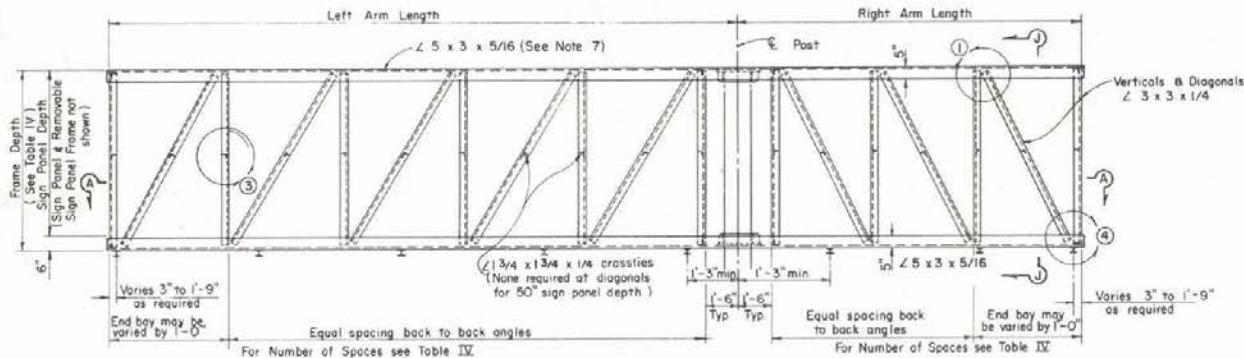

ELEVATION

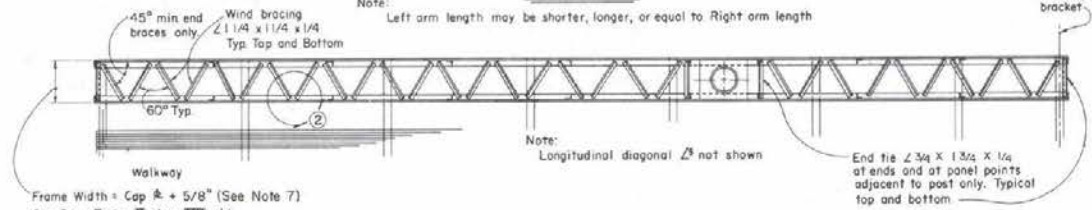


SECTION A-A

Sign Panel Depth	Frame Depth	Maximum Z Spacing	Arm Length
60"	5'-6"	5'-0"	4'
70"	6'-4"	5'-6"	4'
80"	7'-2"	6'-0"	5'
90"	8'-0"	7'-0"	5'
100"	8'-10"	7'-0"	6'
110"	9'-8"	7'-6"	6'
120"	10'-6"	7'-6"	6'


TABLE IX

NOTES:


- For Details ① thru ④ see "Structural Frame Details" sheet.
- For sign panel frames see "Removable Sign Panel Frames" sheet.
- For connection of frame to post see "Frame Junction Details" sheet.
- For walkway see "Standard Walkway Details" 1 and 2 sheets.
- For typical walkway arrangement, special instructions and examples, see "Instructions and Examples" sheet (T-36.1.1).
- Minimum length of frame = 12'-0"
- For arm lengths 35' to 40' and sign depths 80" thru 120"
 - Use 5x3x1/4 chord L's
 - Frame width = Cap R 1/2"
- On single post sign structures the post shall be raked out of plumb, with the use of the leveling nuts to make the bottom of the sign frame level.
- At final position of post all top and bottom nuts shall be tightened against base plate.

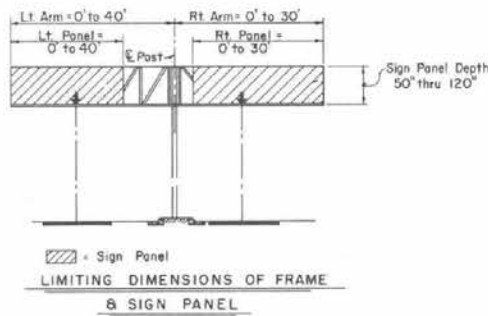

LIMITING DIMENSIONS OF FRAME & SIGN PANEL

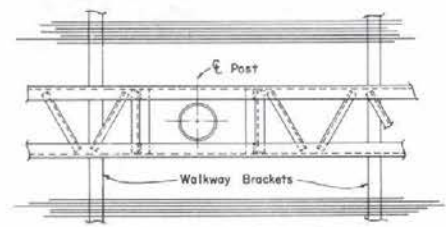

PART PLAN OF DOUBLE FACED TYPE AT POST

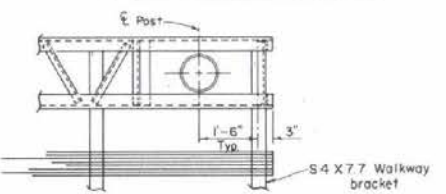

PART PLAN OF CANTILEVER TYPE AT POST

T-24



STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS - SINGLE POST
STRUCTURAL FRAME MEMBERS**

T-36.1.4 - (827)

ADOPTED: 8/69 REVISION: 3-1/76

Russell C. Hill
CHIEF TRAFFIC ENGR.

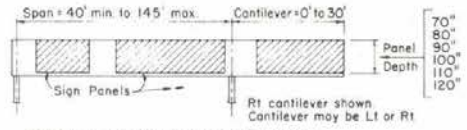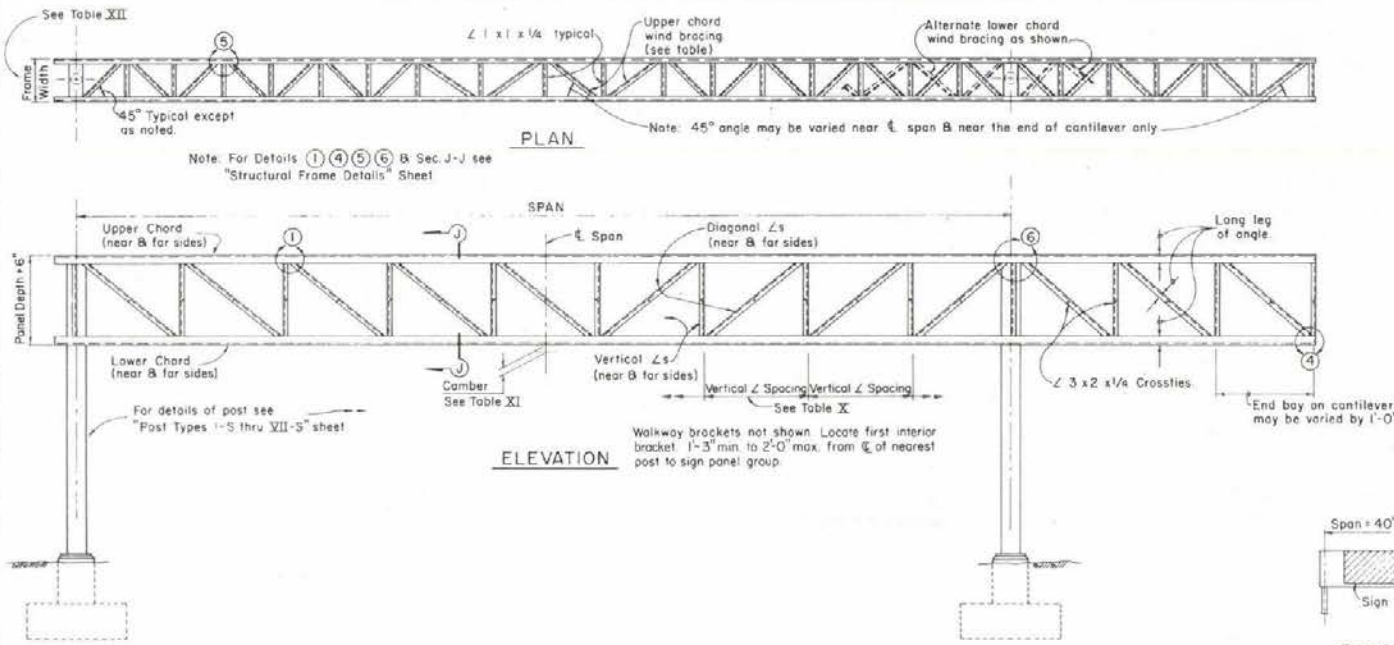

Span	70" Panel Depth					80" Panel Depth					90" Panel Depth				
	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing
40'-50'	2'-0"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
51'-60'	2'-0"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
61'-70'	2'-6"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-6"	5x3 1/2 x 5/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-6"	5x3 1/2 x 5/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
71'-80'	2'-6"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	2'-6"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/4 x 1 1/4 x 1/4	3'-0"	6x4 x 3/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
81'-90'	3'-0"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/2 x 1 1/2 x 1/4	3'-0"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/2 x 1 1/2 x 1/4	3'-0"	6x4 x 3/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
90'-100'	3'-0"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/2 x 1 1/2 x 1/4	3'-0"	6x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 1/2 x 1 1/2 x 1/4	3'-0"	6x4 x 3/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
101'-110'	3'-0"	7x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	7x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	7x4 x 3/8	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
111'-120'	3'-0"	7x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	7x4 x 3/8	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	8x4 x 1/2	3x3 x 5/8	3x3 x 5/8	1 1/4 x 1 1/4 x 1/4
121'-132'	3'-0"	8x4 x 1/2	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	8x4 x 1/2	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-6"	8x4 x 1/2	3x3 x 5/8	3x3 x 5/8	2 x 2 x 1/4
133'-145'	3'-0"	8x4 x 1/2	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-0"	8x4 x 1/2	3x3 x 1/4	3x3 x 1/4	1 3/4 x 1 3/4 x 1/4	3'-6"	8x4 x 1/2	3x3 x 5/8	3x3 x 5/8	2 x 2 x 1/4

Span	100" Panel Depth					110" Panel Depth					120" Panel Depth				
	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing	Frame Width	Chord Ls	Vertical Ls	Diagonal Ls	Wind Bracing
40'-50'	2'-0"	5x3 1/2 x 5/8	3x3 x 3/8	3x3 x 3/8	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4	2'-0"	5x3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
51'-60'	2'-0"	5x3 1/2 x 5/8	3x3 x 3/8	3x3 x 3/8	1 1/4 x 1 1/4 x 1/4	2'-6"	5x3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4	2'-6"	5x3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
61'-70'	2'-6"	5x3 1/2 x 5/8	3x3 x 3/8	3x3 x 3/8	1 1/2 x 1 1/2 x 1/4	3'-0"	5x3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	1 1/2 x 1 1/2 x 1/4	3'-0"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
71'-80'	3'-0"	6x4 x 3/8	3x3 x 3/8	3x3 x 3/8	1 3/4 x 1 3/4 x 1/4	3'-6"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
81'-90'	3'-0"	6x4 x 3/8	3x3 x 3/8	3x3 x 3/8	1 3/4 x 1 3/4 x 1/4	3'-6"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
91'-100'	3'-0"	6x4 x 3/8	3x3 x 3/8	3x3 x 3/8	1 3/4 x 1 3/4 x 1/4	3'-6"	6x4 x 3/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	7x4 x 3/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
101'-110'	3'-6"	7x4 x 3/8	3x3 x 3/8	3x3 x 3/8	2 x 2 x 1/4	3'-6"	7x4 x 3/8	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	7x4 x 3/8	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	1 1/4 x 1 1/4 x 1/4
111'-120'	3'-6"	7x4 x 3/8	3x3 x 3/8	3x3 x 3/8	2 x 2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	2 1/2 x 2 1/2 x 1/4
121'-132'	3'-6"	8x4 x 1/2	3x3 x 3/8	3x3 x 3/8	2 x 2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 x 2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	2 1/2 x 2 1/2 x 1/4
133'-145'	3'-6"	8x4 x 1/2	3x3 x 3/8	3x3 x 3/8	2 x 2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	3 1/2 x 3 1/2 x 5/8	2 1/2 x 2 1/2 x 1/4	3'-6"	8x4 x 1/2	3 1/2 x 3 1/2 x 5/8	4 x 3 1/2 x 5/8	2 1/2 x 2 1/2 x 1/4

TABLE XII

Panel Depth	Frame Depth	Max. Vertical L Spacing
70"	6'-4"	72"
80"	7'-2"	72"
90"	8'-0"	90"
100"	8'-10"	90"
110"	9'-8"	120"
120"	10'-6"	120"

TABLE X

Camber For Fabrication At $\frac{1}{4}$ Span	
Span	Camber
40' - 50'	1/2"
51' - 100'	1"
101' - 145'	1 1/2"

Fabricate camber to approximate parabola
Camber of cantilever arm = 1/2" for arms greater than 10'.

TABLE XI







NOTE:
Frame widths shown are nominal. These widths may be varied by 1/4" to standardize fabrication methods.
Add 6" to frame width for Post Type V-S & VI-S; Add 1'-0" for Post Type VII-S.
Add 6" to frame width for Post Type VIII-S.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS - TWO POST
STRUCTURAL FRAME MEMBERS**


Russell C. Hill
CHIEF TRAFFIC ENGR.

T - 36.1.5 - (627)
ADOPTED: 8/69 REVISION

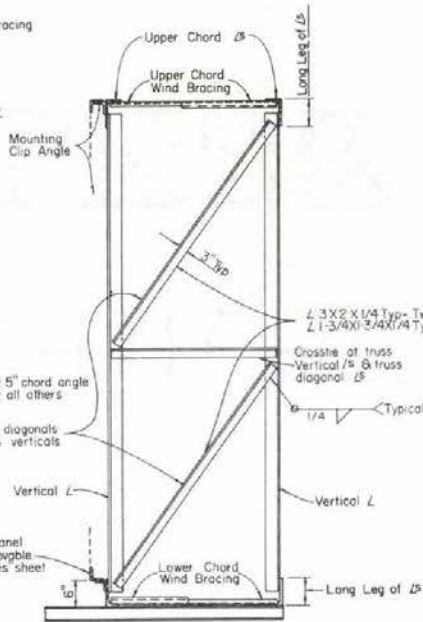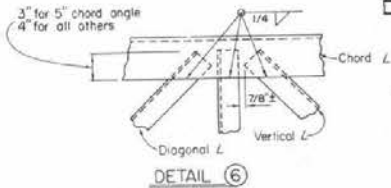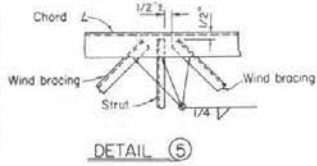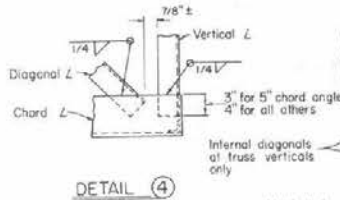


TYPICAL SECTION J-J

Note: Diagonal L in plane of truss, not shown. Bracing shown is at all vertical L's of truss.

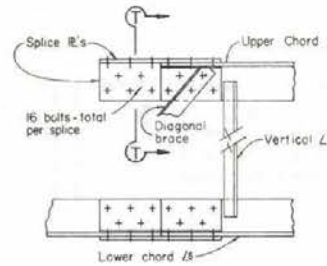

OPTIONAL BOLTED CHORD SPLICE

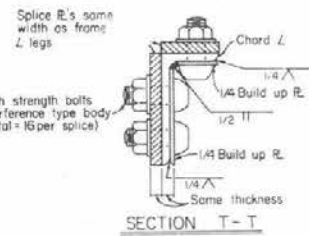

SECTION T-T


SPLICE NOTES

Specifications
The bolted splice shall conform to current Specifications for Structural Joints Using ASTM A325 Bolts, approved by the Research Council on Riveted and Bolted Structural Joints of the Engineering Foundation.

Location of Splices
The splice shall be located so as not to interfere with mounting the walkway brackets or the clip angles for the removable sign panel frame. The wind bracing in the area of the bolted chord splice will be bolted to the chord angles with a 3/8 unfinished bolt, with hex head and nut, 2 cut washers and lock washer.

Bolts
The bolts shall be high strength with an interference type body and torqued to the required amount as stated in the above specifications.

Build Up Plate
The plates welded to the angle legs on the inside shall be welded before punching the bolt holes. They shall be the same length as the cover plates. The plates are not necessary on the single post signs if the splice is located over 1/3 of the corner length from the post. Alternative splice details may be used if approved by the Engineer.

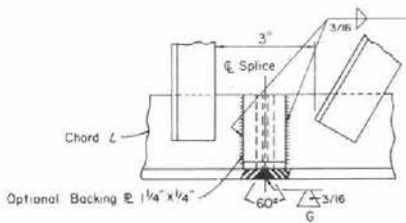

WELDED CHORD SPLICE

Note:
1. Prepare edges by beveling to angle shown
2. Weld to 100% full penetration
3. Grind flush with base metal

BOLTED CHORD SPLICE	
TWO POST SIGNS	
Chord L	Nominal Bolt Diam
5X3 1/2 X 5/8	3/4"
6X4 X 3/8	7/8"
7X4 X 7/8	1"
8X4 X 1/2	1 1/8"
8X4 X 5/8	1 1/4"
SINGLE POST SIGNS	
Chord L	Nominal Bolt Diam
5 X 3 X 5/16	3/4"
5 X 3 X 7/16	3/4"


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS
STRUCTURAL FRAME DETAILS**

T - 36.1.6 - (627)

ADOPTED: 8/69 REVISION: 1-1/74

Russell C. Hill
CHIEF TRAFFIC ENGINEER

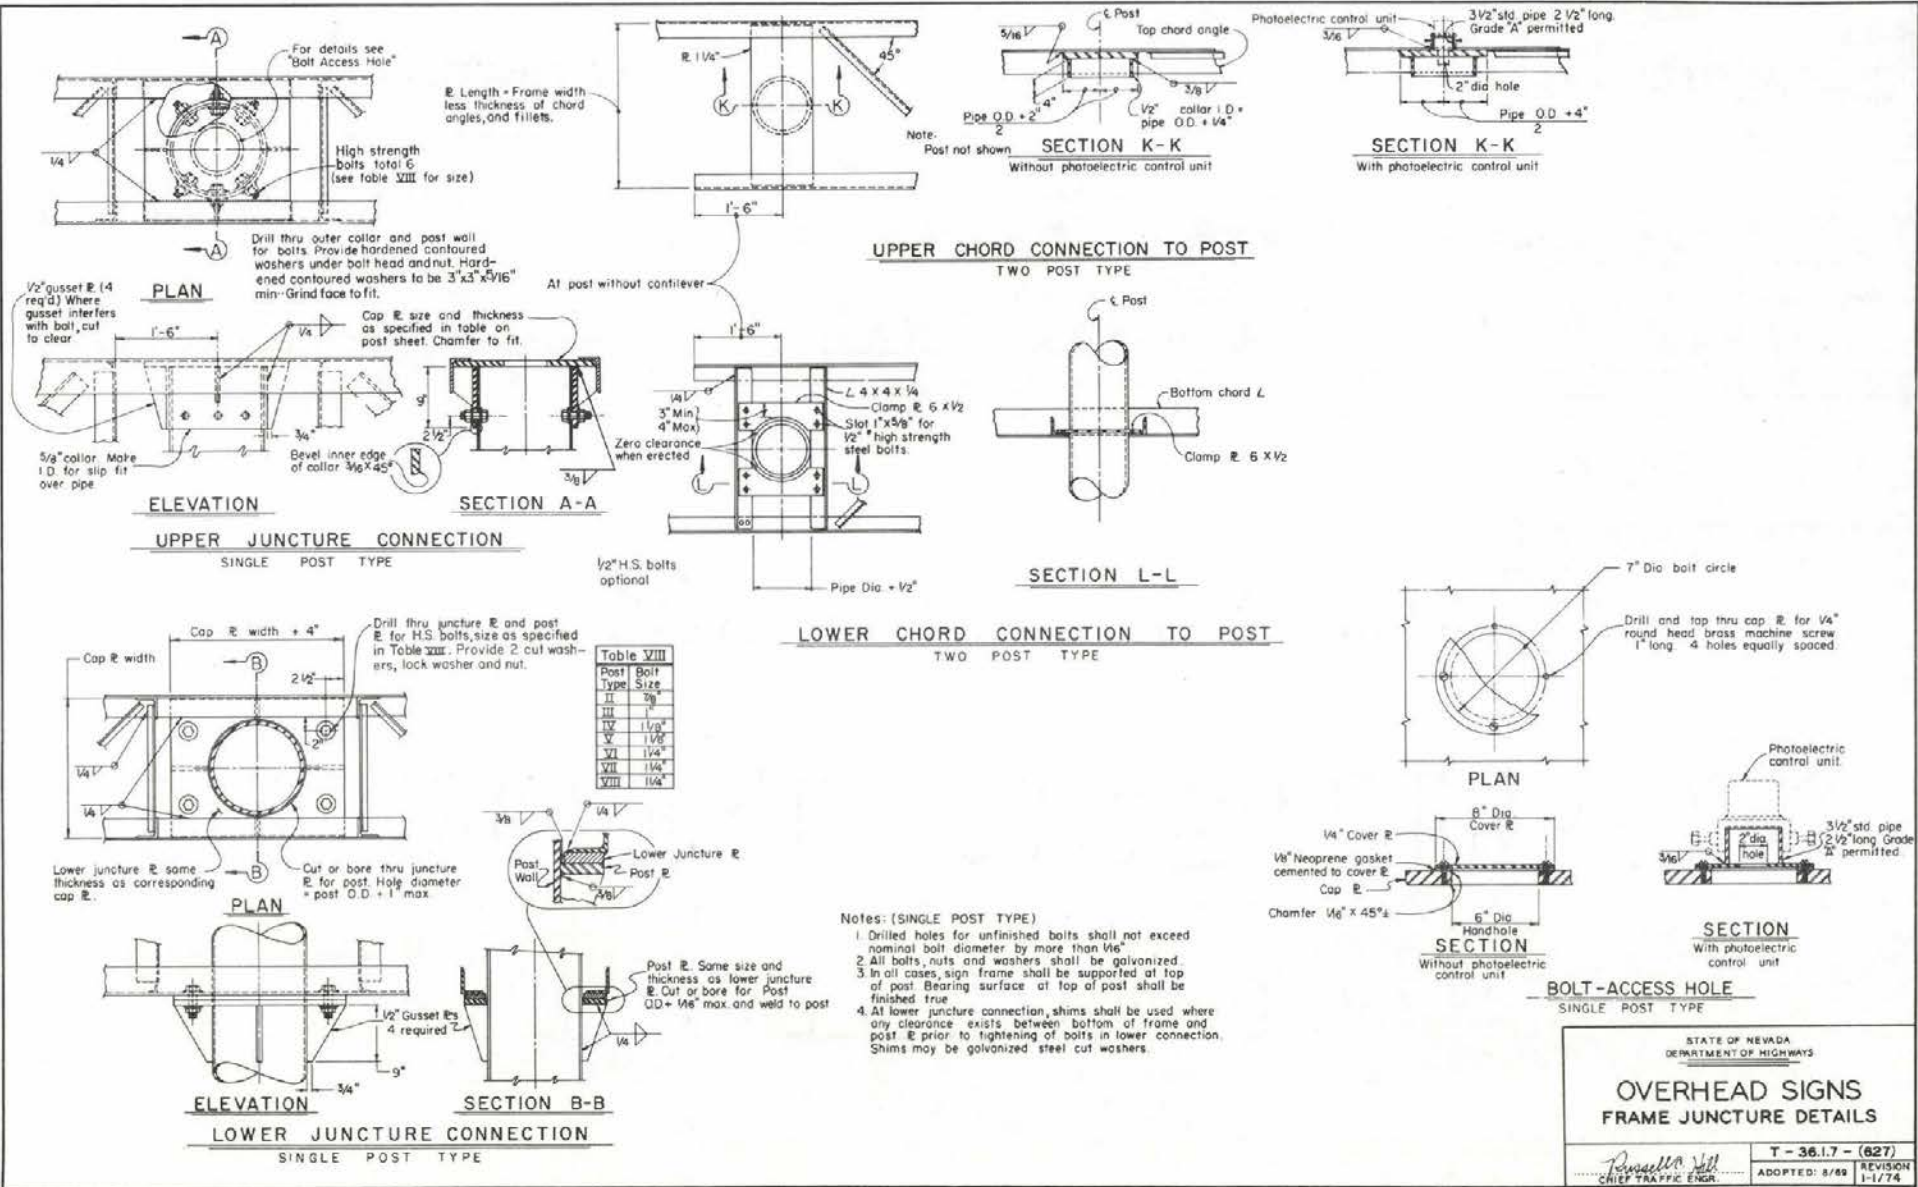

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**OVERHEAD SIGNS
FRAME JUNCTURE DETAILS**

T - 36.17 - (627)




ADOPTED: 8/69

REVISION
1-1/74

Russell Hill
CHIEF TRAFFIC ENGR.

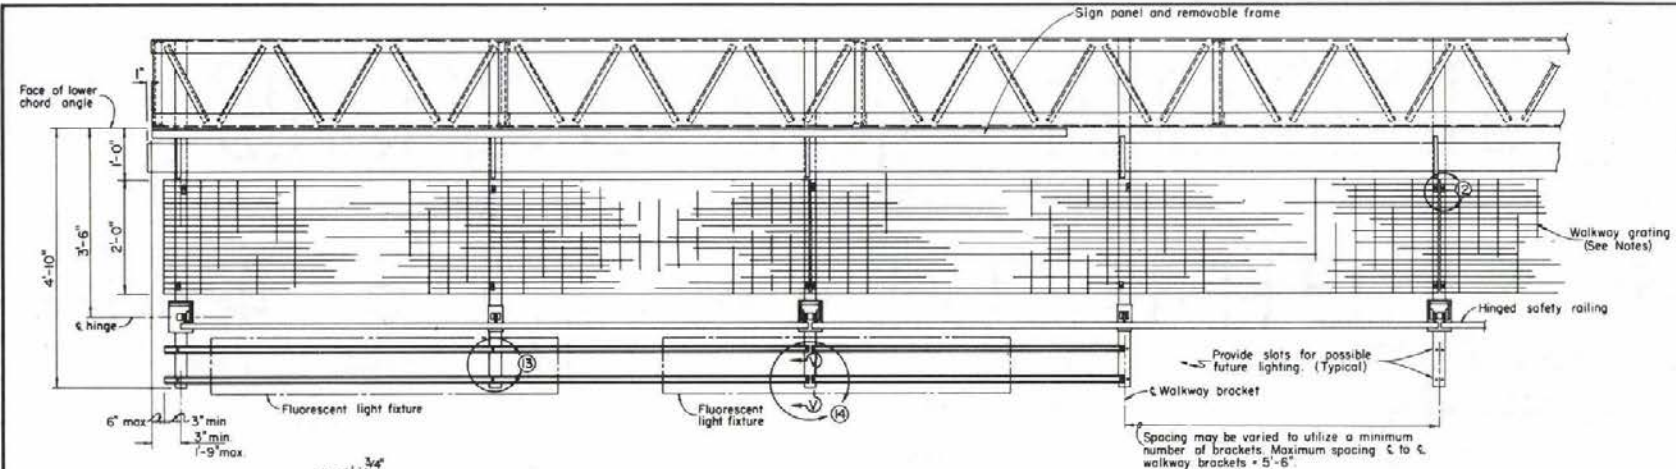

WALKWAY PLAN
Scale 1" = 1'-0"

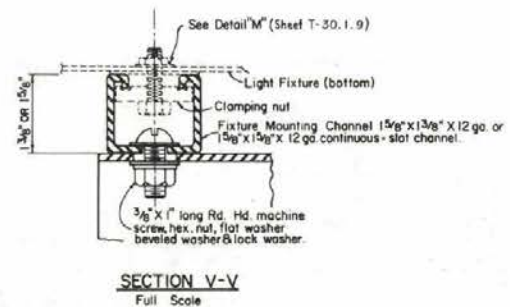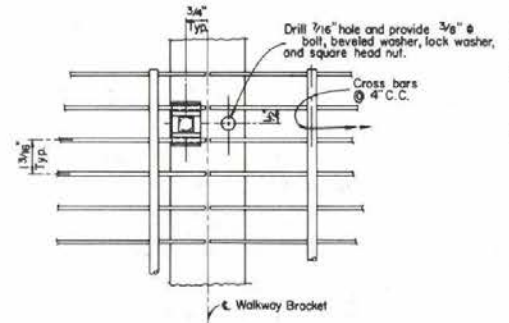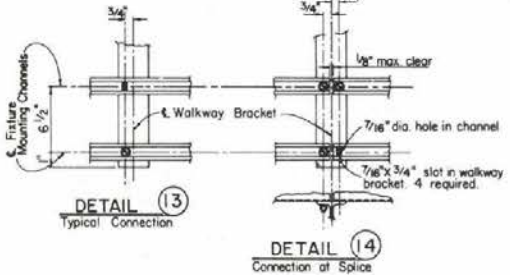


1. Welded-type grating shall have 1 1/4" x 1/8" bearing bars @ 1 3/8" centers with 1/4" diameter (or equal) cross bars @ 4" centers. See detail (2). If mechanical lock grating is used it shall be equal in strength to the welded-type. Alternate hold-down clips may be submitted for approval.
2. For spacing of lighting fixtures see table of spacings on "fluorescent sign lighting equipment" sheet.
3. Walkway grating and light fixture mounting channels to be continuous (no splices) over as many walkway brackets as practicable consistent with fabrication, ease of handling and assembling.
4. Bolts, nuts, washers, etc. to be galvanized.

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS


**OVERHEAD SIGNS
WALKWAY DETAILS NO. 1**

RUSSELL C. HILL CHIEF TRAFFIC ENGR.	T - 36.1.9 - (627) ADOPTED: 8/69 REVISION 2 // 23
--	--

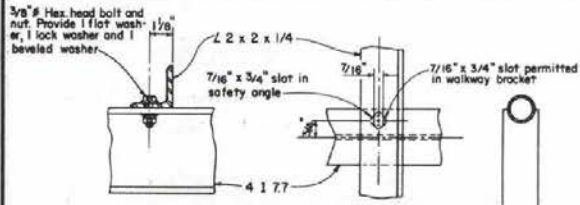


SAFETY ANGLE DETAILS

NOTE: On structure mounted signs replace gutter with a safety L 2x2x1/4 positioned with gage line 7 inches from mounting bracket L 5x3x1/4.

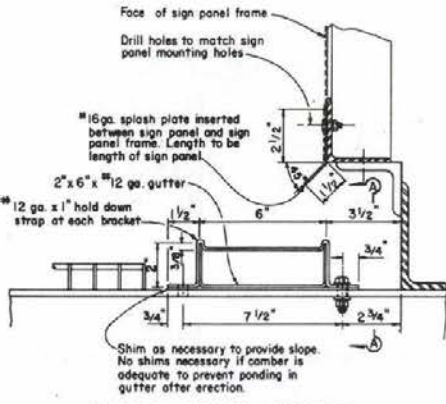


TYPICAL GUTTER SECTION


NOTES: Gutter sections to be made in convenient lengths and welded or brazed together in the field. On sign bridges where panels face two directions, end gutters 1 1/2 past edge of panels nearest to ϵ Span.




SECTION A-A

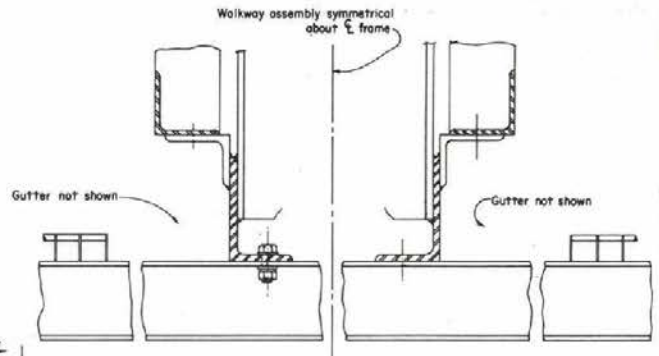


FOR DOUBLE-FACED SIGN FRAMES

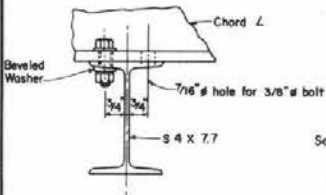

SECTION B-B

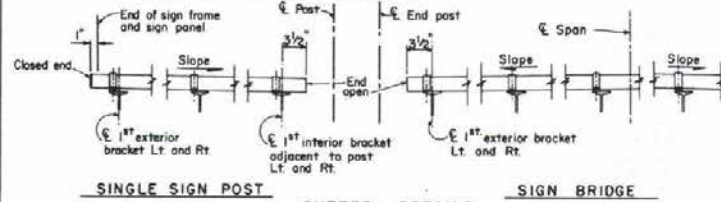

SINGLE SIGN POST GUTTER DETAILS SIGN BRIDGE

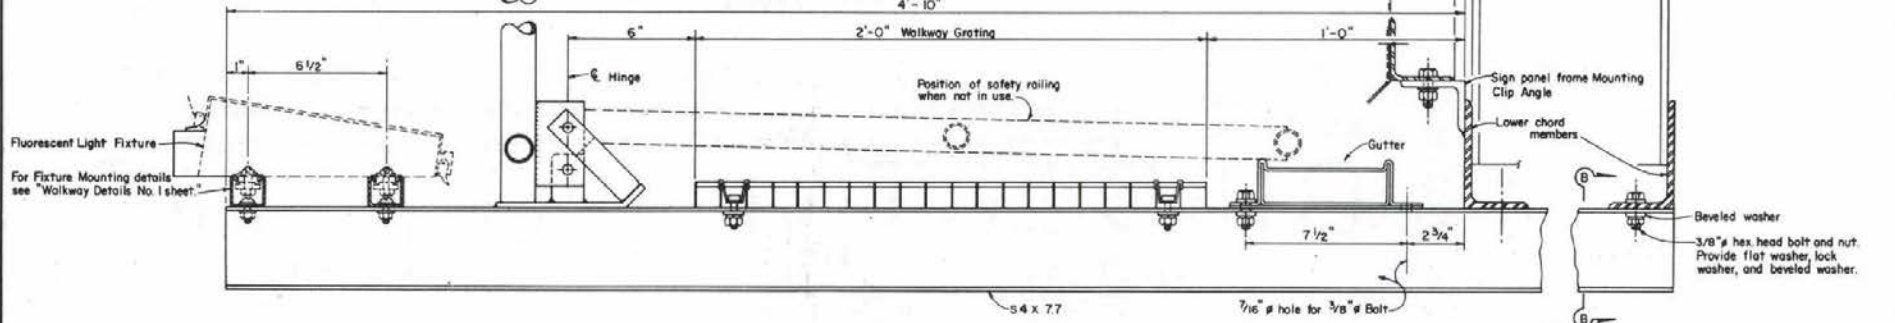

WALKWAY ASSEMBLY


STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS
WALKWAY DETAILS NO. 2**


Dracell Hill
CHIEF TRAFFIC ENGR.

T-36.110-(627)	REVISION
ADOPTED 1/68	2/78

T 30

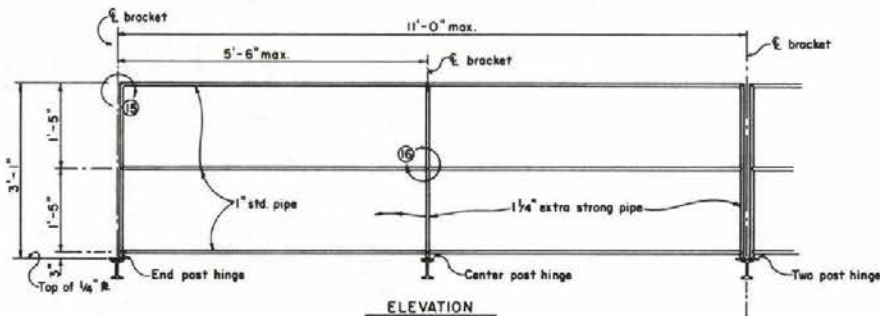


ELEVATION

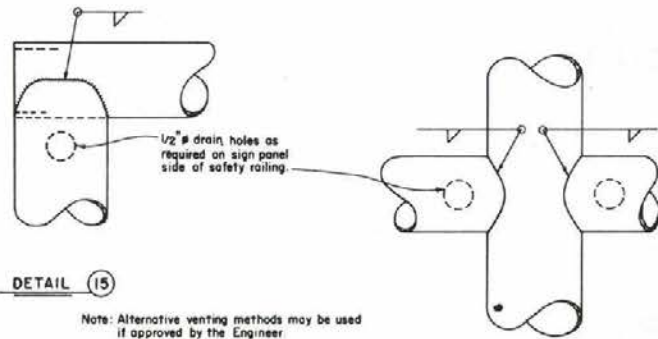


DETAIL 15



DETAIL 16

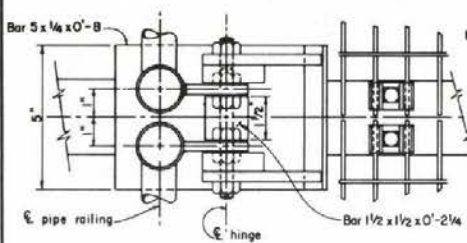


PLAN VIEW - TWO POST HINGE

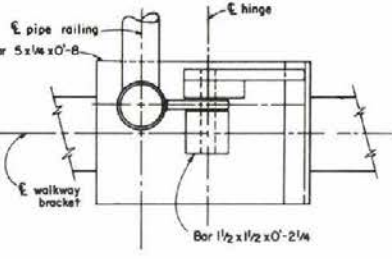


PLAN VIEW - END POST HINGE

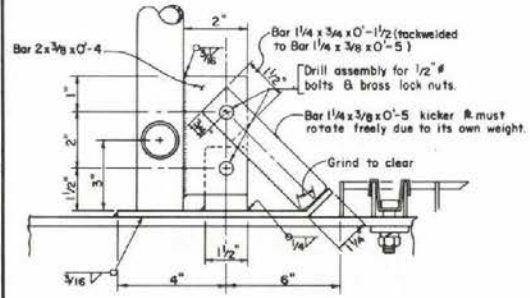


ELEVATION

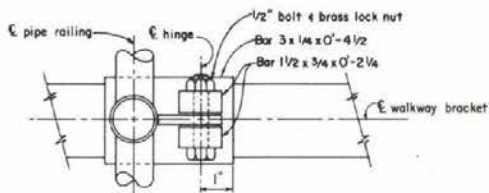

PLAN VIEW - CENTER POST HINGE



SECTION W-W

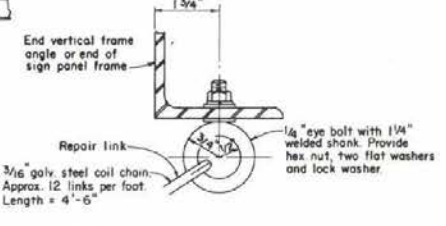

SECTION A-A

CHAIN ASSEMBLY

- Note:
1. Special care shall be taken to insure that the completed hinge and latch assembly will hold the safety railing in a steady manner, free of wobble while in the raised position. Maximum allowable displacement from vertical at top of railing when latched shall be 1".
 2. Details for bolting hinge base & walkway bracket may be submitted for approval.
 3. Alternative details approved by the Engineer may be substituted for the safety chain connections shown.



STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

**OVERHEAD SIGNS
WALKWAY SAFETY RAILING DETAILS**

Thomson Hill
CHIEF TRAFFIC ENGR.

T - 36.1.11 - (627)
ADOPTED: 8/68 REVISION
1-1/74

T-13

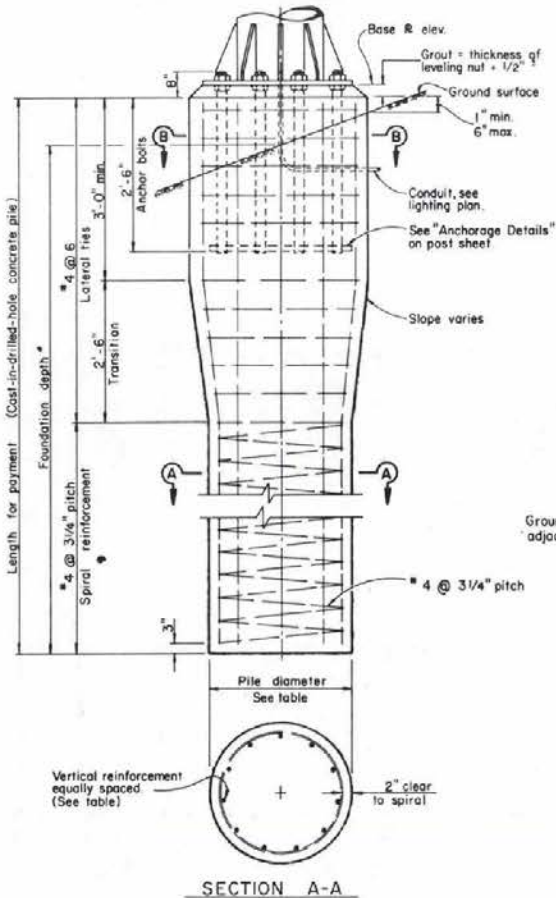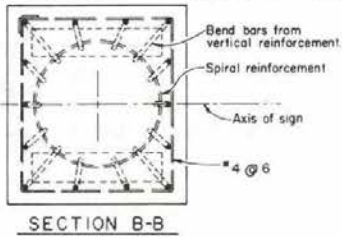


Post Type	Anchor Bolts	Pedestal Size	Reinforcing Steel Vertical	Pile Diameter	Foundation Depth*
II	6 - 2"	2'-11" x 2'-8"	14 - #7	30"	14'
III	6 - 2"	3'-2" x 2'-10"	14 - #8	30"	14'
IV	6 - 2"	3'-8" x 3'-4"	16 - #8	36"	14'
V	10 - 2"	3'-10" x 3'-7"	16 - #9	36"	17'
VI	10 - 2"	3'-10" x 3'-7"	16 - #10	36"	18'
VII	12 - 2"	4'-3" x 3'-11"	16 - #11	36"	21'
VIII	12 - 2"	4'-5" x 3'-11"	16 - #14	36"	22'
I-S	6 - 2"	2'-7" x 2'-3"	14 - #7	30"	14'
II-S	6 - 2"	3'-0" x 2'-6"	14 - #8	30"	16'
III-S	6 - 2"	3'-4" x 2'-7"	14 - #10	30"	18'
IV-S	8 - 2"	3'-6" x 3'-2"	16 - #10	36"	19'
V-S	8 - 2"	3'-8" x 3'-4"	16 - #11	36"	22'
VI-S	8 - 2"	4'-0" x 3'-4"	16 - #11	36"	23'
VII-S	8 - 2 1/4"	4'-5" x 3'-11"	16 - #14	36"	25'

* Use Foundation Depth shown in table unless otherwise shown on the Format Sheet.

NOTES:

1. For anchor bolt layout see Post Sheet.
2. For Base & Elev. see Format Sheet.
3. Pedestal and pile shall be Class A P.C.C.
4. Pedestals & Base Plates, longer sides shall be normal to axis of sign.
5. The excavation around the formed pedestal shall be backfilled & compacted with material equivalent to the surrounding material.
6. Pedestal shall be formed 6" min below ground surface.
7. Slope protection required when indicated on the plans. See Detail C.

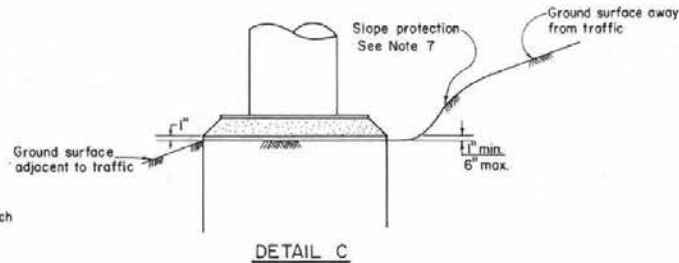

STATE OF NEVADA
DEPARTMENT OF HIGHWAYS

OVERHEAD SIGNS ALTERNATE PILE FOUNDATION

T-36.1.12 - (627)
ADOPTED: 8/89 REVISION
2-1/74

Donald H. Hill
CHIEF TRAFFIC ENGR.